




1 CONDUIT RACK WALL MOUNTED TYPE A NO SCALE

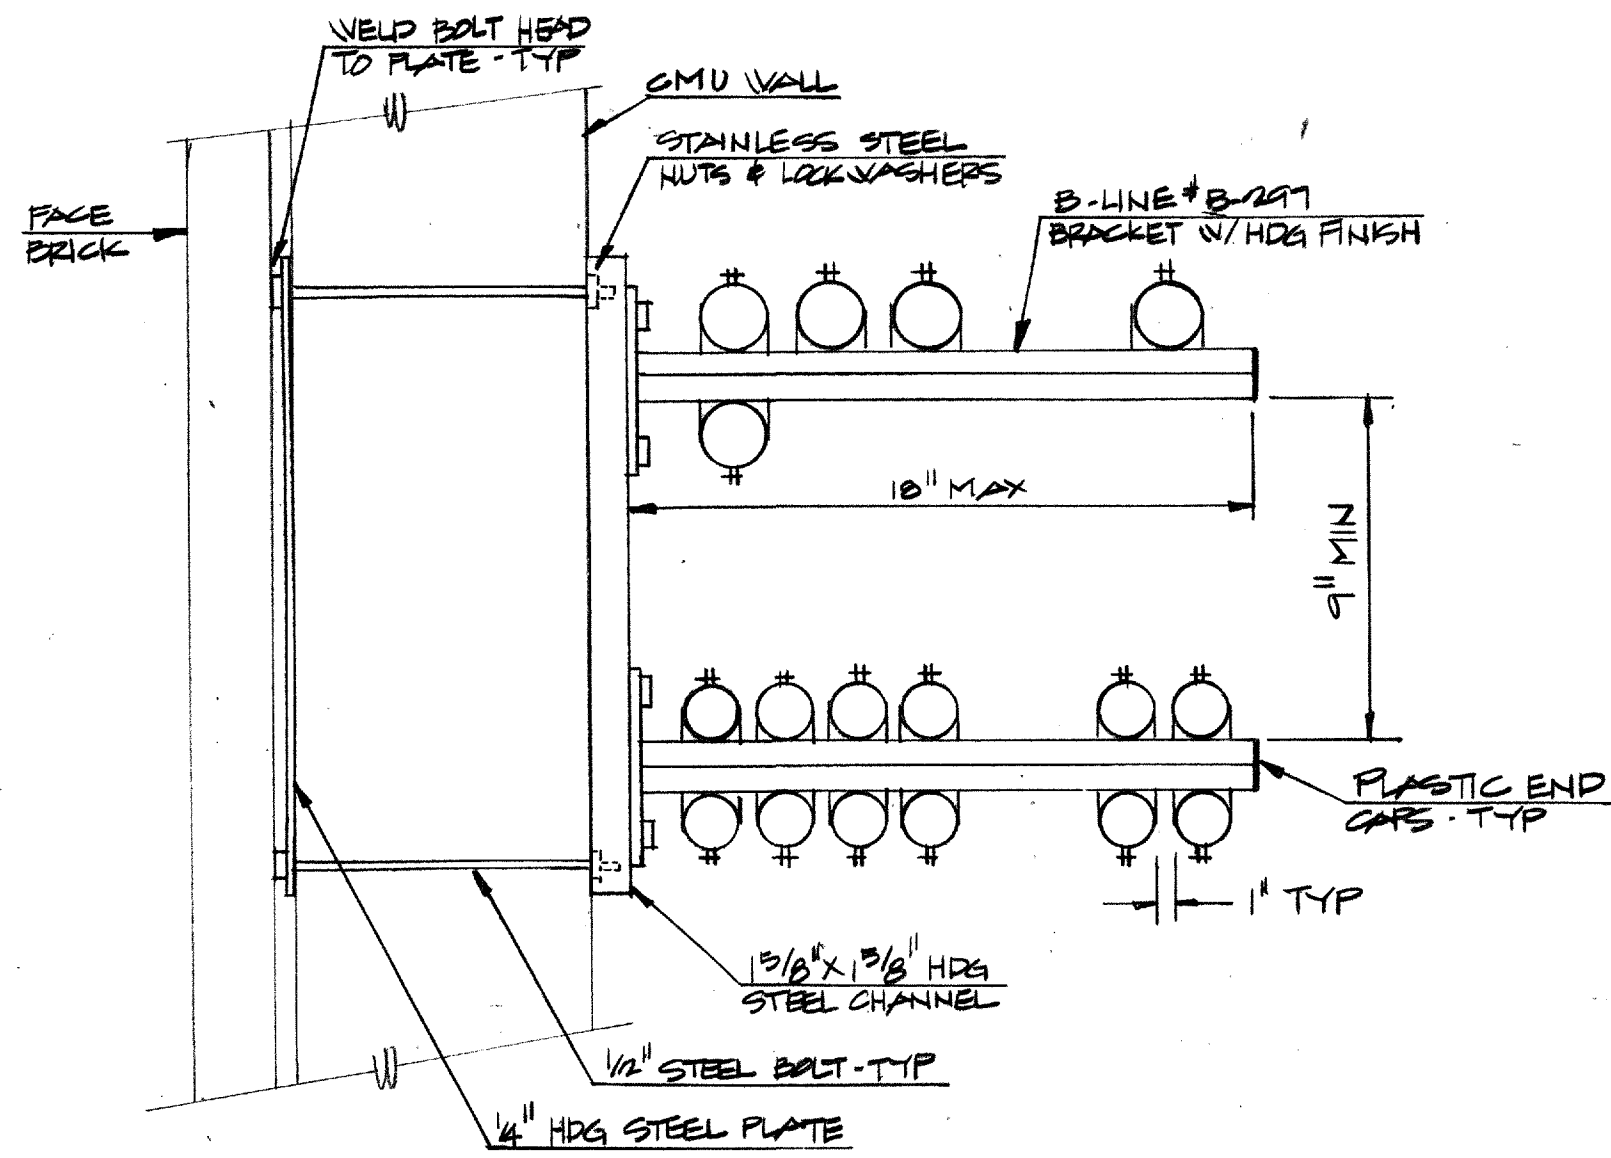


3 CONDUIT RACK-WALL MOUNTED TYPE B NO SCALE

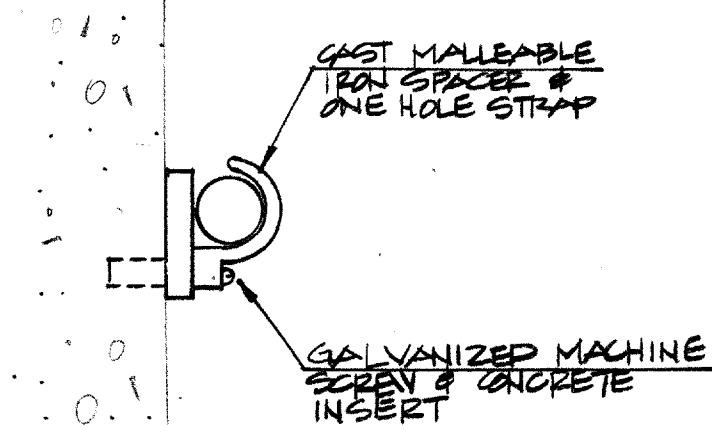

2 EXPOSED CONDUIT INSTALLATION CEILING OR WALL NO SCALE

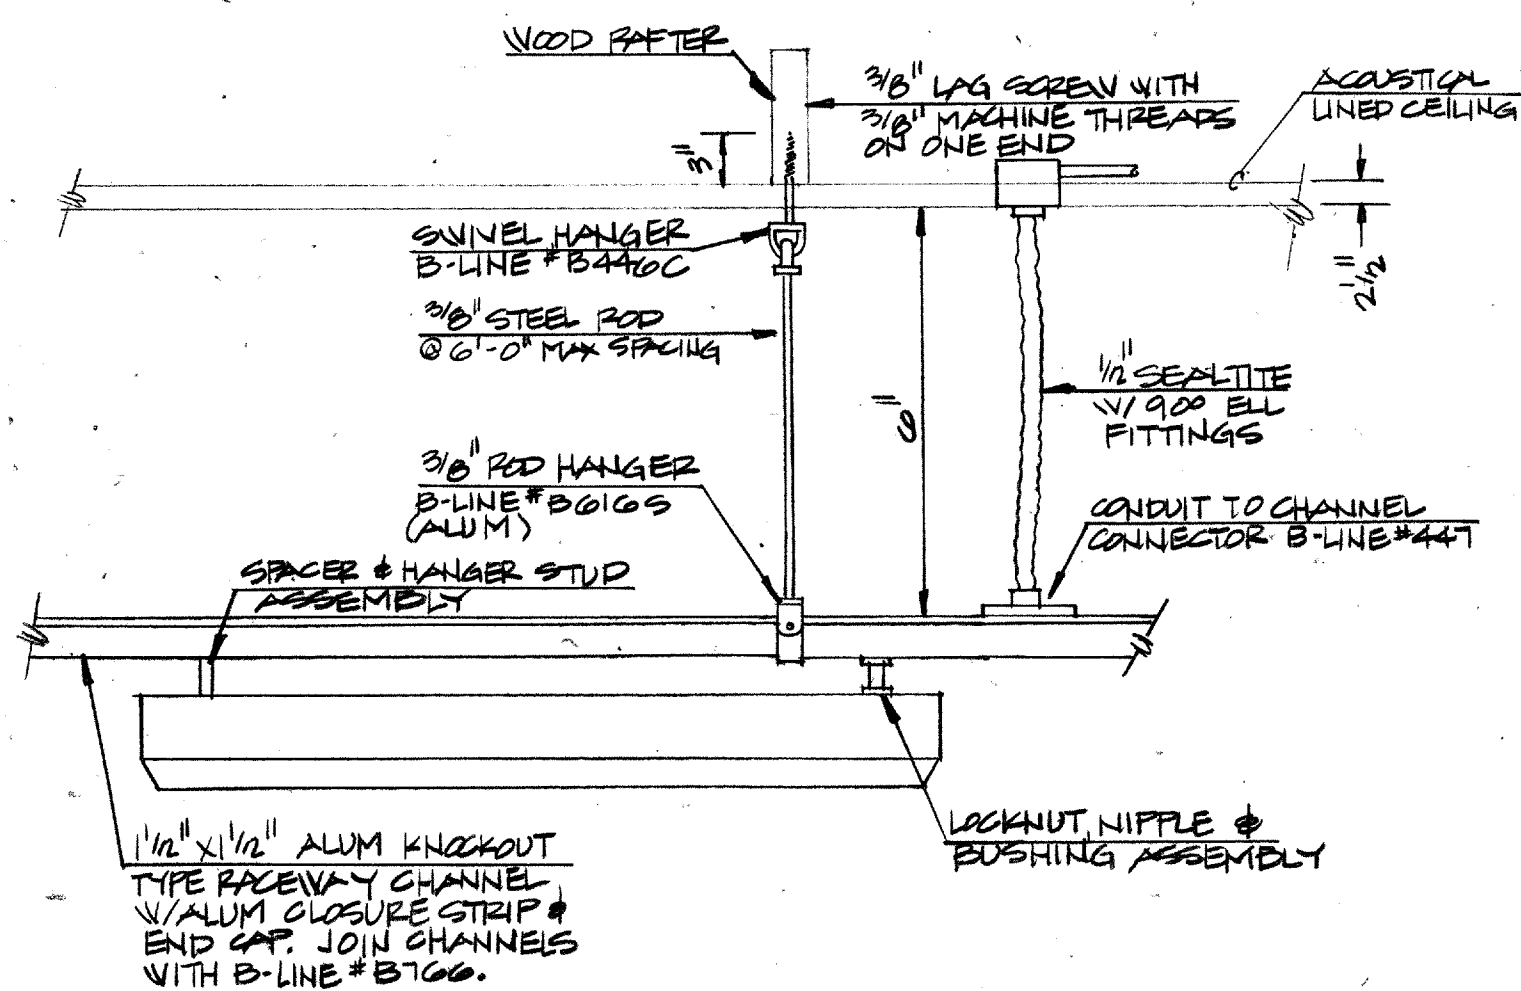

4 LIGHTING FIXTURE INSTALLATION NO SCALE

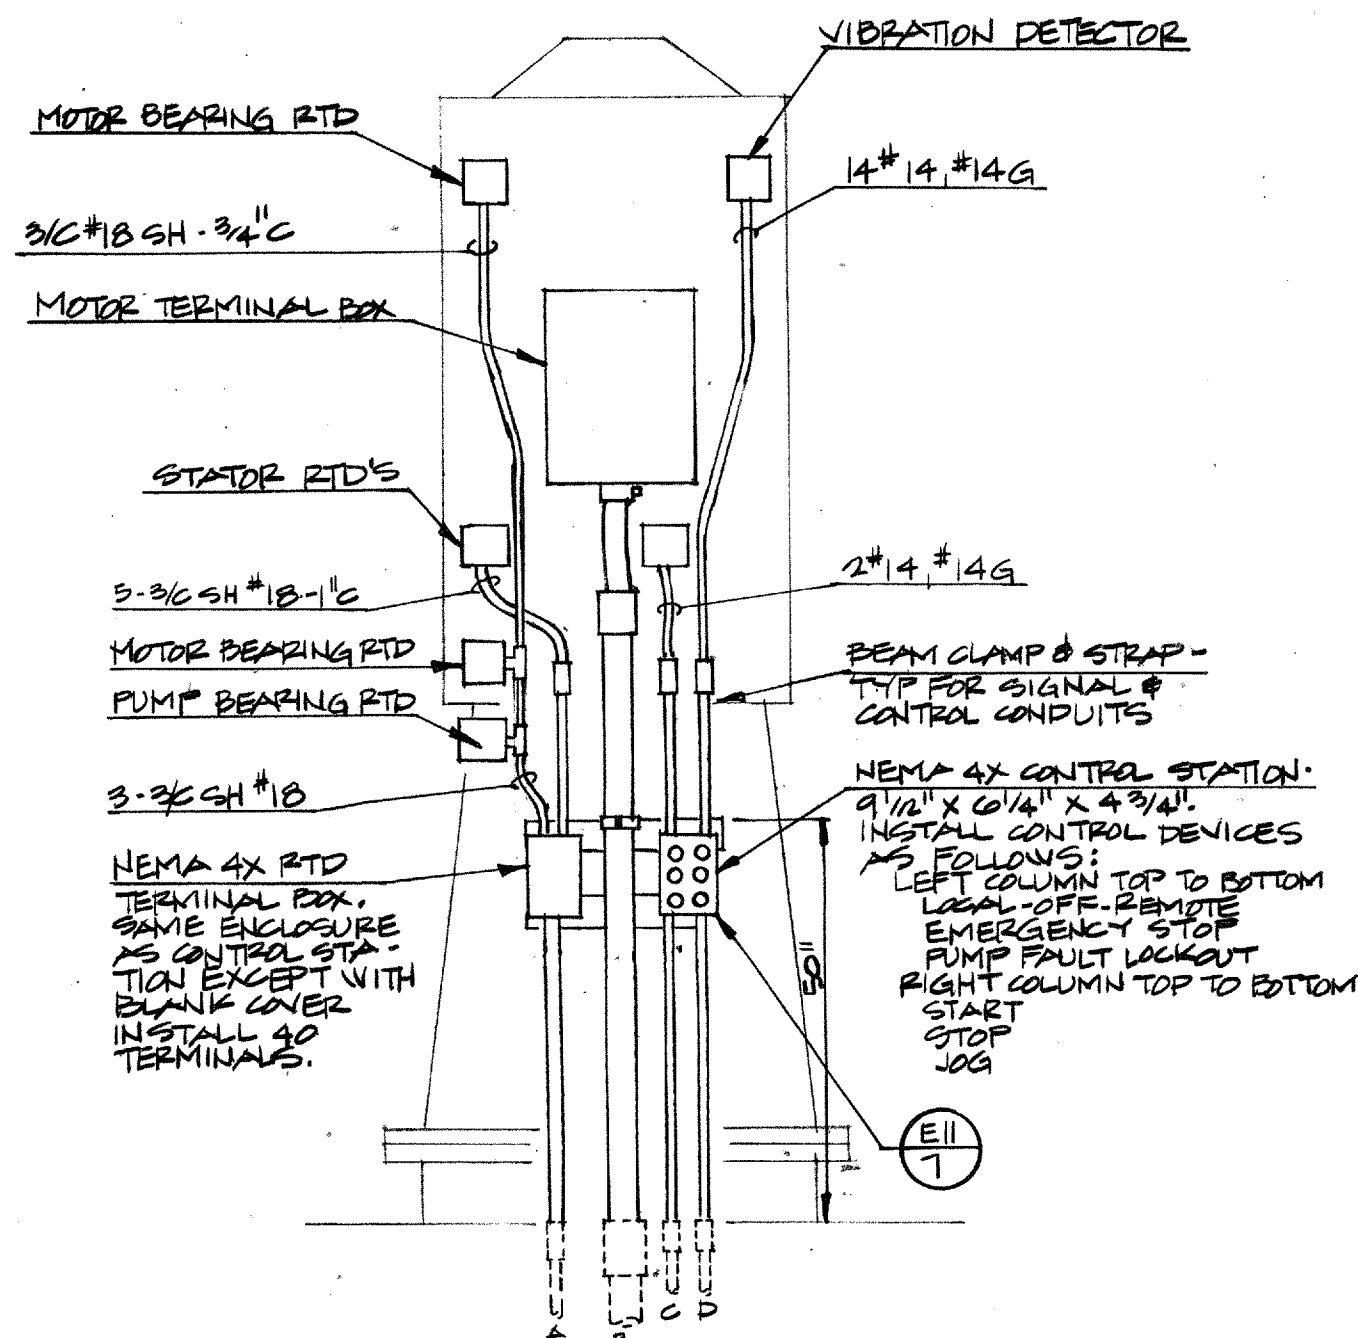


NOTES:
 1. SECTION SHOWN IS FOR PUMP WP-1 & IS TYPICAL FOR PUMPS WP-2 & WP-3. CONDUIT CORES SHALL BE AS FOLLOWS:

PUMP	A	B	C	D
WP-1	S107	P107	C107	C117
WP-2	S109	P109	C109	C119
WP-3	S111	P111	C111	C121


2. CONDUITS FOR FUTURE PUMPS WP-2 & WP-4 SHALL BE INSTALLED & CAPPED FLUSH W/ FINISHED FLOOR.

5 SECTION-PUMP WP-1 NO SCALE

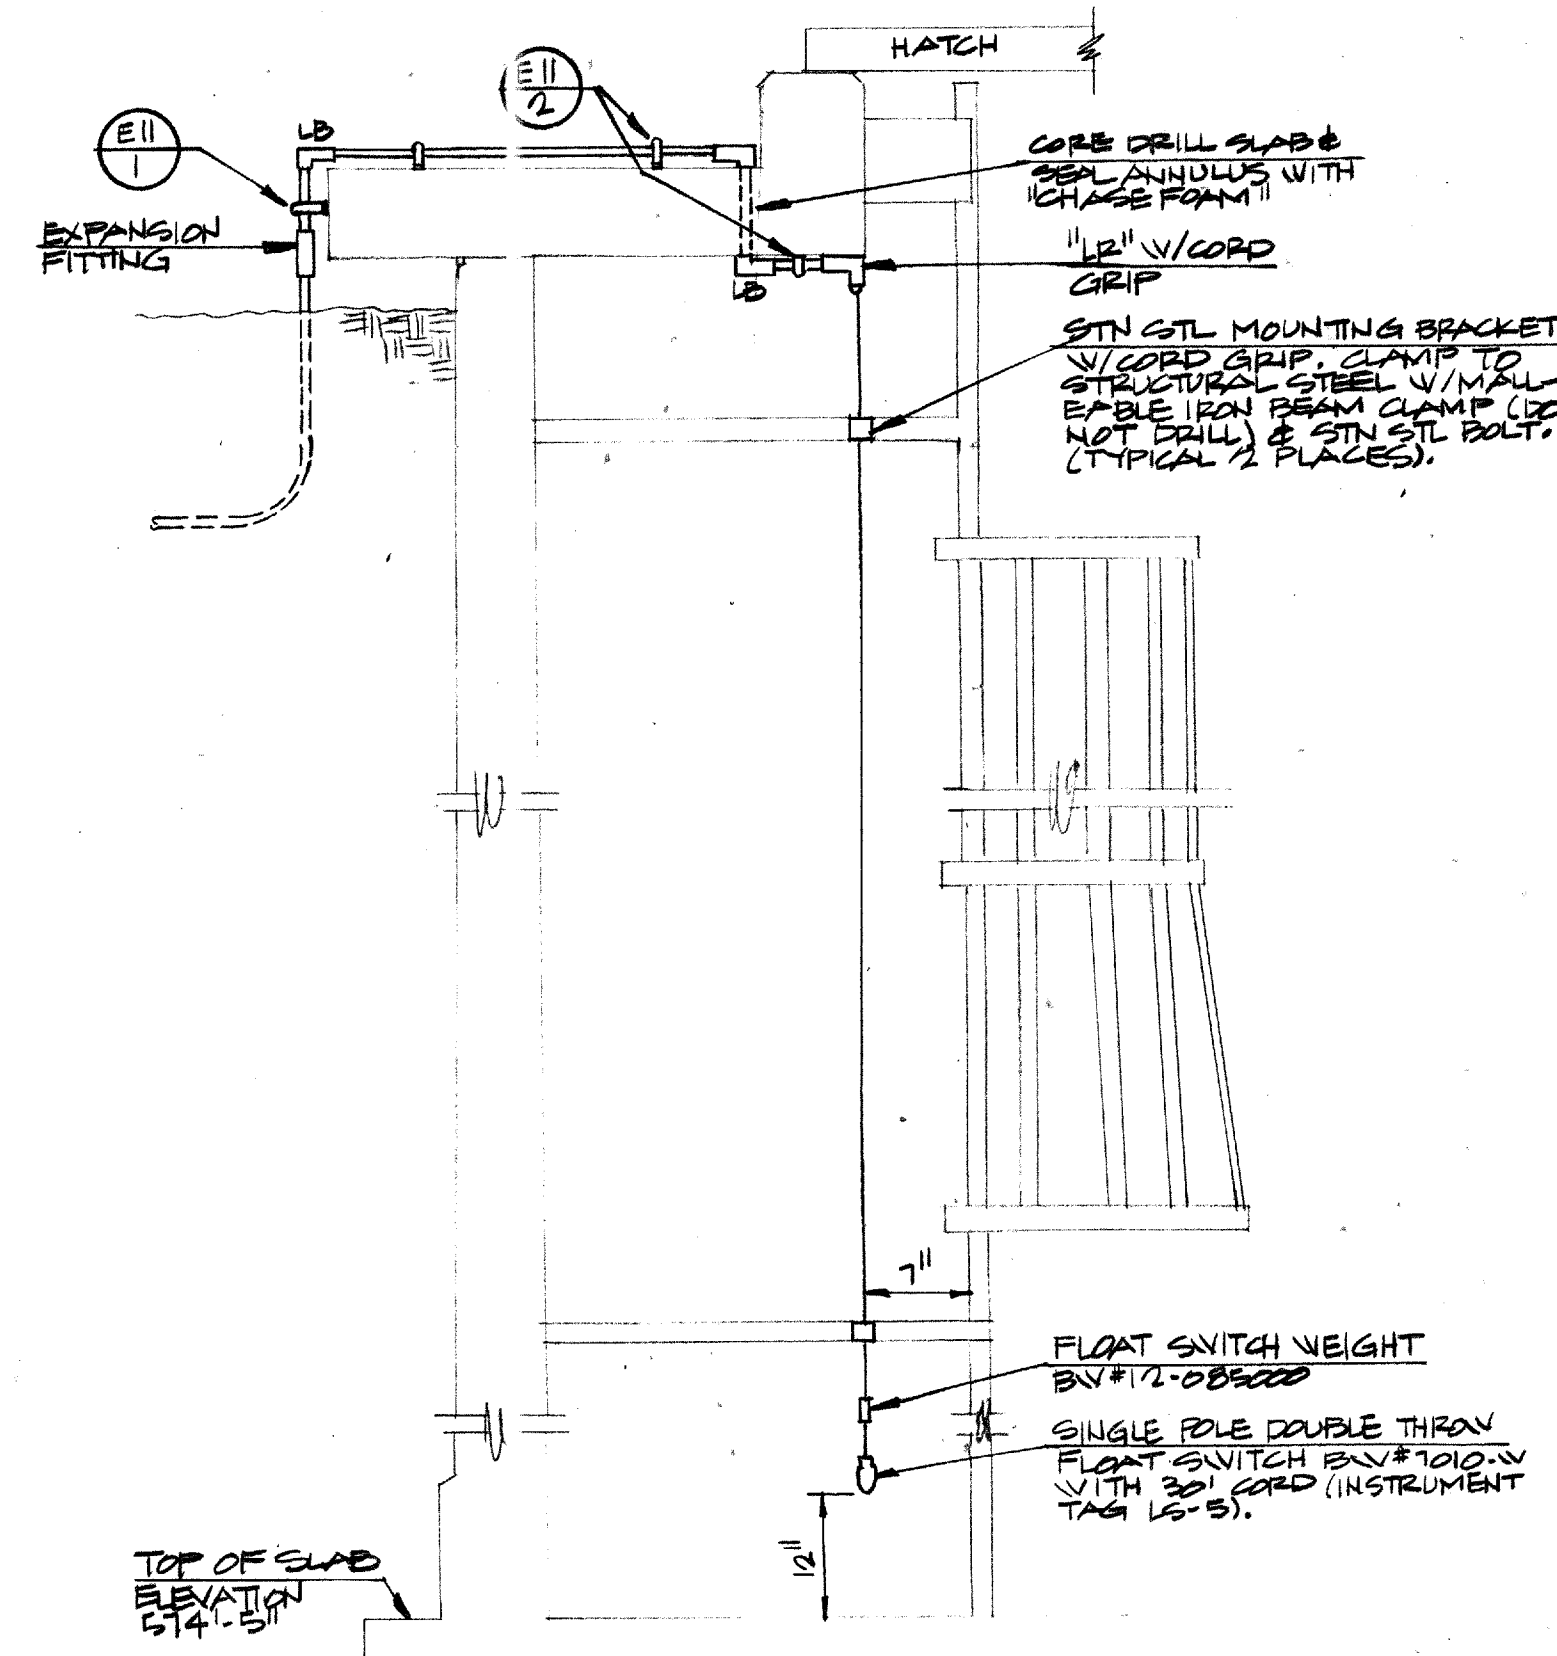


NOTES:
 1. CONDUIT & FITTINGS INSIDE TANK SHALL BE ALUMINUM.

6 SECTION-LEVEL SWITCH NO SCALE

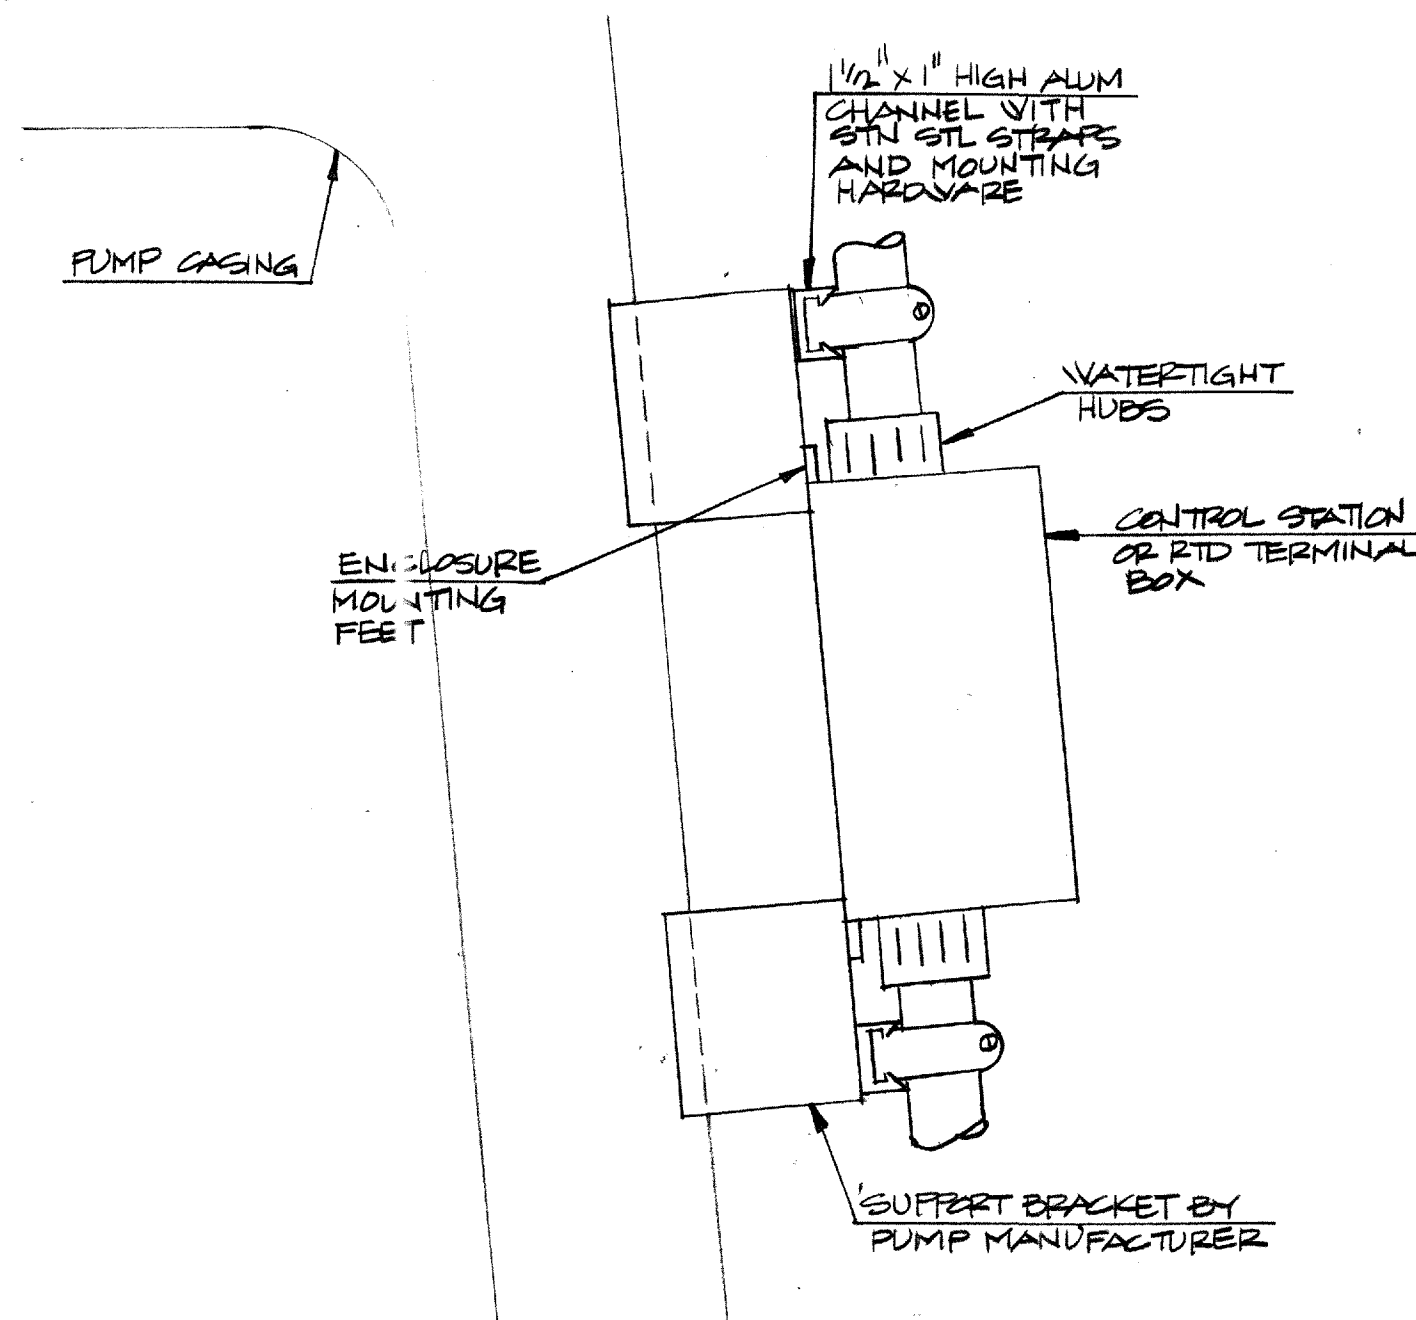


7 CONDUIT AND CONTROL STATION SUPPORT NO SCALE

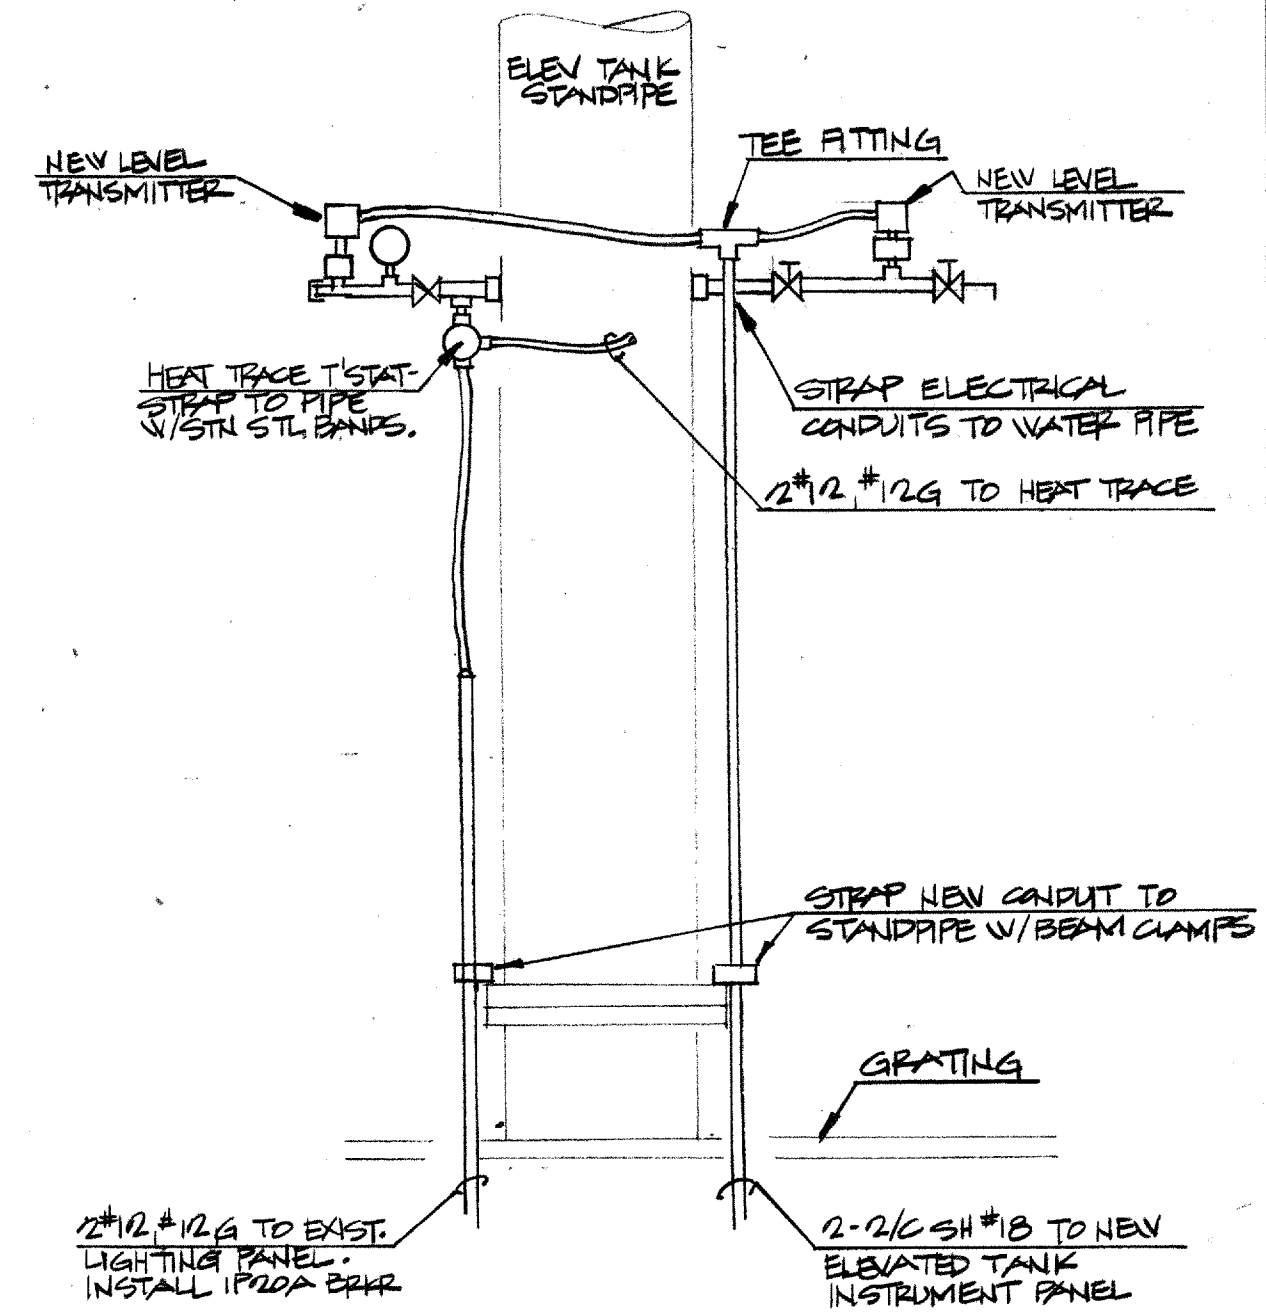

NOTES:
 1. HEAT TRACE & INSULATE ALL PIPING COMING OFF STANDPIPE.
 2. HEAT TRACE SHALL BE THERMON EL-2.5. THERMOSTAT SHALL THERMON TCA-1.
 3. HEAT TRACE END CAPS SHALL BE THERMON ET-10.
 4. INSTALL HEAT TRACE PER MFR INSTRUCTIONS.
 5. FURNISH & INSTALL 1" FIBERGLASS INSULATION.

8 ELEVATED TANK LEVEL TRANSMITTERS-NEW NO SCALE

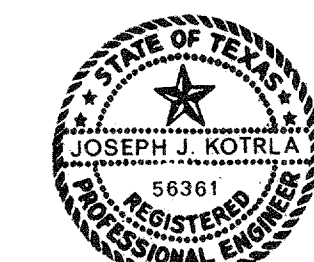

Joseph J. Kotrla
 2-18-87

No.	Revision	By	Date
TOWN OF ADDISON DALLAS COUNTY, TEXAS CELESTIAL ROAD PUMP STATION			
CHARLES R. McCREARY & ASSOCIATES CONSULTING ENGINEERS SUITE 212 6300 LBJ FREEWAY DALLAS, TEXAS 75240		ELECTRICAL DETAILS	
GINN, INC. Consulting Engineers Dallas, Texas			
Designed - JK	Drawn - JW	Date -	Job No. -
Approved -	Checked -	Scale -	Sheet E11 of E12