



EXHAUST FAN	A	B	C	D
EF-4	1Ø	T4	MBD-4	LW-4
EF-5	2Ø	T5	MBD-5	NONE
EF-8	2Ø	T8	MBD-8	NONE

3 CONTROL SCHEMATIC-EF-4, EF-5, EF-8

1 CONTROL SCHEMATIC-CHLORINE ROOM EXHAUST FAN

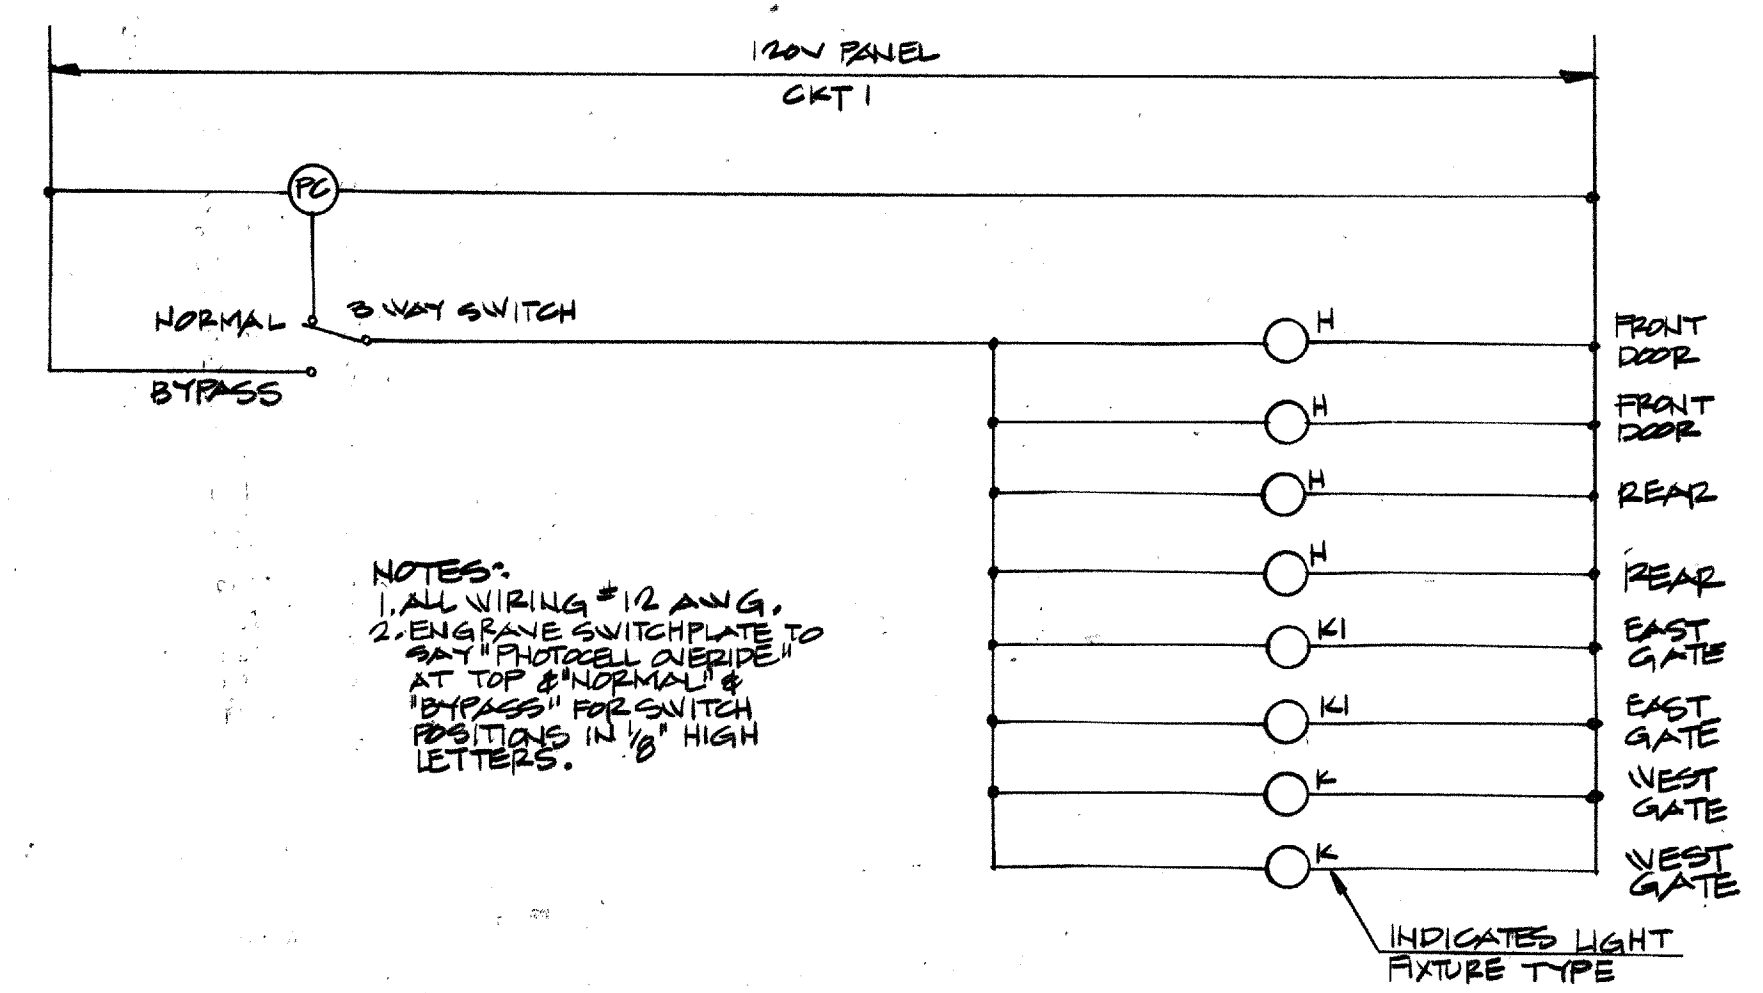

2 CONTROL SCHEMATIC-OUTDOOR LIGHTING PC CONTROLLED

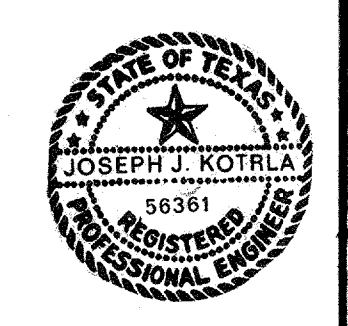

Joseph J. Kotrla
2-4-87

No.	Revision	By	Date
TOWN OF ADDISON DALLAS COUNTY, TEXAS CELESTIAL ROAD PUMP STATION			
CHARLES R. McCREARY & ASSOCIATES <small>CONSULTING ENGINEERS SUITE 217 4300 LAUREL FREEWAY DALLAS, TEXAS 75240</small>		ELECTRICAL CONTROL SCHEMATICS	
GINN, INC. Consulting Engineers Dallas, Texas			
Designed - JK	Drawn - JW	Date -	Job No. -
Approved -	Checked -	Scale -	Sheet E6 of E12