SHEET TIME
SHEET:
ASSIGN TO:
DATE | HOURS/ DOSE | CUMUL. HOURS
CHECKED
REVISIONS
KEYNOTING
PRINTS TO:

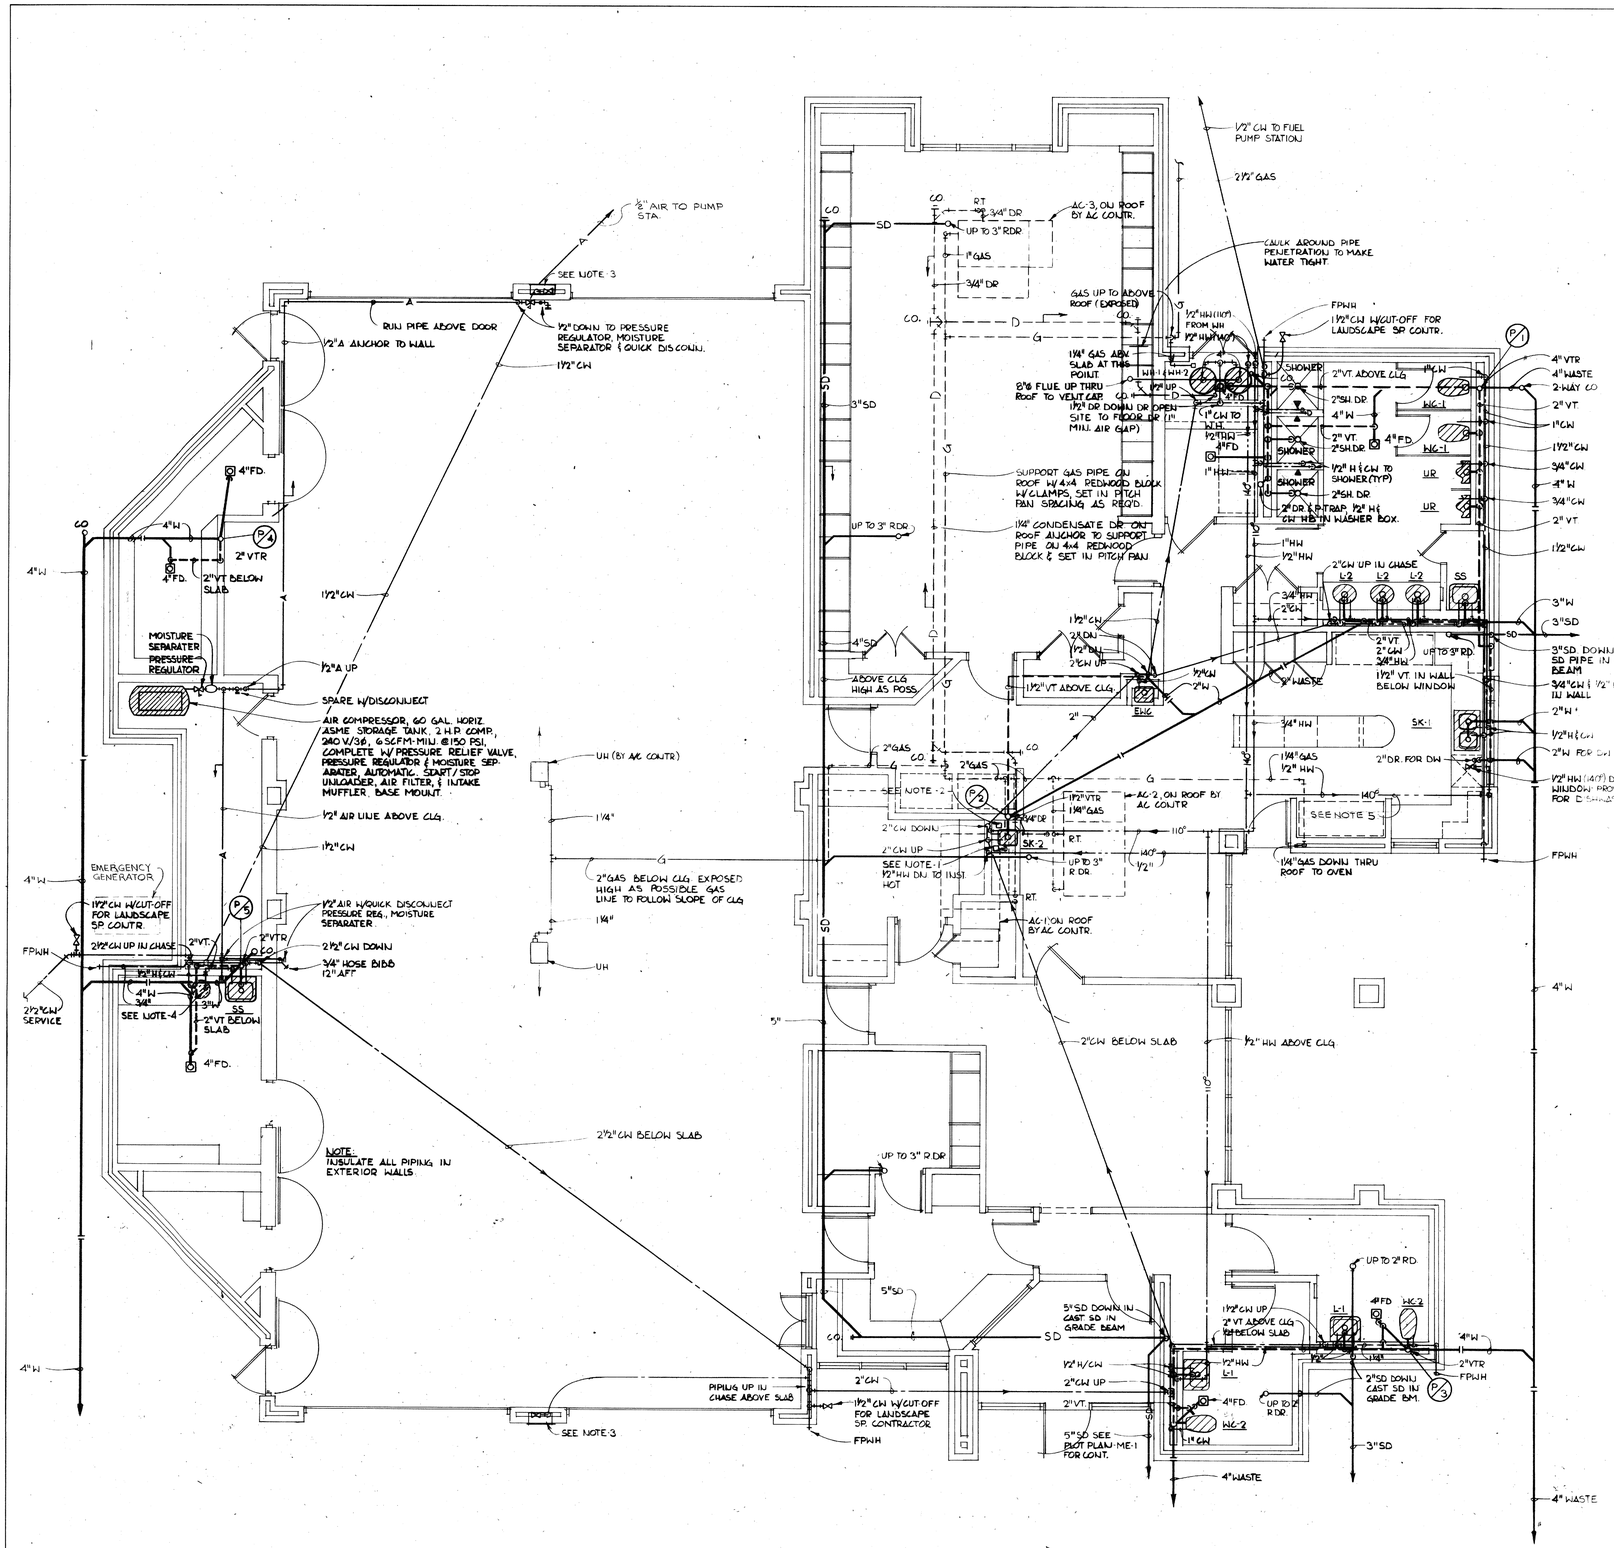

NOTES:
1 ELKAY INSTANT HOT WATER ZE-30H SINK
2 ELKAY INSTANT CHILLER BELOW SINK
3 8'x 8'x 8" HOSE CABINET W/LOCKING DOOR, HT AS DIRECTED BY ARCH. PROVIDE 1½" HOSE VALVE W/ 2 SOCKS. CABINET TO HAVE "ACCUSTICAL" USUL ATTACHED TO INSIDE OF DOOR "SEE MANUF SERIES 'S'
4 EWH-1 BELOW COUNTER RUN POP OFF OR P.V. OUTSIDE OF BUILDING TURN 90° DOWN. 6'-0" ± MIN & 7'-0" AFG MAX
5 AUTOMATIC MANUAL RESET CUTOFF VALVE BY HOOD FIRE PROTECTION CONTRACTOR. PLUMBING SUB CONTRACTOR TO INSTALL IN GAS SERVICE LINE TO RANGE

M 201 PLUMBING PLAN

SC.: 1/4" = 1'-0"

DRAWN BY _____ CHECKED BY _____

REVISIONS

NO.	DESCRIPTION	DATE

Associated Consulting Engineers, Inc.
DALLAS, TEXAS
PROJ. # 81-1970

rawls welty inc.
Architects / Planners
16475 Dallas Parkway Suite 660
Dallas, Texas 75248 (214) 931-0090

REGISTERED ARCHITECT STATE OF TEXAS

ADDISON FIRE STATION NO. 2

ADDISON, TEXAS

SHEET TITLE
PLUMBING PLAN

81080	SHEET NO. M-2
PROJECT NO.	
12-2-81	OF 23
DATE	