




TYPICAL CORNER DETAIL (A)
NTS

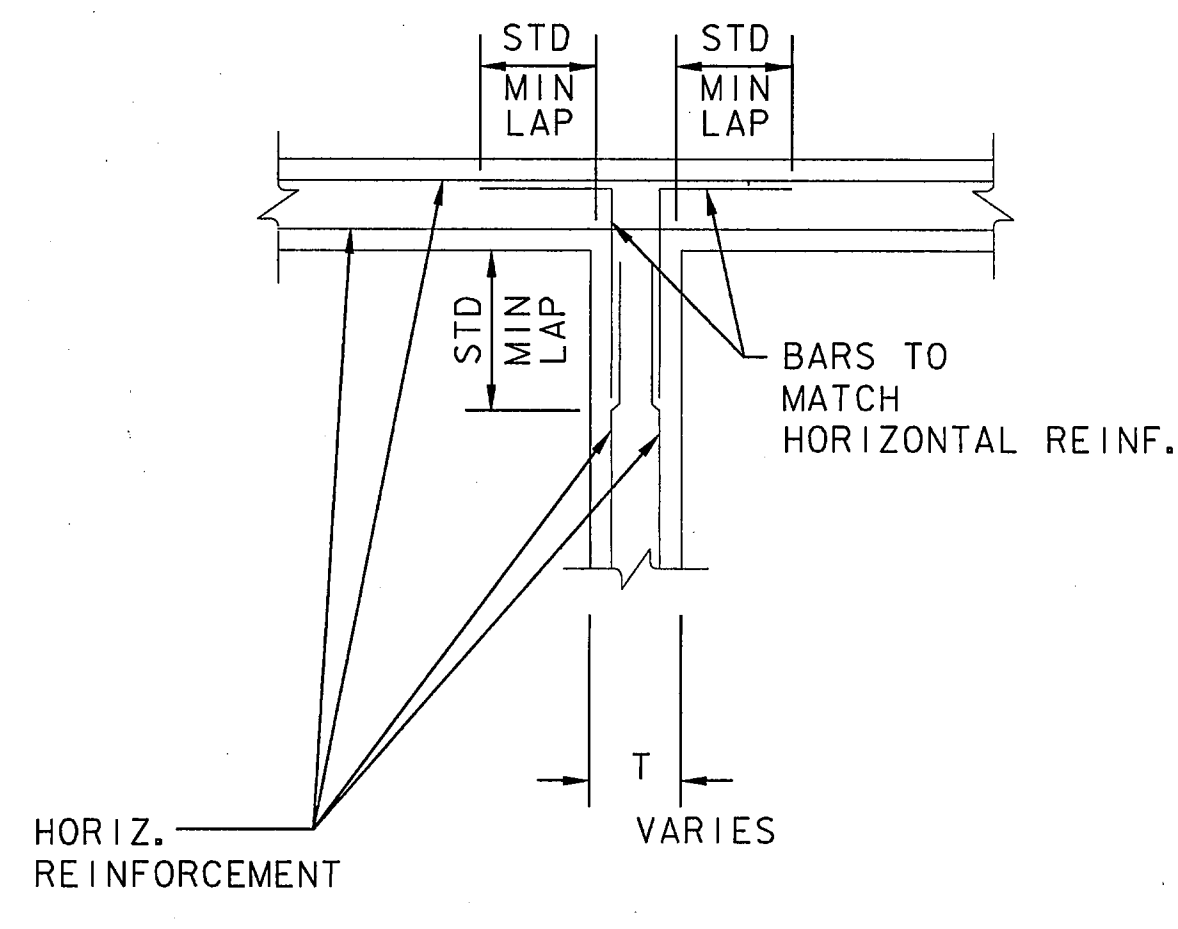


TYPICAL WALL TO WALL DETAIL (B)
NTS

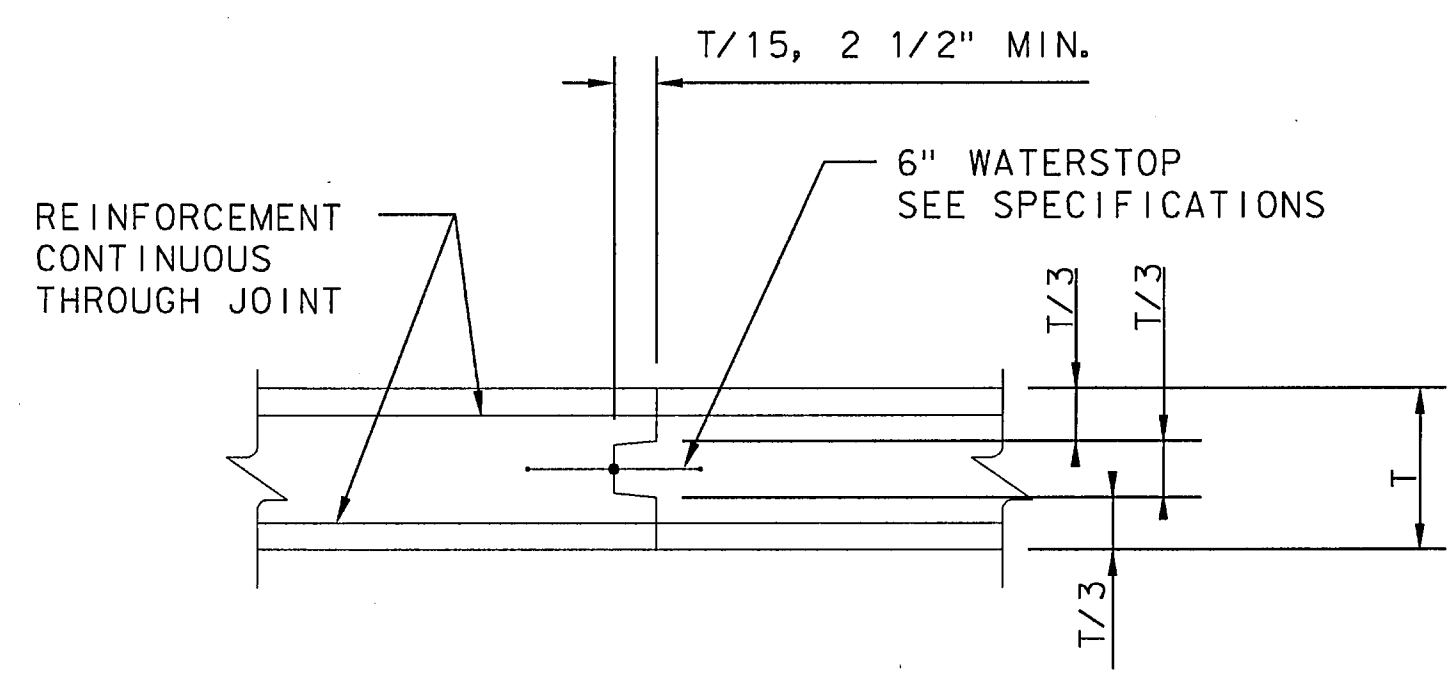


CONSTRUCTION JOINT AT SLAB (C)
NTS

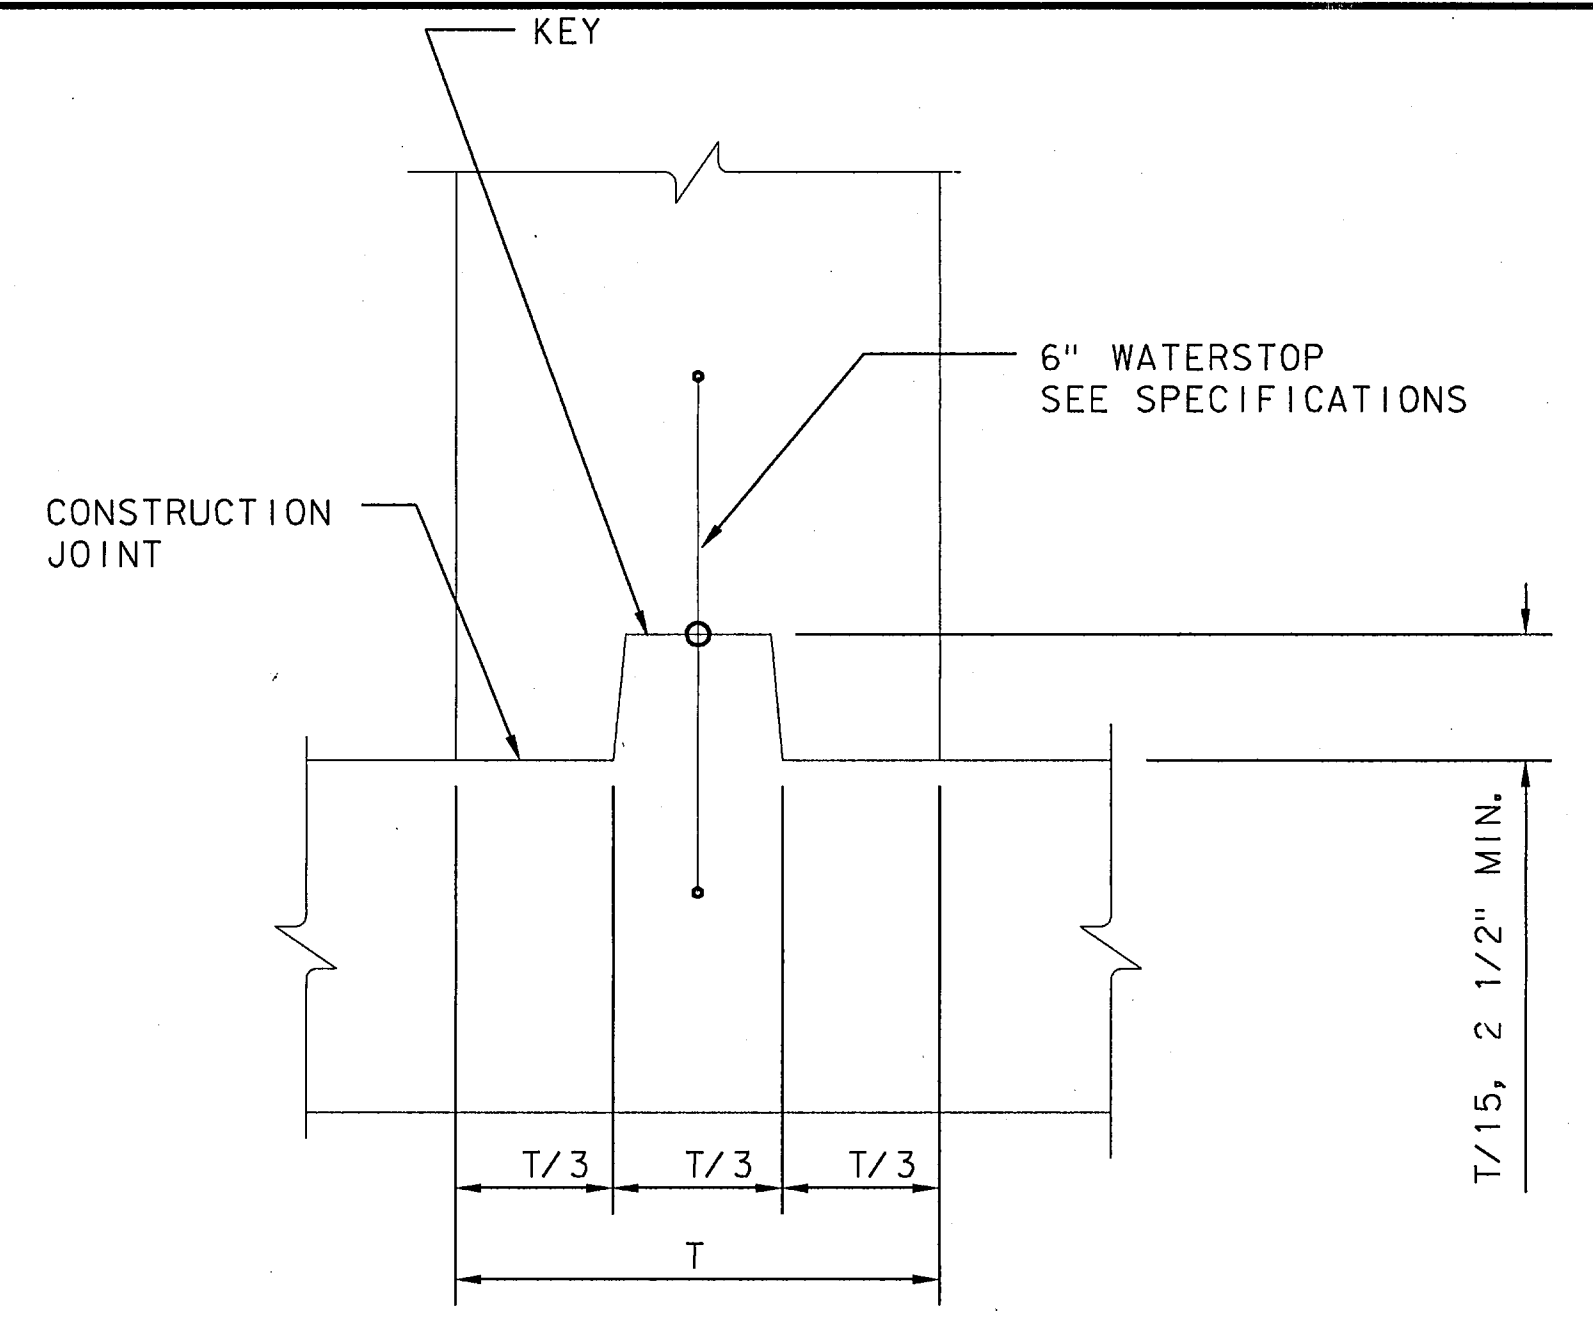


CONSTRUCTION JOINT LOWER SLAB TO WALL (D)
NTS

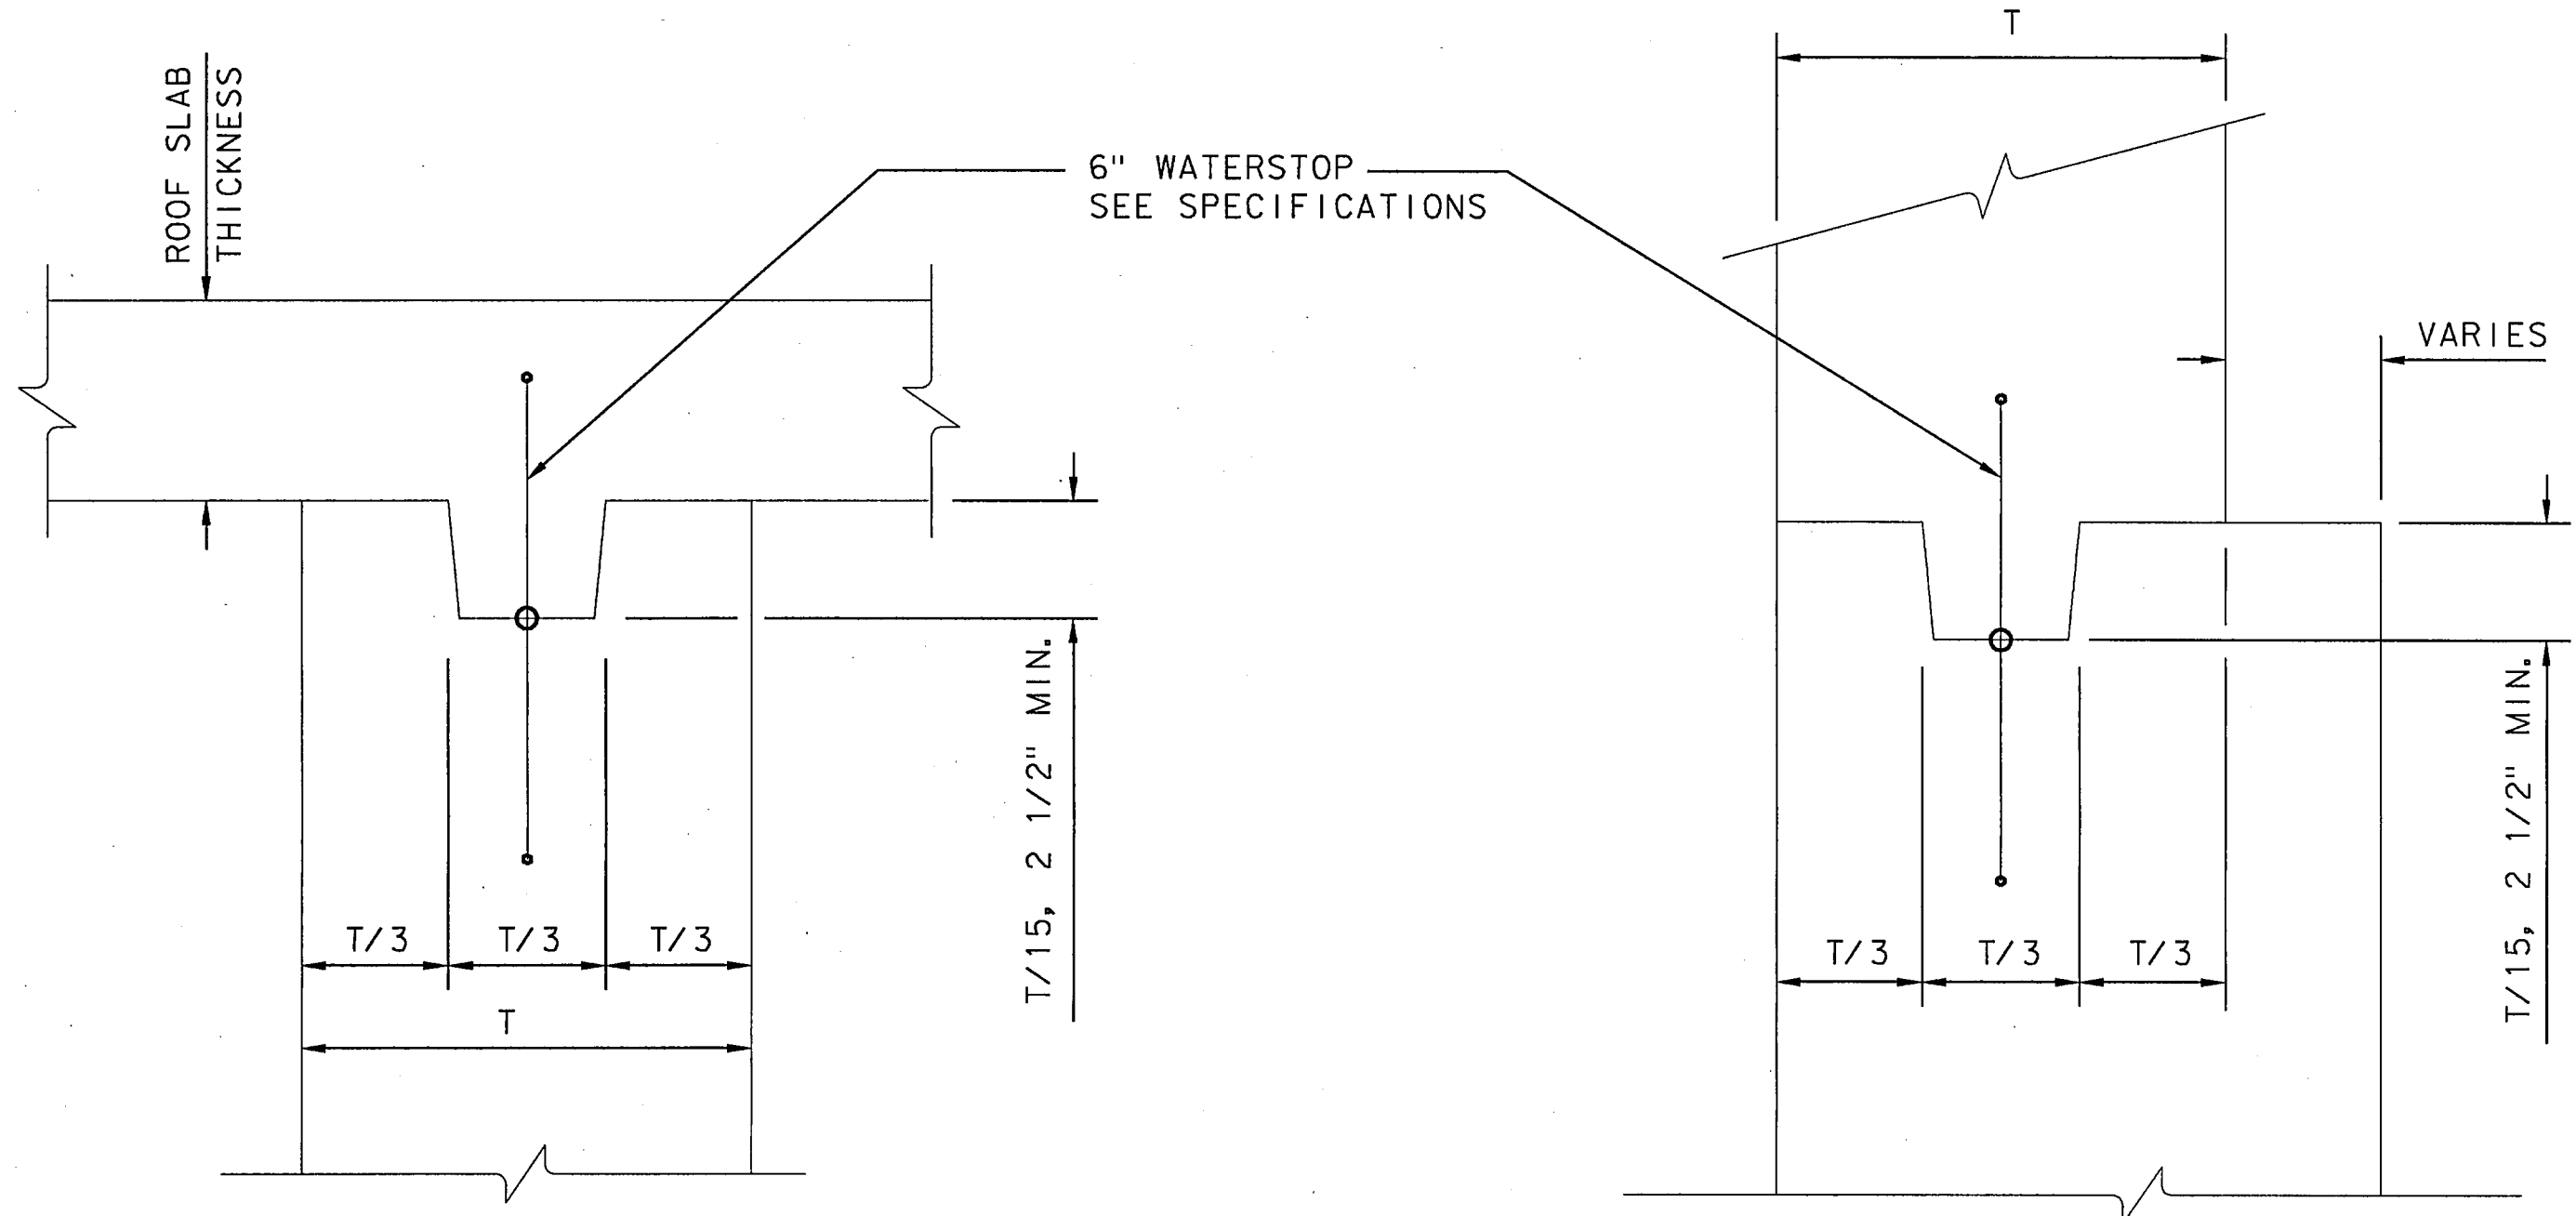


CONSTRUCTION JOINT UPPER SLAB TO WALL (E)
NTS

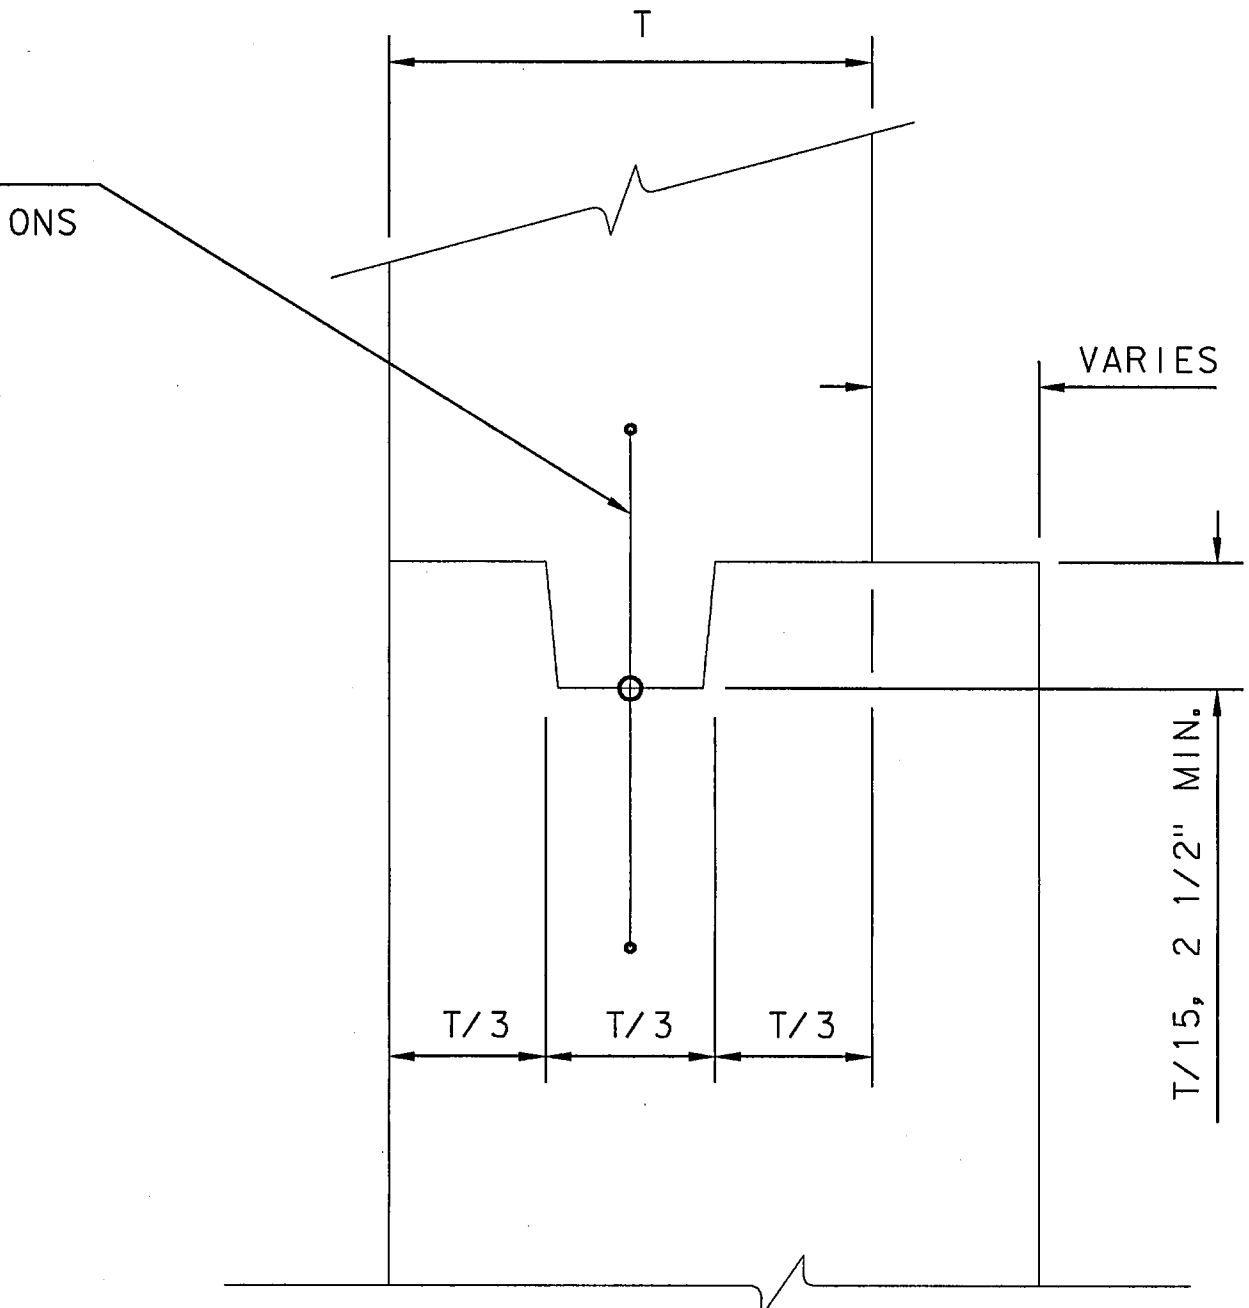


HORIZ. OR VERT. CONSTRUCTION JOINT AT WALL (F)
NTS

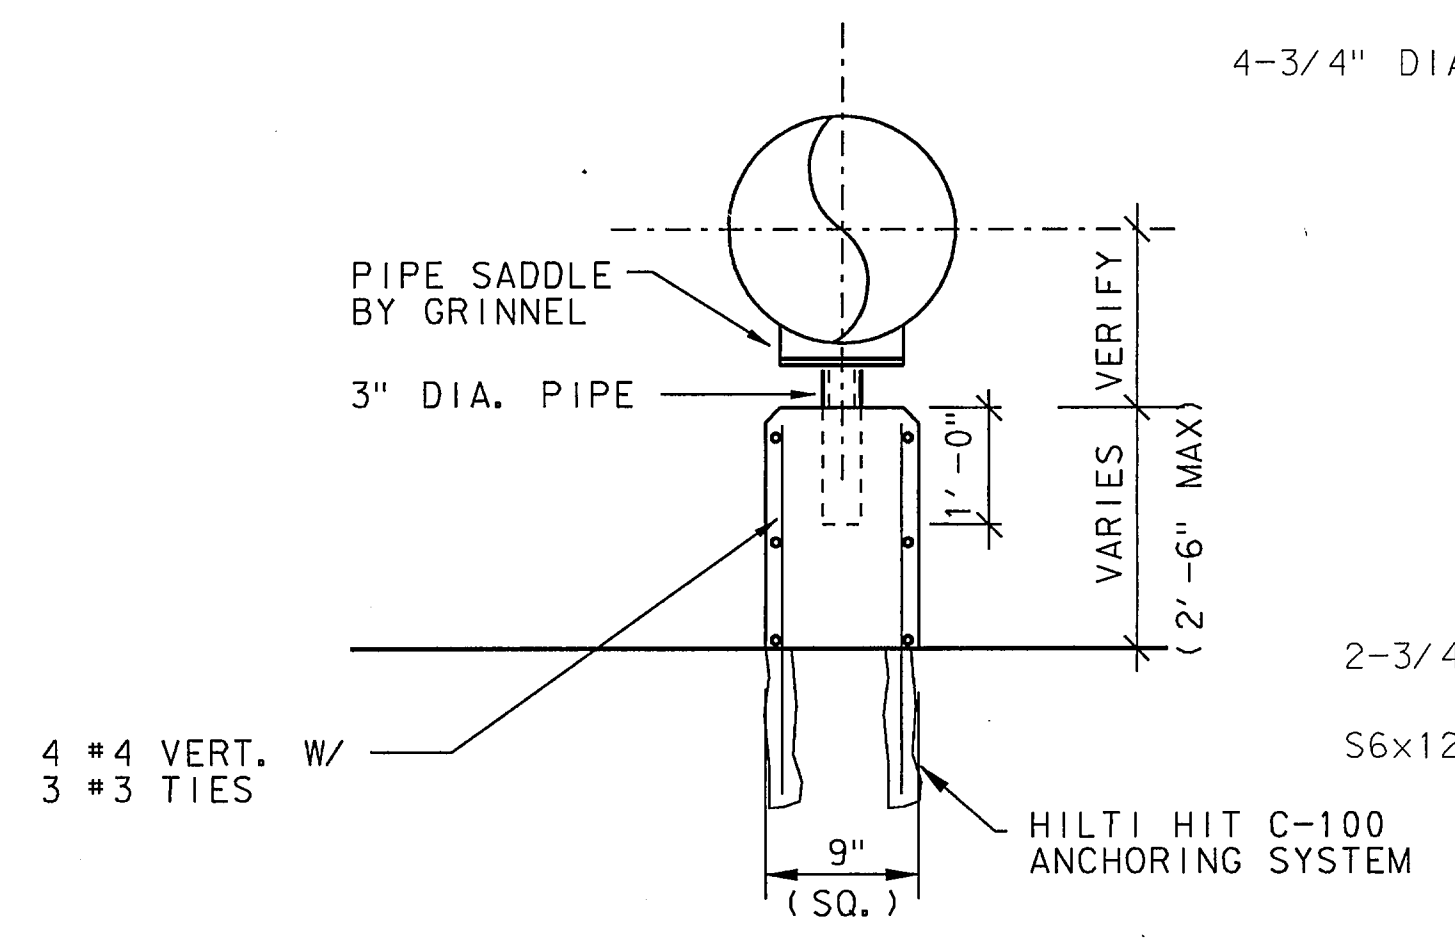

TYPICAL PUMP SUPPORT (G)
1" = 1'-0"

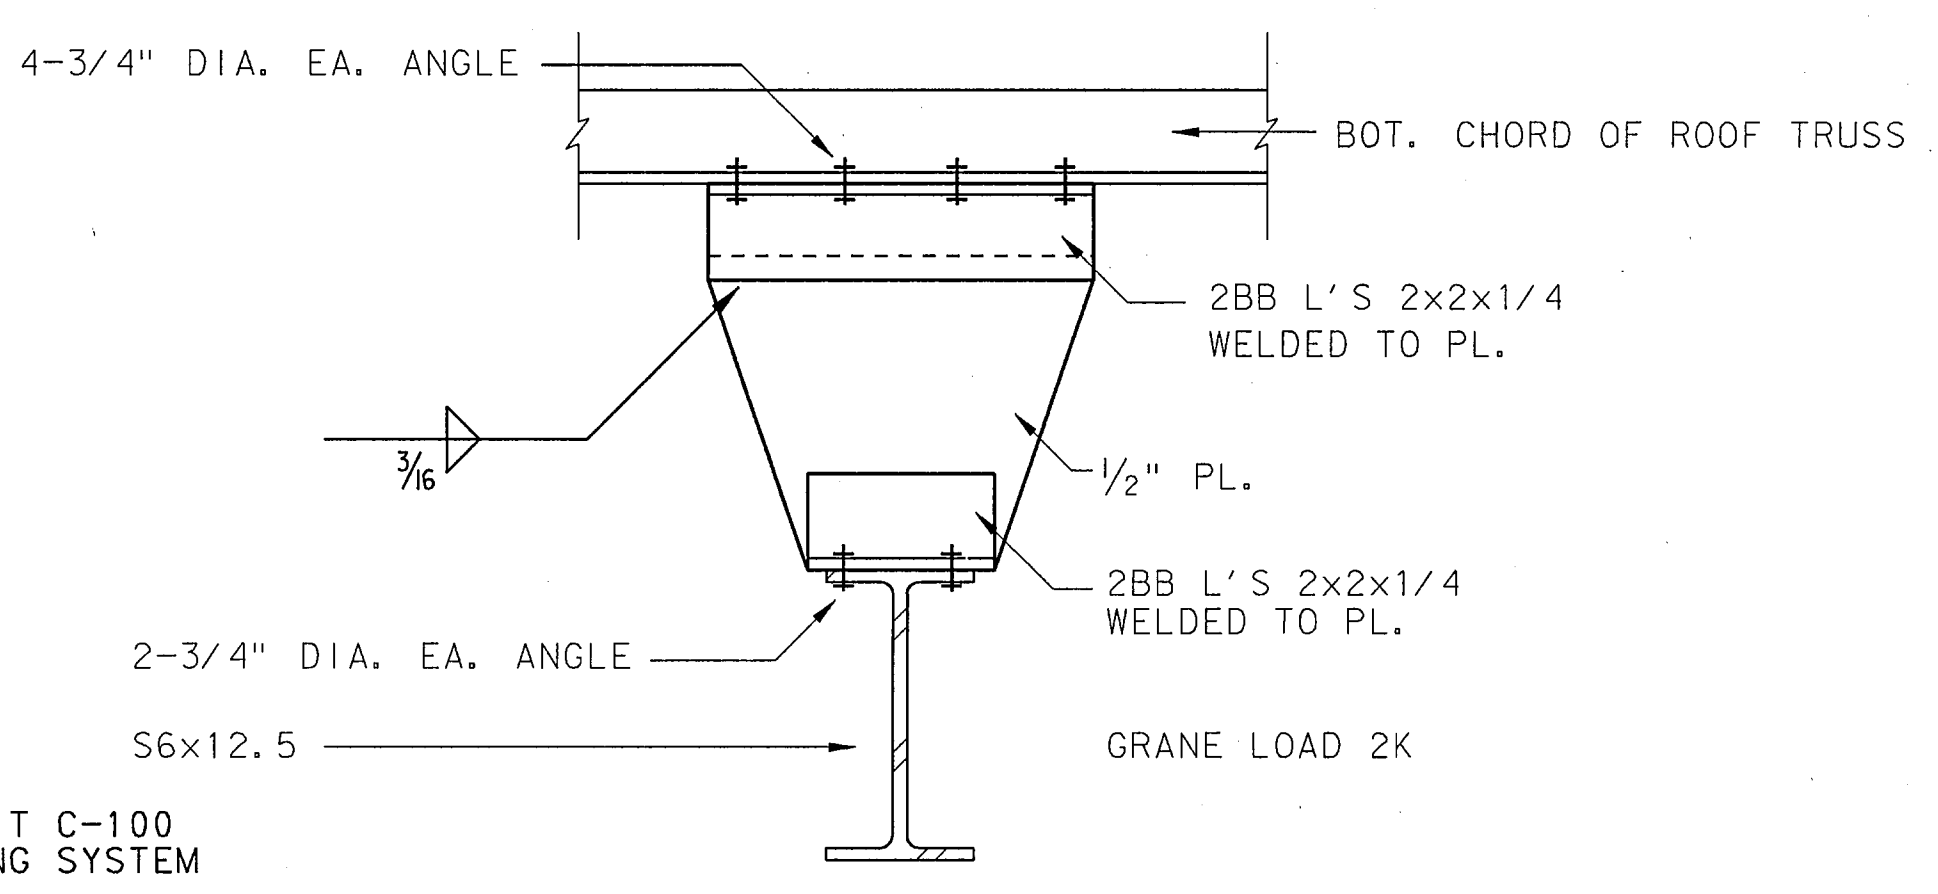


MONORAIL HOIST BEAM HANGER (H)
3" = 1'-0"

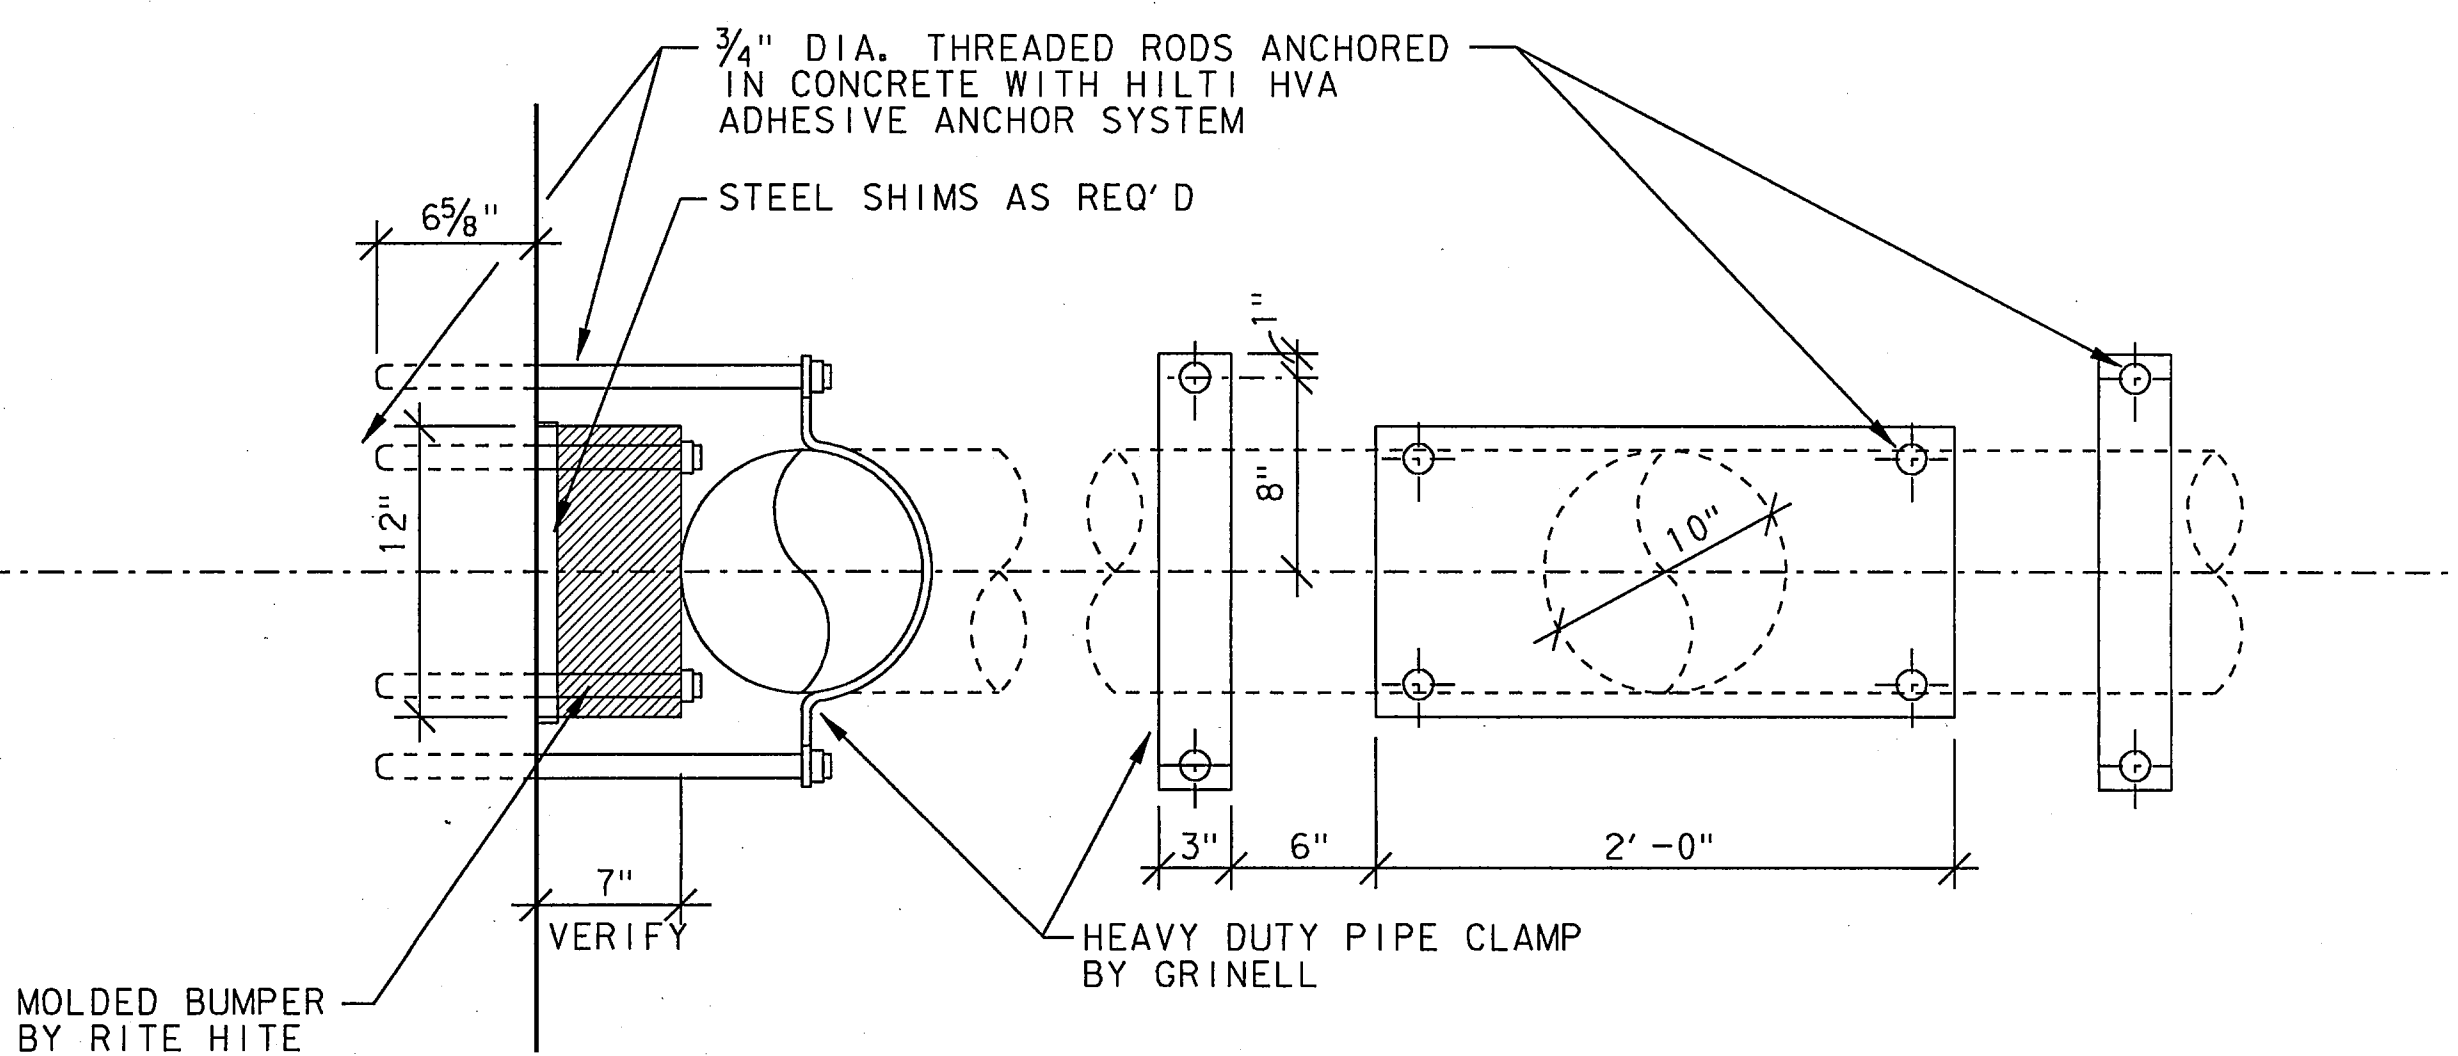

REF TO MECH DWGS FOR PIPE SIZE AND THRUST BLOCK LOCATIONS

THRUST BLOCK DETAIL (I)
1/2" = 1'-0"

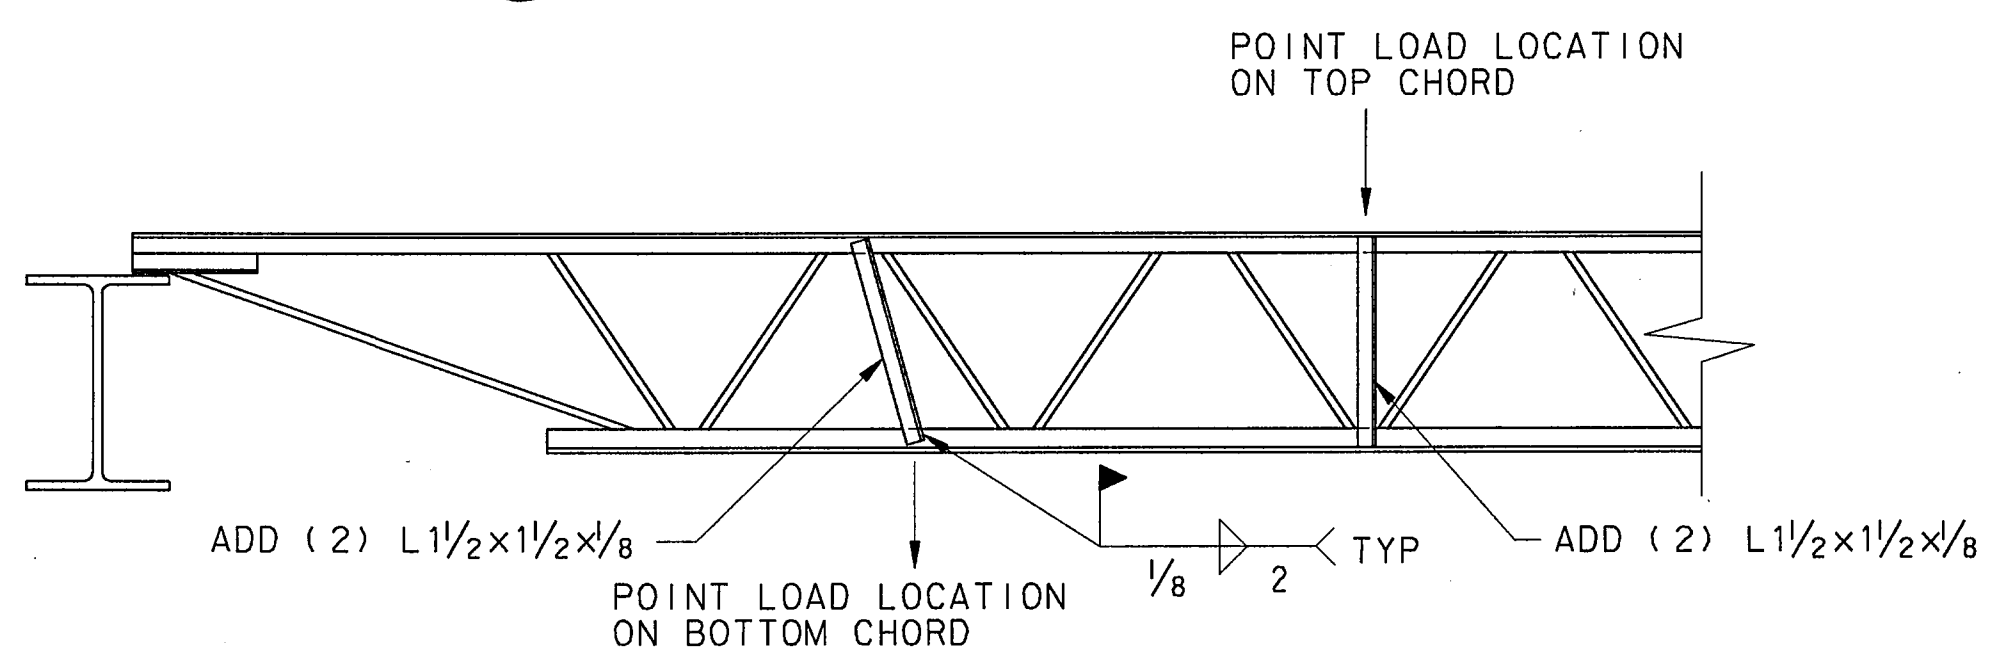

NOTE: USE THIS DETAIL WHEN POINT LOAD EXCEEDS 20 LBS. AND IS 6" OR MORE AWAY FROM PANEL POINT. ANGLES TO BE IN PLACE PRIOR TO APPLICATION OF LOAD. CONTRACTOR SHALL COORDINATE ALL SUPERIMPOSED LOADS WITH THE JOIST MANUFACTURER PRIOR TO JOIST FABRICATION. LOCATIONS OF THESE LOADS SHALL BE ON THE SUBMITTED JOIST SHOP DRAWINGS.


TYP. JOIST CHORD BRACING DETAIL (J)
1" = 1'-0"

4			
3			
2			
1			
NO.	DATE	REVISION	APPROV.

TOWN OF ADDISON, TEXAS
MIDWAY/BELTLINE SANITARY SEWER
PHASE II
LIFT STATION
STRUCTURAL DETAILS

Carter Burgess

Consultants in Engineering, Architecture,
Planning and the Environment
CARTER & BURGESS, INC.
7950 ELMBROOK DRIVE, SUITE 250
DALLAS, TX 75247-4961

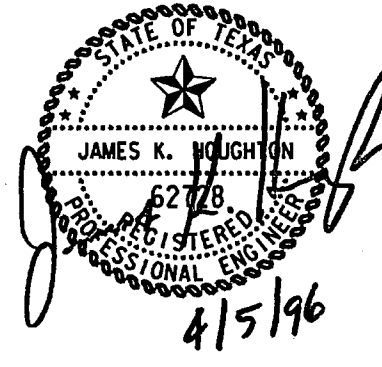

Unit	Scale	Date	04-05-96
Designed	K. Houghton	Checked	K. Houghton
Drawn	C. Semmons	Approved	J. Lindner
Job No.	93327601D	Sheet	49 of 63