


**02 SECTION**  
 SCALE: 3/4"=1'-0"

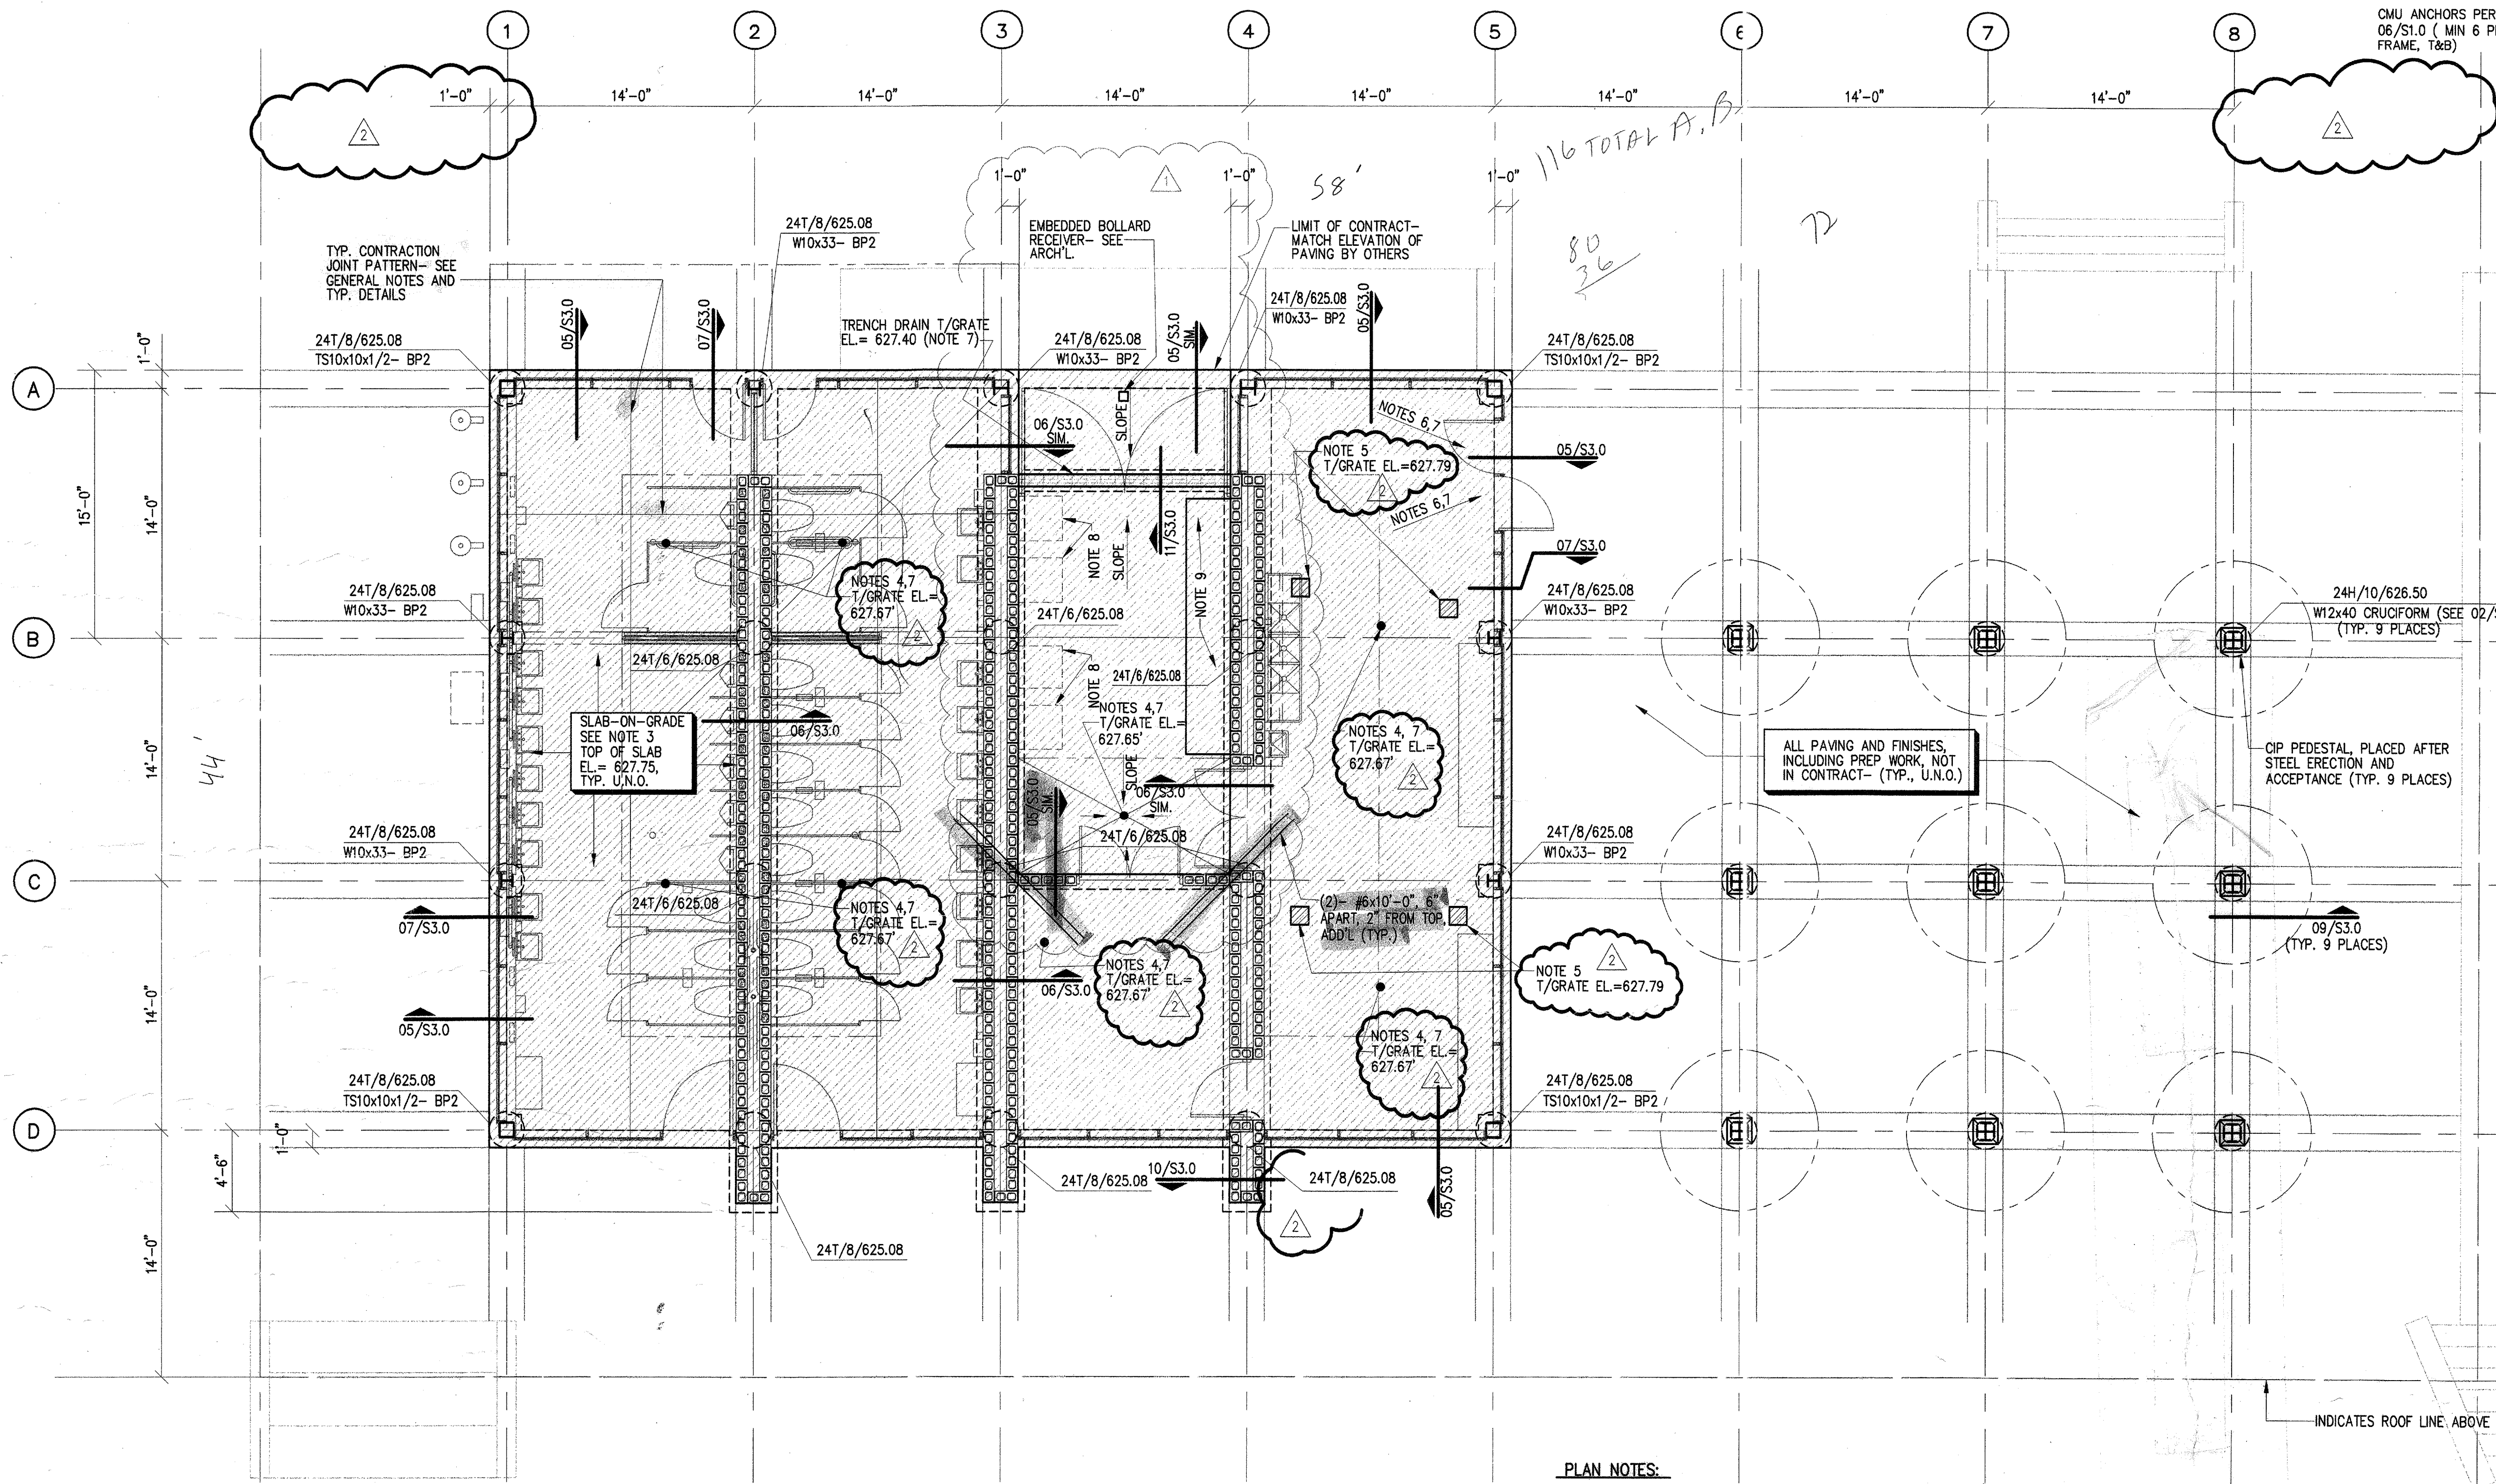


**LEGEND**



SHADED AREA INDICATES EXTENT OF WORK IN THIS CONTRACT

INDICATES CMU WALL - SEE DETAILS FOR DOWELS TO FOUNDATION

**01 FOUNDATION PLAN**  
 SCALE: 3/16" = 1'-0"



- PLAN NOTES:**
- SEE S1.0 FOR GENERAL NOTES.
  - SEE S3.0 FOR TYPICAL DETAILS.
  - SLAB-ON-GRADE TO BE 5" THICK CONCRETE REINF. W/ #3 @ 14" o.c. I.A. WAY, 2" FROM TOP. SEE ALSO GENERAL NOTES FOR MIX RESTRICTIONS. PROVIDE SUBGRADE PREPARATION AS SPECIFIED BY GEOTECHNICAL CONSULTANT TO REDUCE PVR TO ONE INCH OR LESS.
  - FLOOR DRAIN - SEE MEP DOCUMENTS FOR DETAILS, AND 05/AB.2 FOR LOCATIONS.
  - FLOOR SINK - SEE MEP DOCUMENTS FOR DETAILS AND 05/AB.2 FOR LOCATIONS. TOP OF SLAB EL. ADJACENT TO HOUSING 1/2" LOWER PER CITY OF ADDISON STANDARDS.
  - SLOPE SLAB TO MATCH ELEVATION OF PATIO THRESHOLD (SEE ARCH'L).
  - SLOPE SUBGRADE TO MAINTAIN 5" SLAB THICKNESS - DO NOT REDUCE THICKNESS TO CREATE SLOPE.
  - CONDENSOR UNIT MOUNTING RACKS ABOVE. SEE DETAIL 02/THIS DWG.
  - 6" CIP PAD FOR SWITCH CABINETS - SEE MEP DOCUMENTS. REINF. SAME AS SLAB-ON-GRADE (ADD'L).

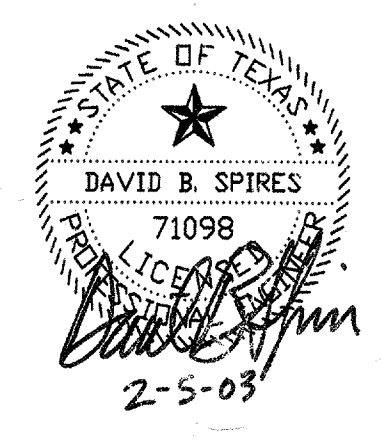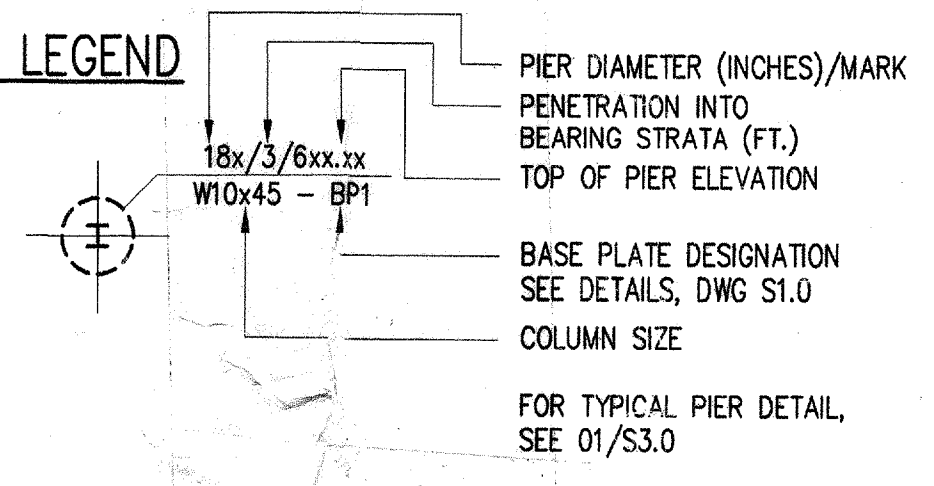

date	issue	description
12/24/02	95% CD	1/23/03
1/23/03	100% CD	1/31/03
1/31/03	ADDM 1	2/06/03
2/06/03	ADDM 2	

**S2.0 FOUNDATION PLAN**