

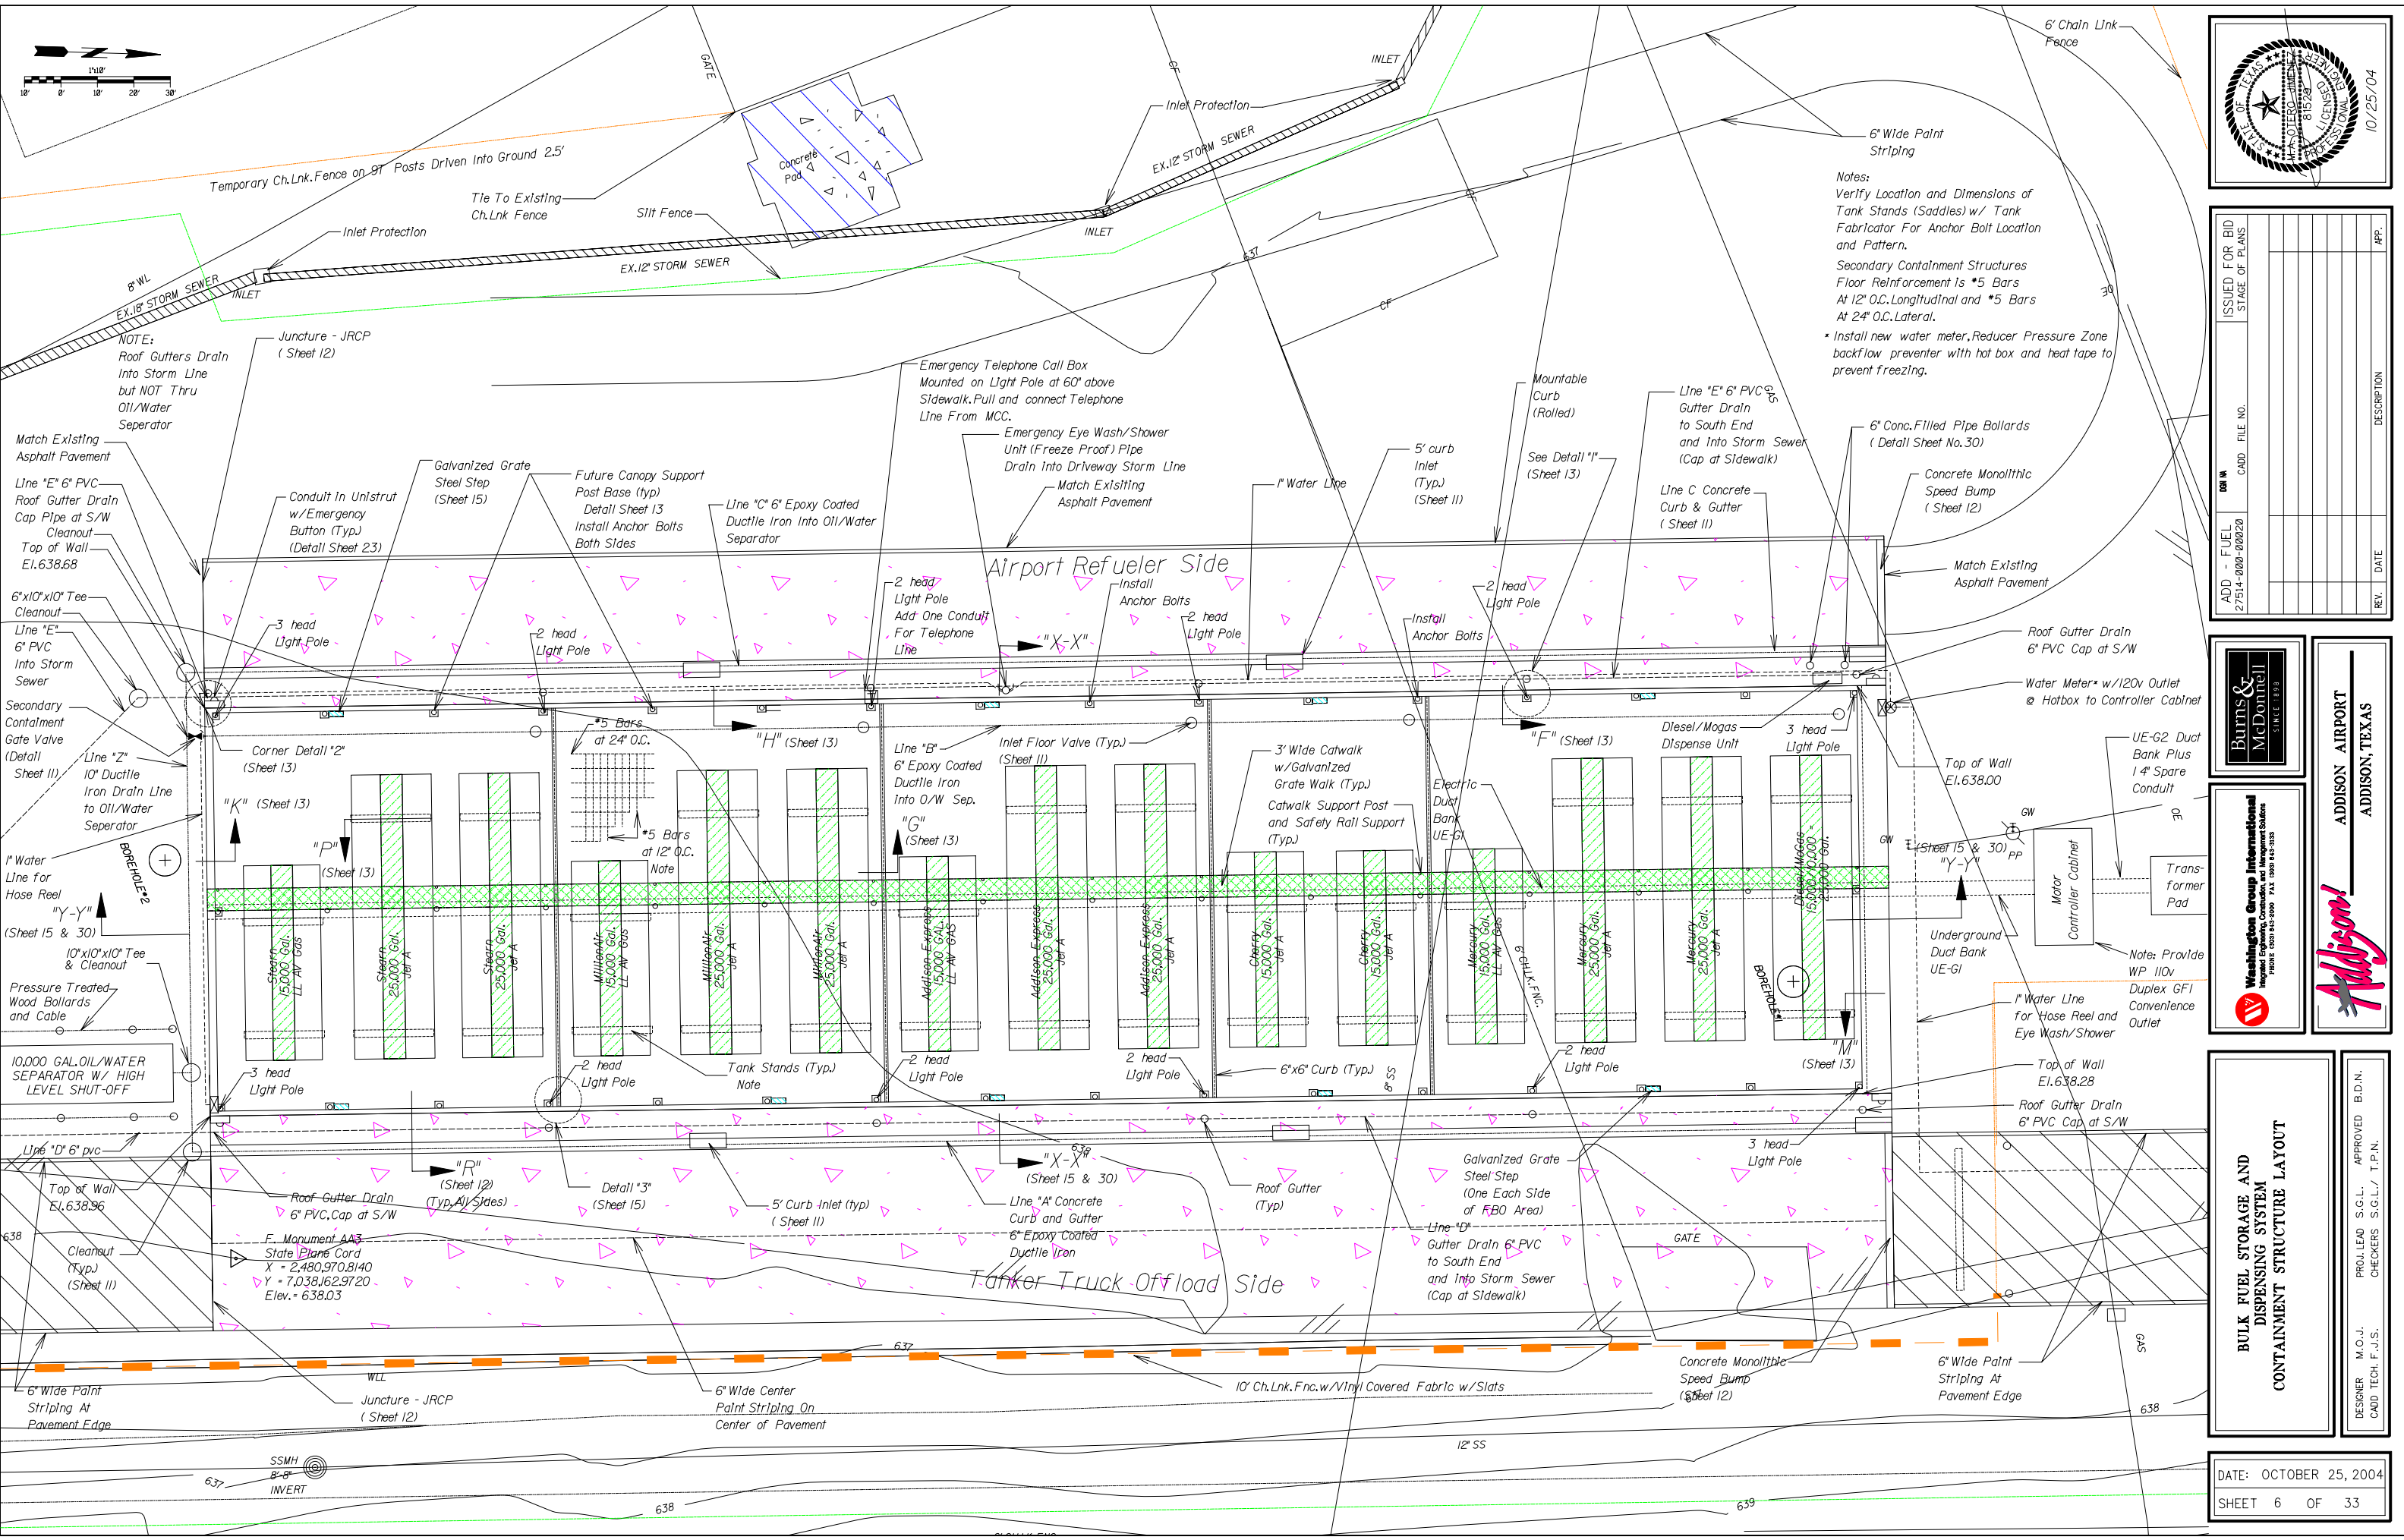


ISSUED FOR BID	STAGE OF PLANS	APP.
ADD - FUEL	CADD FILE NO.	DESCRIPTION
2/5/14-000-000220		
REV.	DATE	

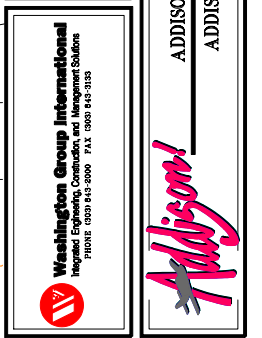

Notes:
 Verify Location and Dimensions of Tank Stands (Saddles) w/ Tank Fabricator For Anchor Bolt Location and Pattern.
 Secondary Containment Structures Floor Reinforcement is #5 Bars At 12" O.C. Longitudinal and #5 Bars At 24" O.C. Lateral.
 • Install new water meter, Reducer Pressure Zone backflow preventer with hot box and heat tape to prevent freezing.



BULK FUEL STORAGE AND DISPENSING SYSTEM CONTAINMENT STRUCTURE LAYOUT

ADDISON AIRPORT
 ADDISON, TEXAS

DESIGNER: M.O.J.
 CADD TECH: F.J.S.

PROJ. LEAD: S.G.L.
 CHECKERS: S.G.L., T.P.N.

APPROVED: B.D.N.