

MORRIS AVE.



5025

ADDISON CIRCLE DR.

LEVEL 3

ADDISON CIRCLE
M - BLOCK

SPECTRUM DRIVE

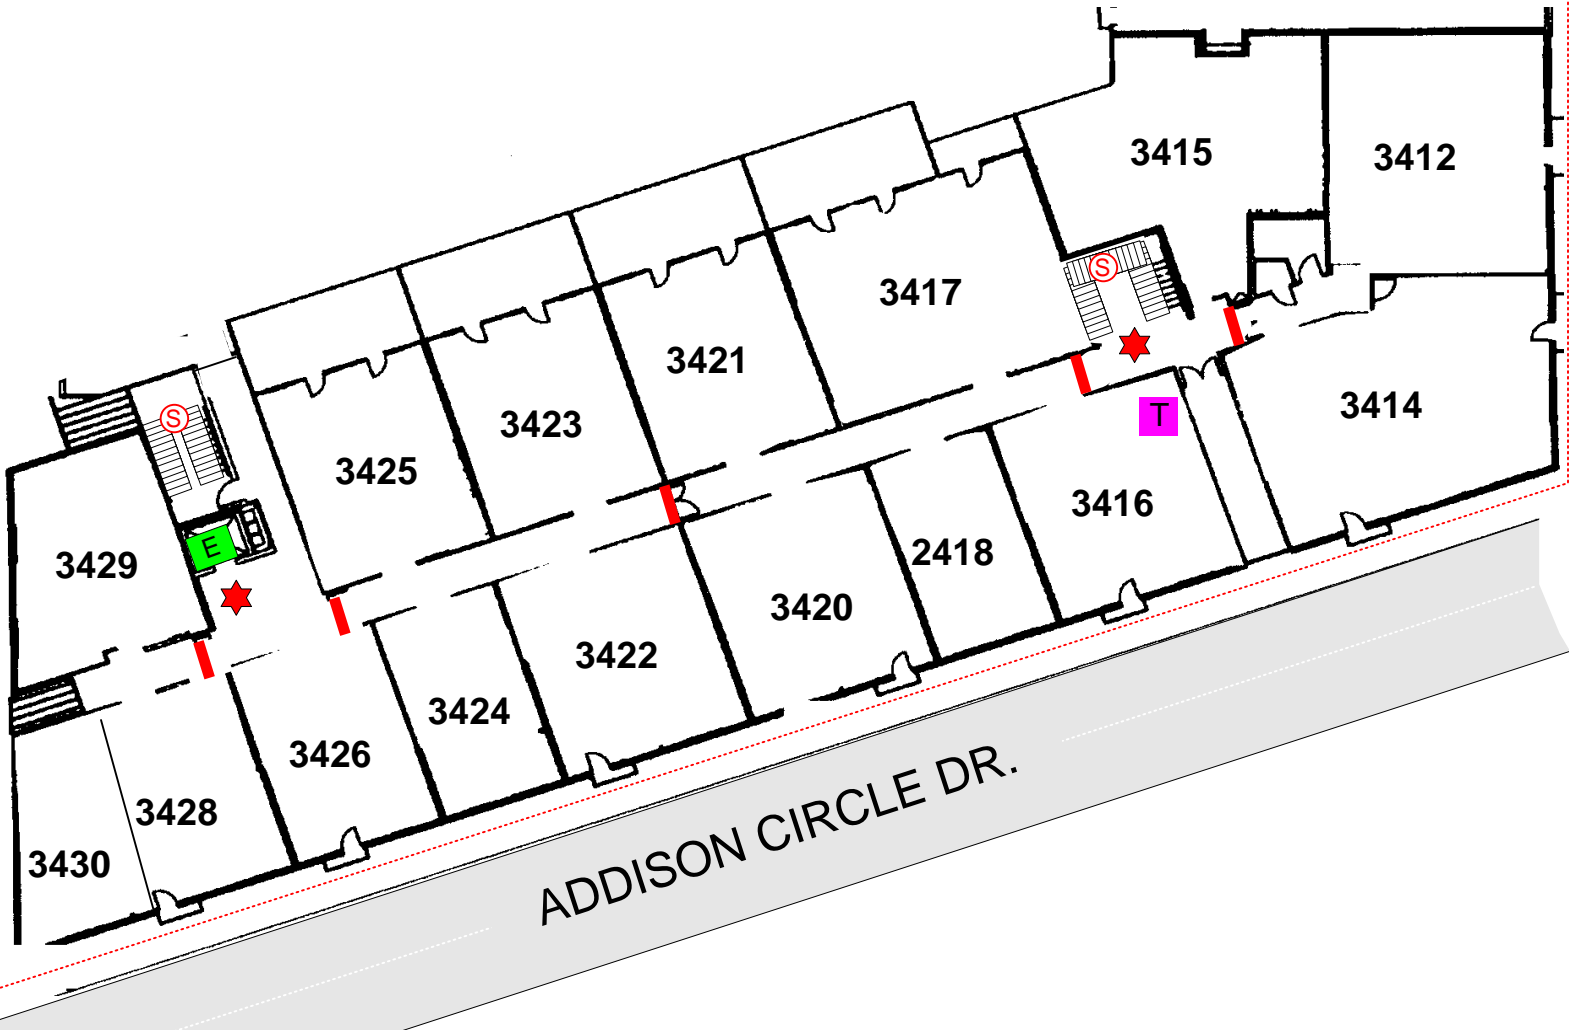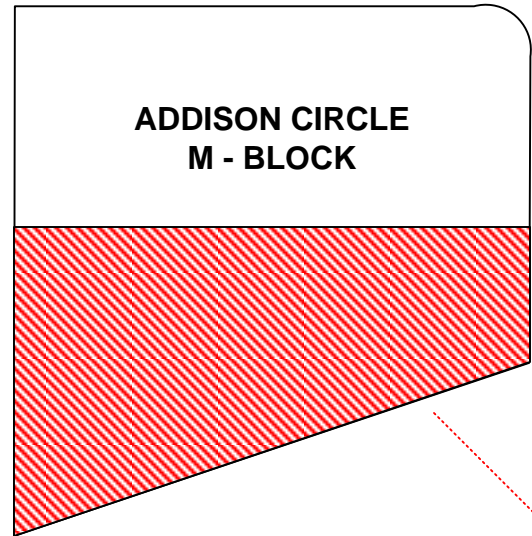

FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	T	TRASH CHUTE	ELECTRONIC GATE	HEAT ACTIVATED FIRE DOOR
FIRE DEPT. CONNECTION	W MAIN WATER SHUTOFF	S STANDPIPE CONNECTION	SPRINKLER ISOLATION VALVE	FIRE DOOR	MAIN SPRINKLER SHUTOFF		
KNOX SWITCH	E ELECTRICAL MAIN	ELEVATOR	HEAT DETECTOR	ENTRANCE / EXIT			
KNOX BOX	G GAS SHUTOFF VALVE	STAIRS	SMOKE DETECTOR	PARKING ENTRANCE /EXIT			

Addison!
FIRE DEPARTMENT
OPERATIONS DIVISION
DRAWING BY:
RAY YAGER

