
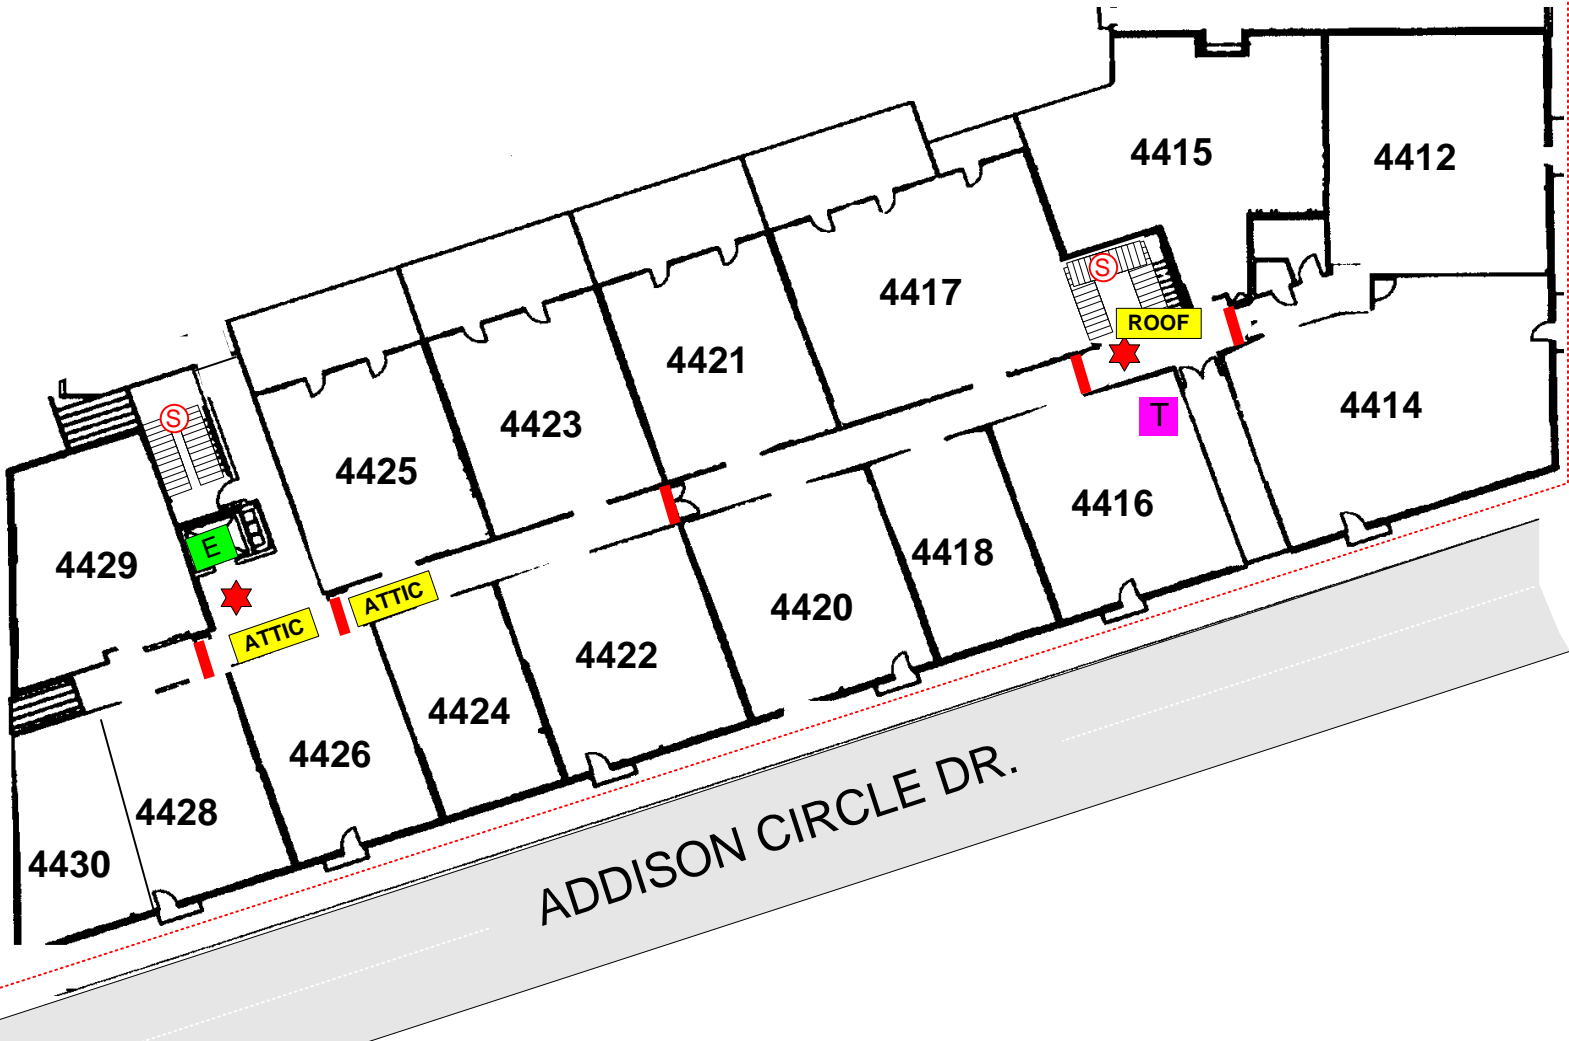


MORRIS AVE.

SPECTRUM DRIVE

ADDISON CIRCLE
M - BLOCK

5025 ADDISON CIRCLE DR. LEVEL 4

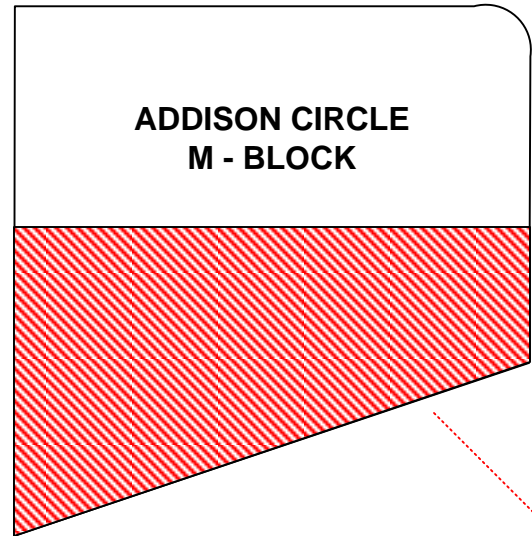

FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	T	TRASH CHUTE	ELECTRONIC GATE	HEAT ACTIVATED FIRE DOOR
FIRE DEPT. CONNECTION	W MAIN WATER SHUTOFF	S STANDPIPE CONNECTION	SPRINKLER ISOLATION VALVE	FIRE DOOR	MAIN SPRINKLER SHUTOFF	ATTIC	ATTIC ACCESS
KNOX SWITCH	E ELECTRICAL MAIN	ELEVATOR	HEAT DETECTOR	ENTRANCE / EXIT	ROOF	ROOF ACCESS	
KNOX BOX	G GAS SHUTOFF VALVE	STAIRS	SMOKE DETECTOR	PARKING ENTRANCE /EXIT			

Addison!
FIRE DEPARTMENT
OPERATIONS DIVISION
DRAWING BY:
RAY YAGER

