


5060 Addison Circle Dr. Level 1

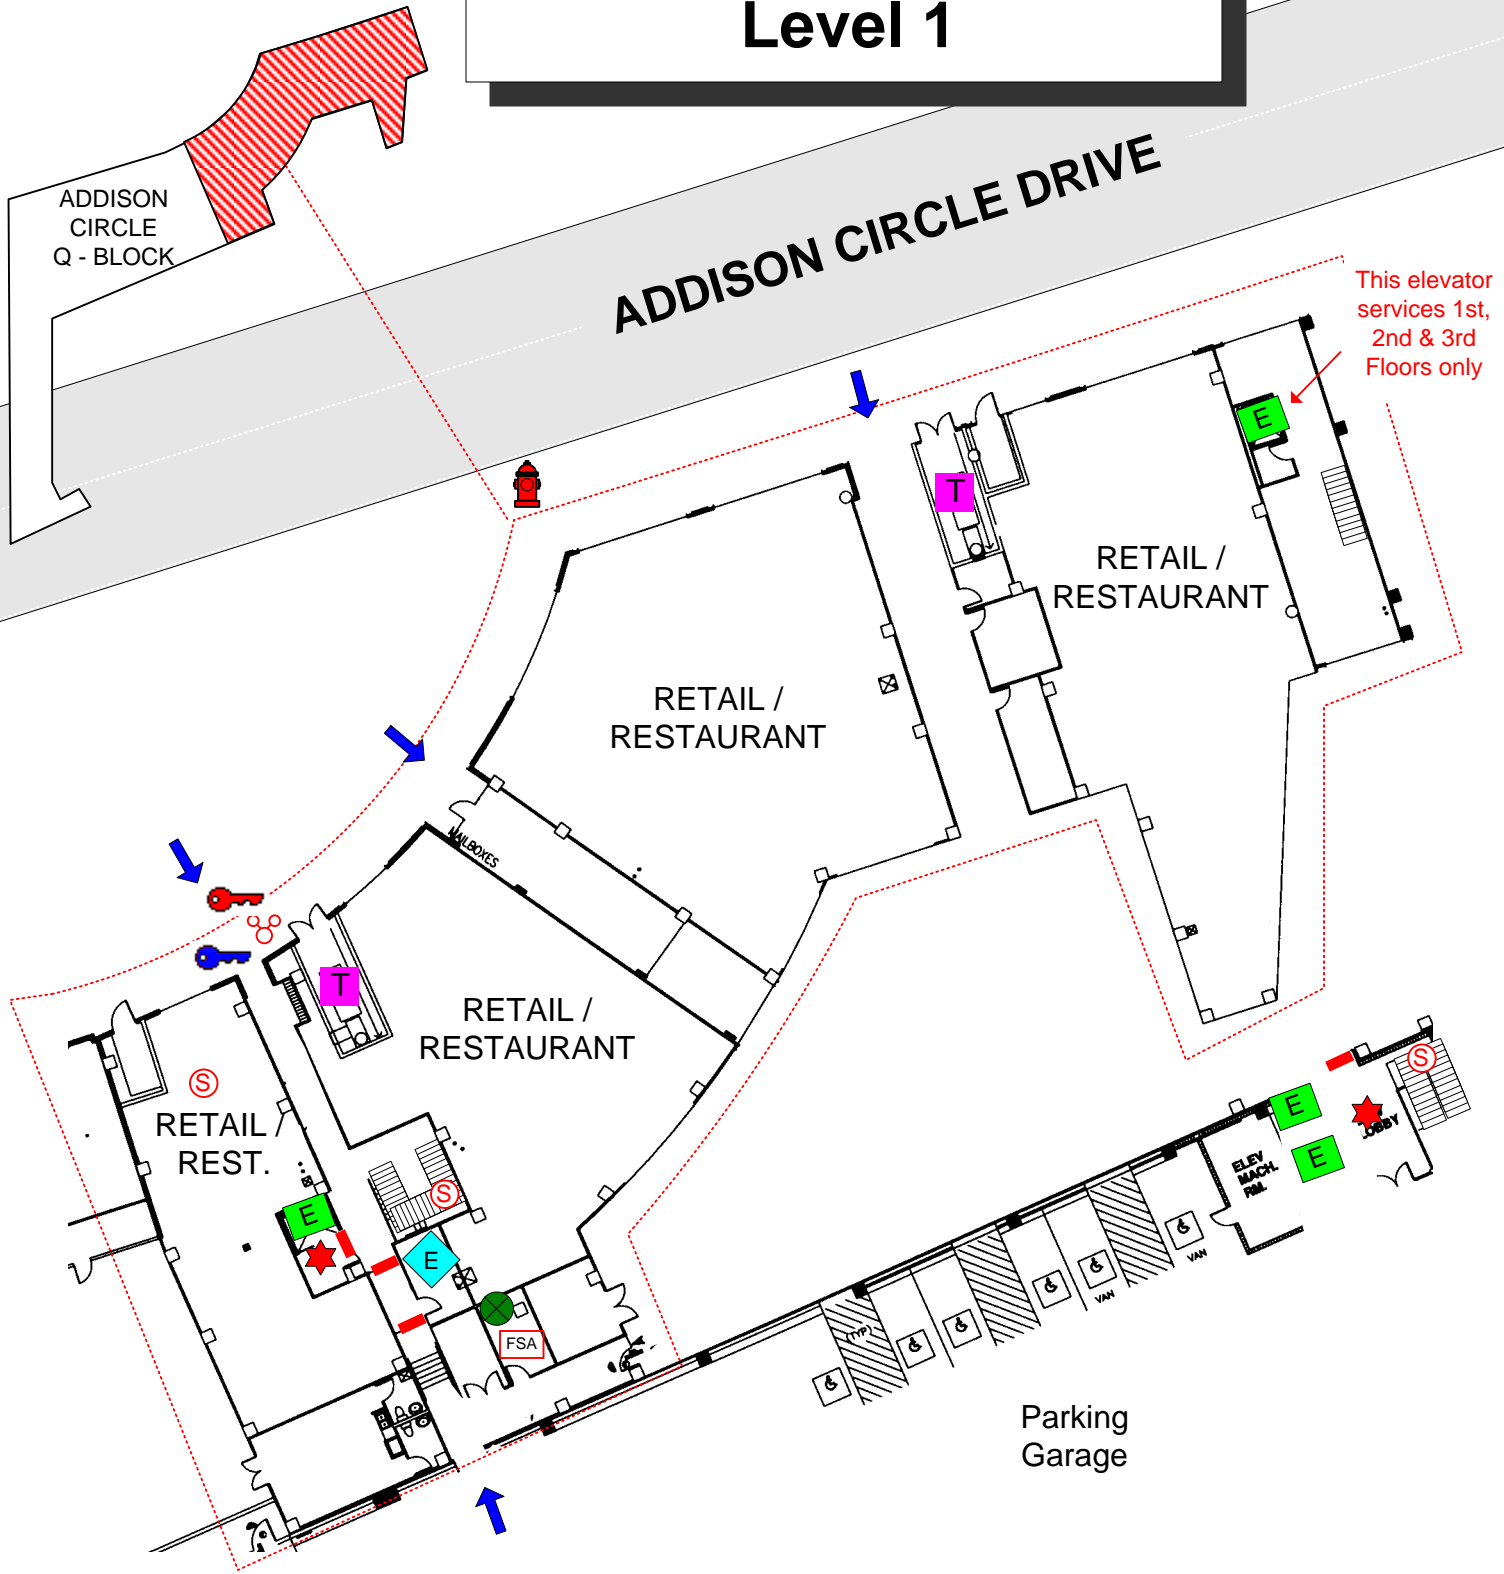

FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	TRASH CHUTE	ELECTRONIC GATE	HEAT ACTIVATED FIRE DOOR
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	STANDPIPE CONNECTION	SPRINKLER ISOLATION VALVE	FIRE DOOR	ENTRANCE / EXIT	MAIN SPRINKLER SHUTOFF
KNOX SWITCH	ELECTRICAL MAIN	ELEVATOR	HEAT DETECTOR	ENTRANCE / EXIT		
KNOX BOX	GAS SHUTOFF VALVE	STAIRS	SMOKE DETECTOR	PARKING ENTRANCE / EXIT		

Addison!
FIRE DEPARTMENT
OPERATIONS DIVISION
DRAWING BY:
RAY YAGER

11-1-99

