


16200 ADDISON RD

ADDISON PLAZA 2ND FLOOR

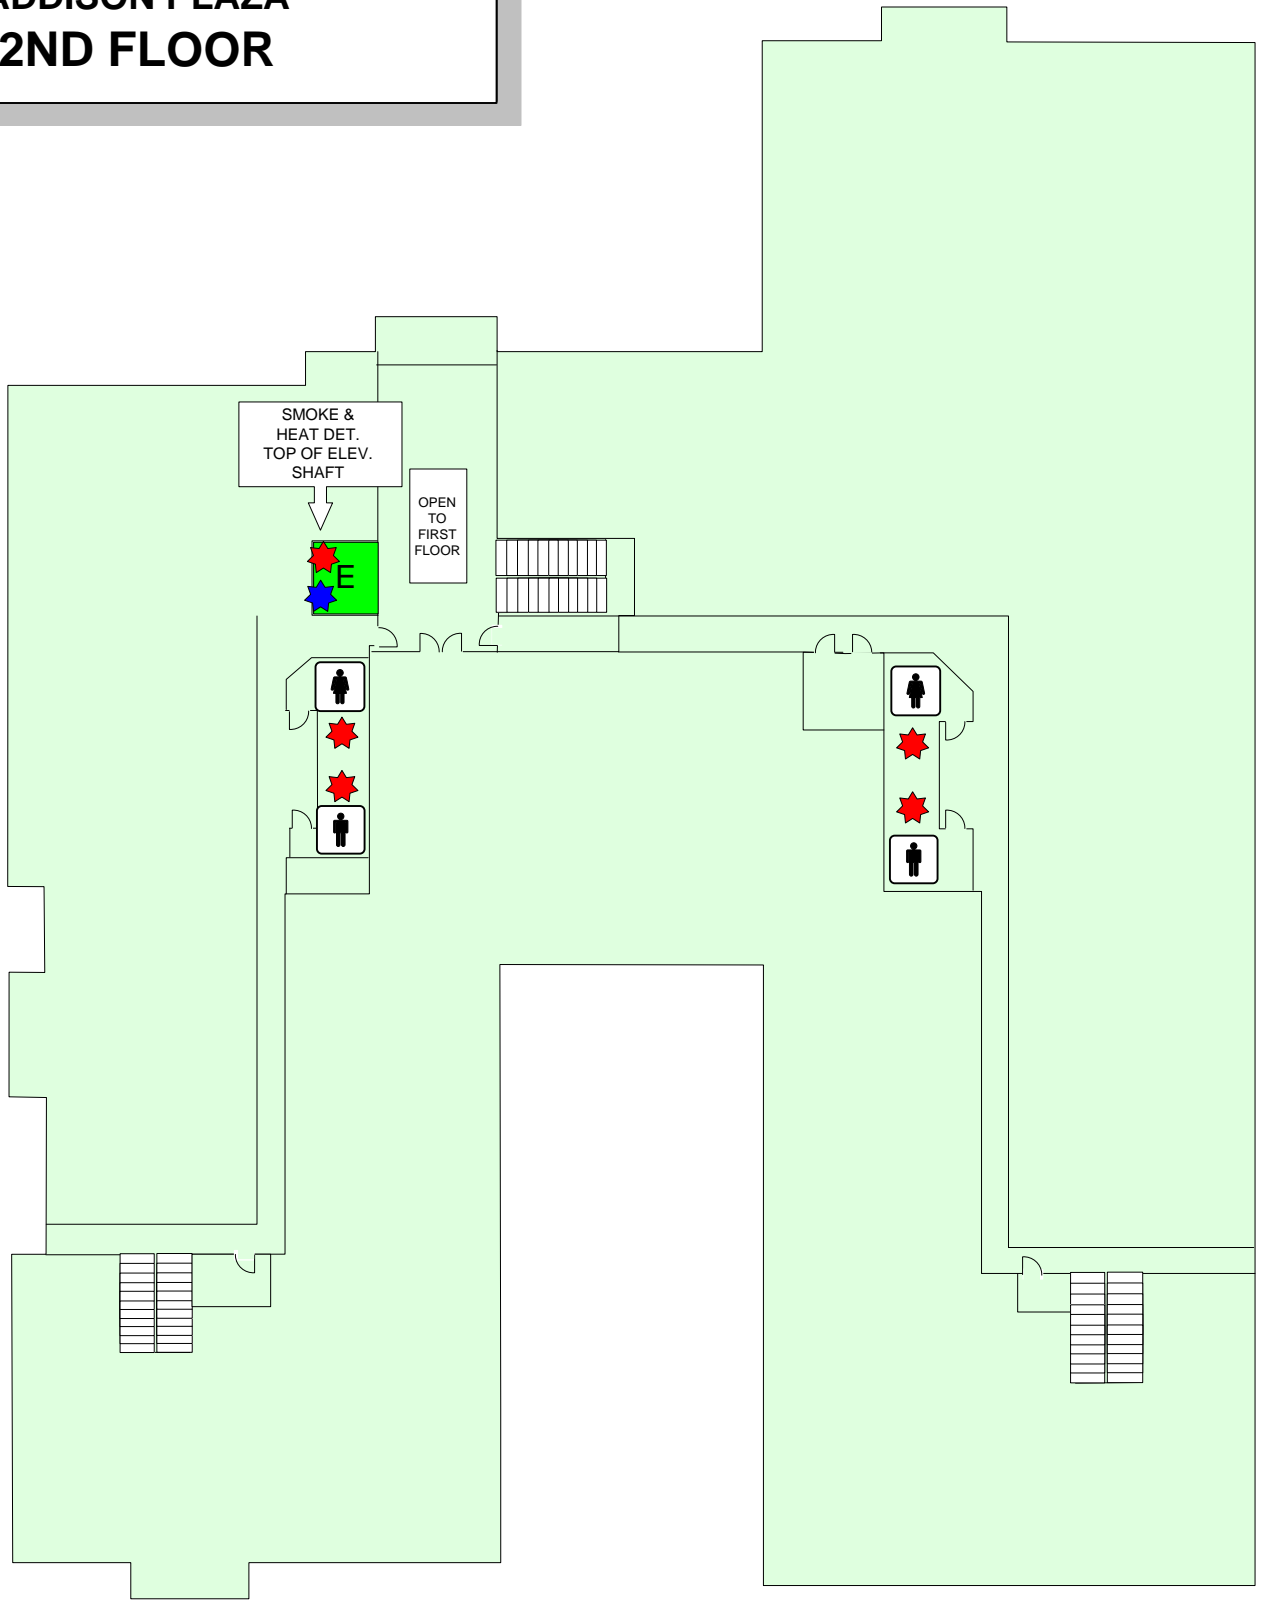

FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	ENTRANCE / EXIT	
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	STANDPIPE CONNECTION	SPRINKLER ISOLATION VALVE	HEAT DETECTOR	
KNOX SWITCH	ELECTRICAL MAIN	ELEVATOR	SMOKE DETECTOR		
KNOX BOX	GAS SHUTOFF VALVE	STAIRS			

Addison!

FIRE DEPARTMENT
OPERATIONS DIVISION

DRAWING BY: RAY YAGER

04/24/00

