
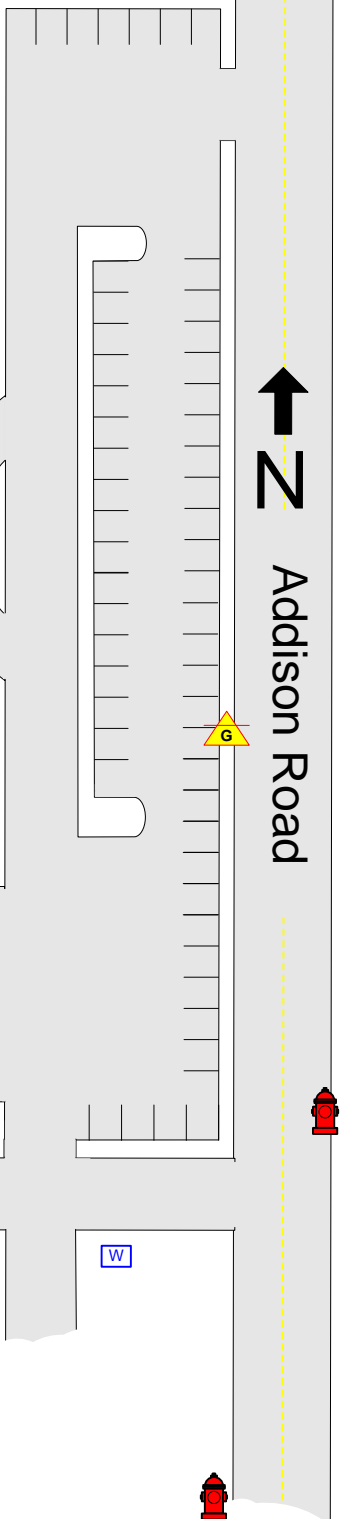


17275 Addison Rd.
 Bent Tree Child Care
 Ground Floor

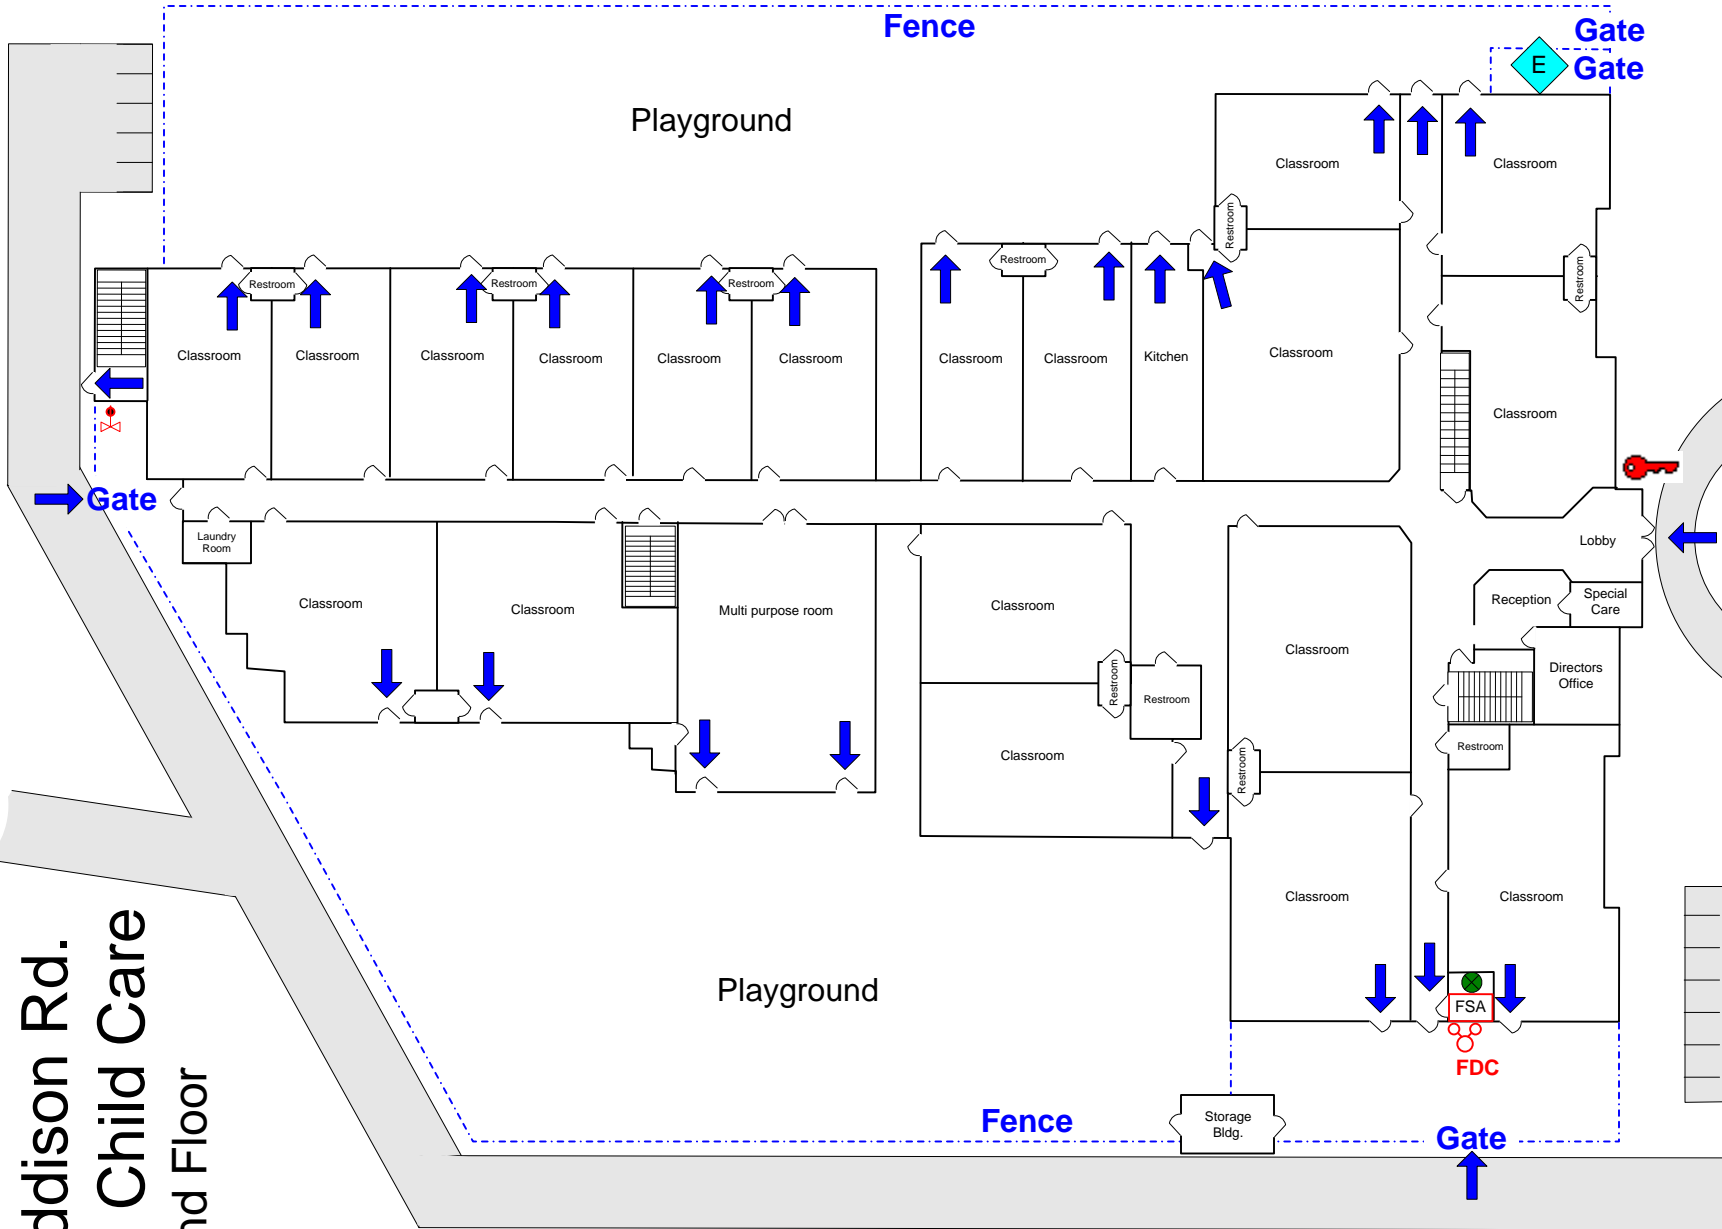

Addison!
 FIRE DEPARTMENT
 OPERATIONS DIVISION

FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	ELECTRICAL MAIN	Inspectors Test Valve
ENTRANCE / EXIT	GAS SHUTOFF VALVE	STAIRS	
KNOX BOX			