


3883 ARAPAHO RD Osteomed Corporation

Addison!

FIRE DEPARTMENT
OPERATIONS
DIVISION

DRAWING BY:
RAY YAGER
11/27/02

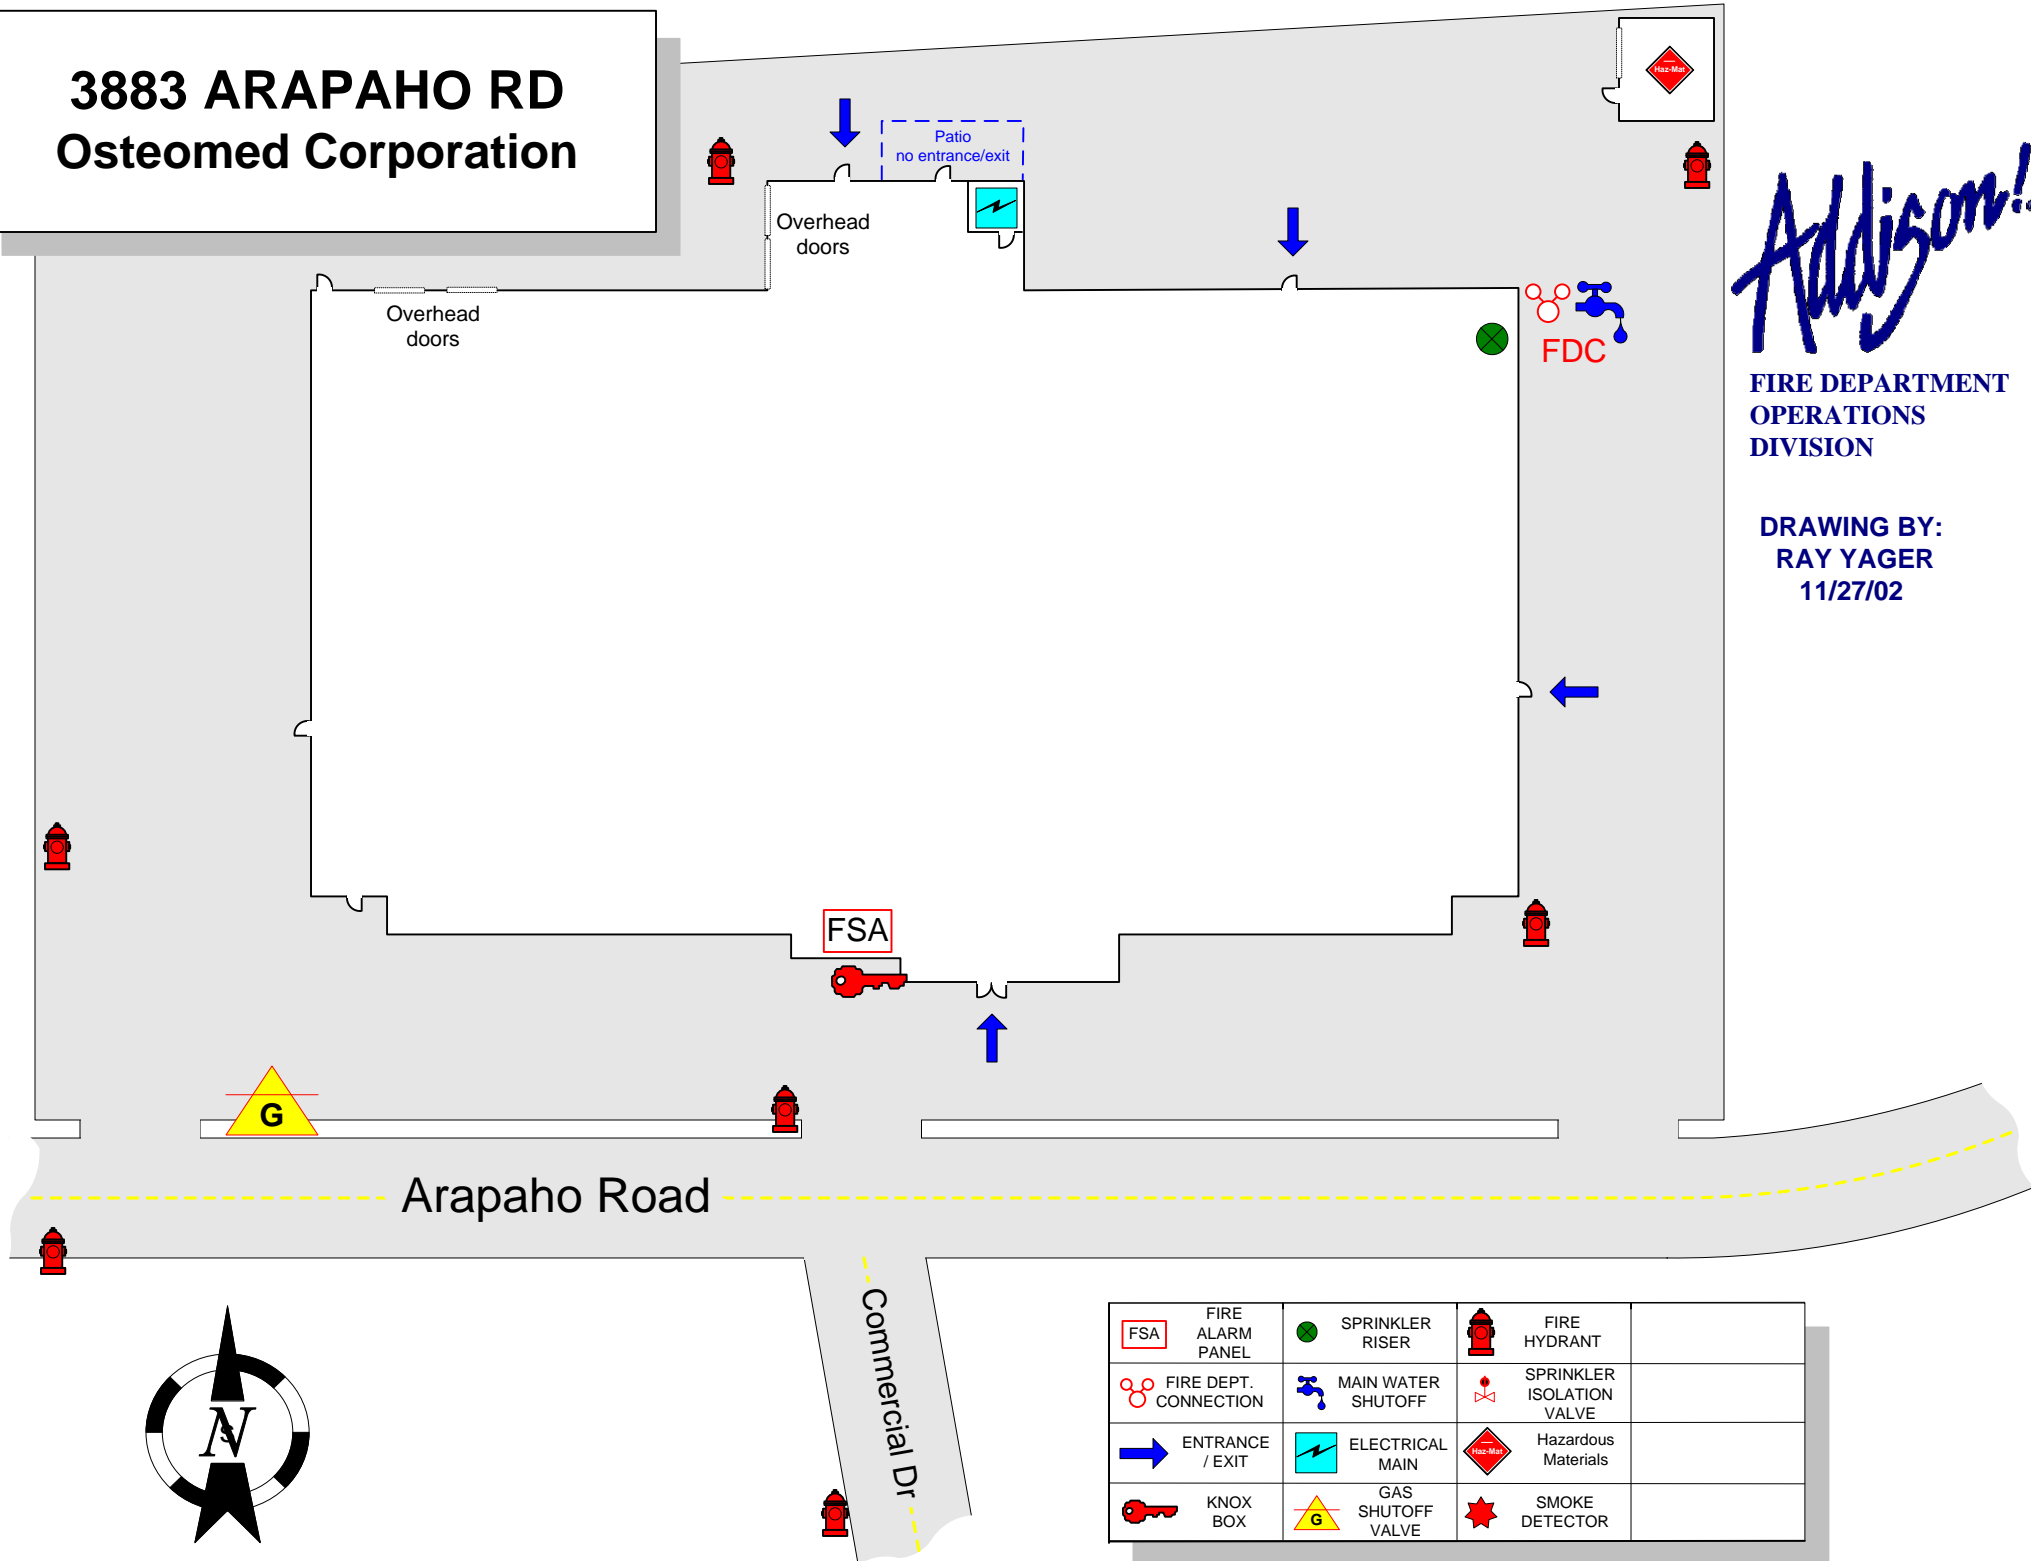

FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	
FIRE DEPT. CONNECTION		MAIN WATER SHUTOFF	SPRINKLER ISOLATION VALVE	
ENTRANCE / EXIT		ELECTRICAL MAIN	Hazardous Materials	
KNOX BOX		GAS SHUTOFF VALVE	SMOKE DETECTOR	