


3740 & 3750 Beltline Rd

Beltline Road

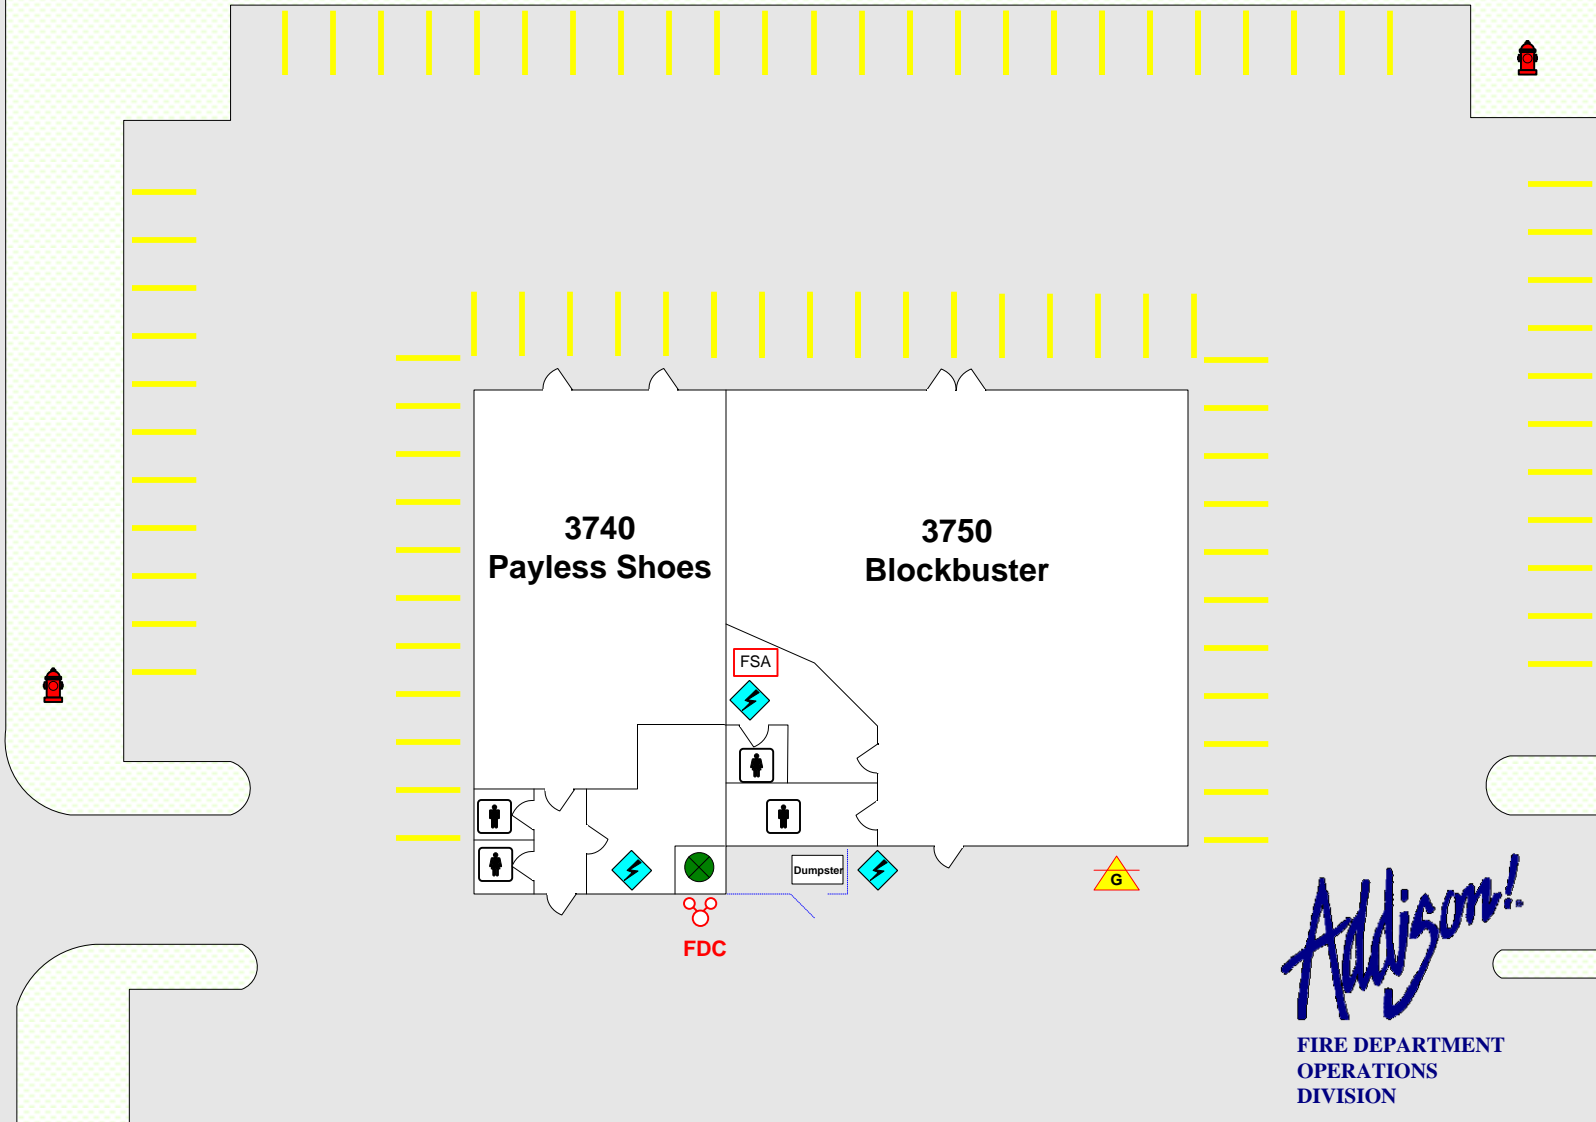

	FIRE ALARM PANEL
	FIRE DEPT. CONNECTION
	ELECTRICAL
	KNOX BOX
	GAS SHUTOFF VALVE
	ENTRANCE/EXIT
	SPRINKLER RISER
	SPRINKLER DRAIN
	MAIN WATER SHUTOFF
	FIRE HYDRANT

Addison!

FIRE DEPARTMENT
OPERATIONS
DIVISION

DRAWING BY:
RAY YAGER
12/22/03