


3800-3850 Beltline Rd

Addison!

FIRE DEPARTMENT
OPERATIONS
DIVISION

DRAWING BY:
RAY YAGER
10/5/04

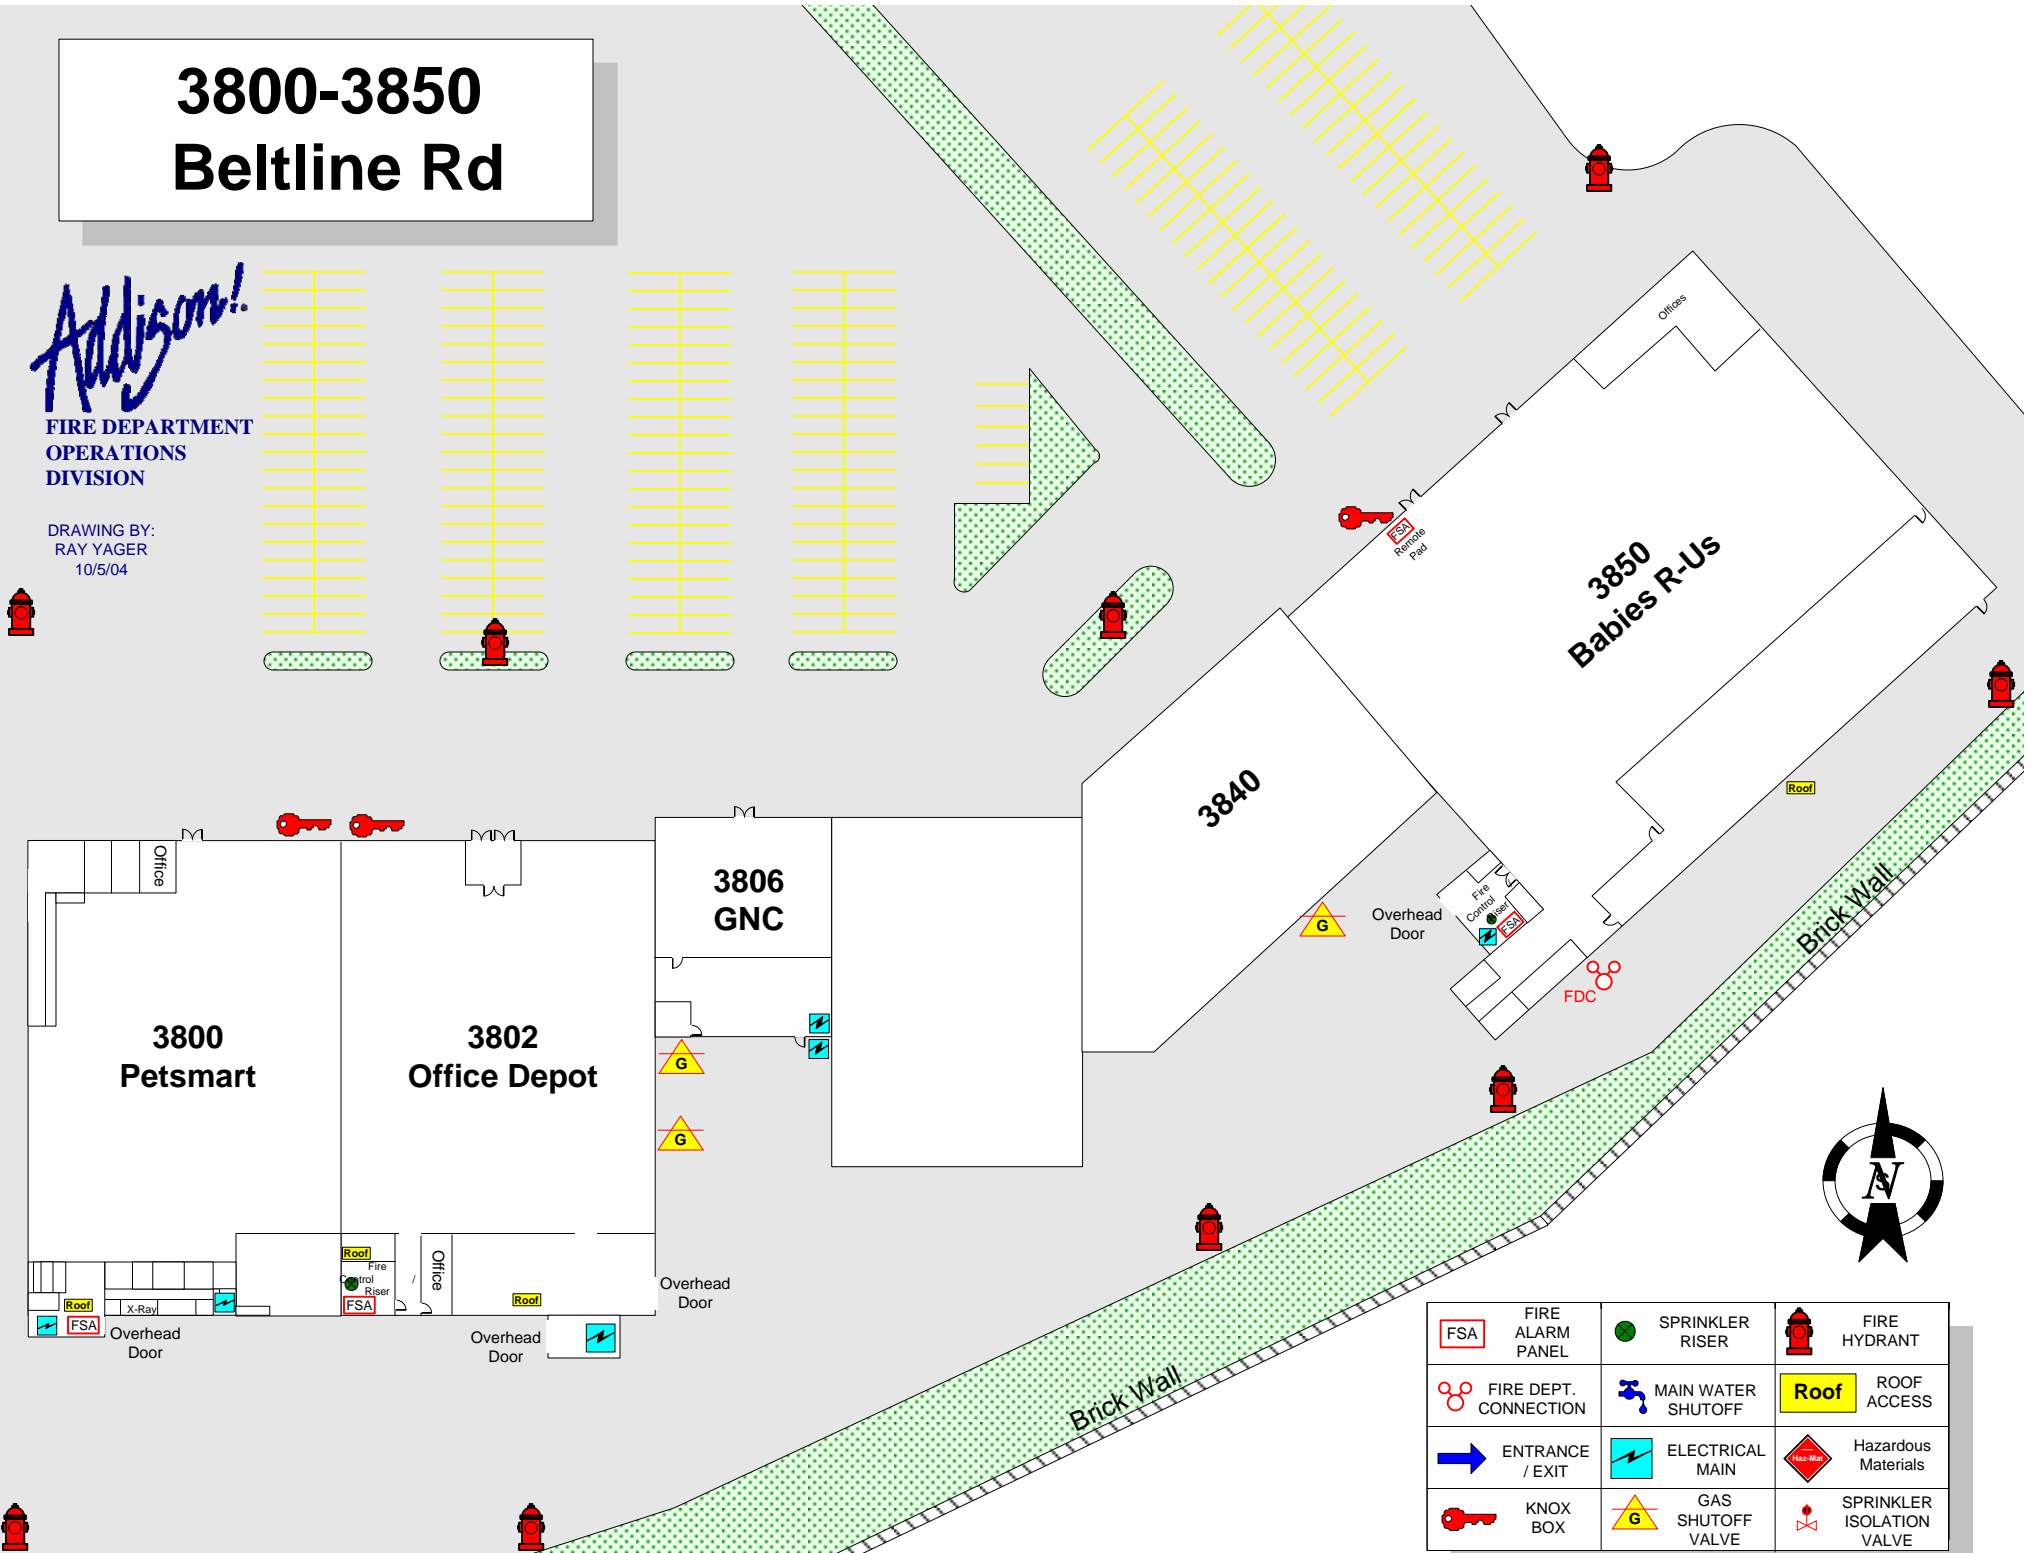

FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	ROOF ACCESS	Hazardous Materials
ENTRANCE / EXIT	ELECTRICAL MAIN	GAS SHUTOFF VALVE	SPRINKLER ISOLATION VALVE
KNOX BOX			