

3805 Beltline Rd 300


FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	SPRINKLER ISOLATION VALVE
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	Roof	Roof Access	
ENTRANCE / EXIT	ELECTRICAL MAIN	Hazardous Materials		
KNOX BOX	GAS SHUTOFF VALVE	SMOKE DETECTOR		

Realty Rd

Addison!

**FIRE DEPARTMENT
OPERATIONS
DIVISION**

Business Ave.

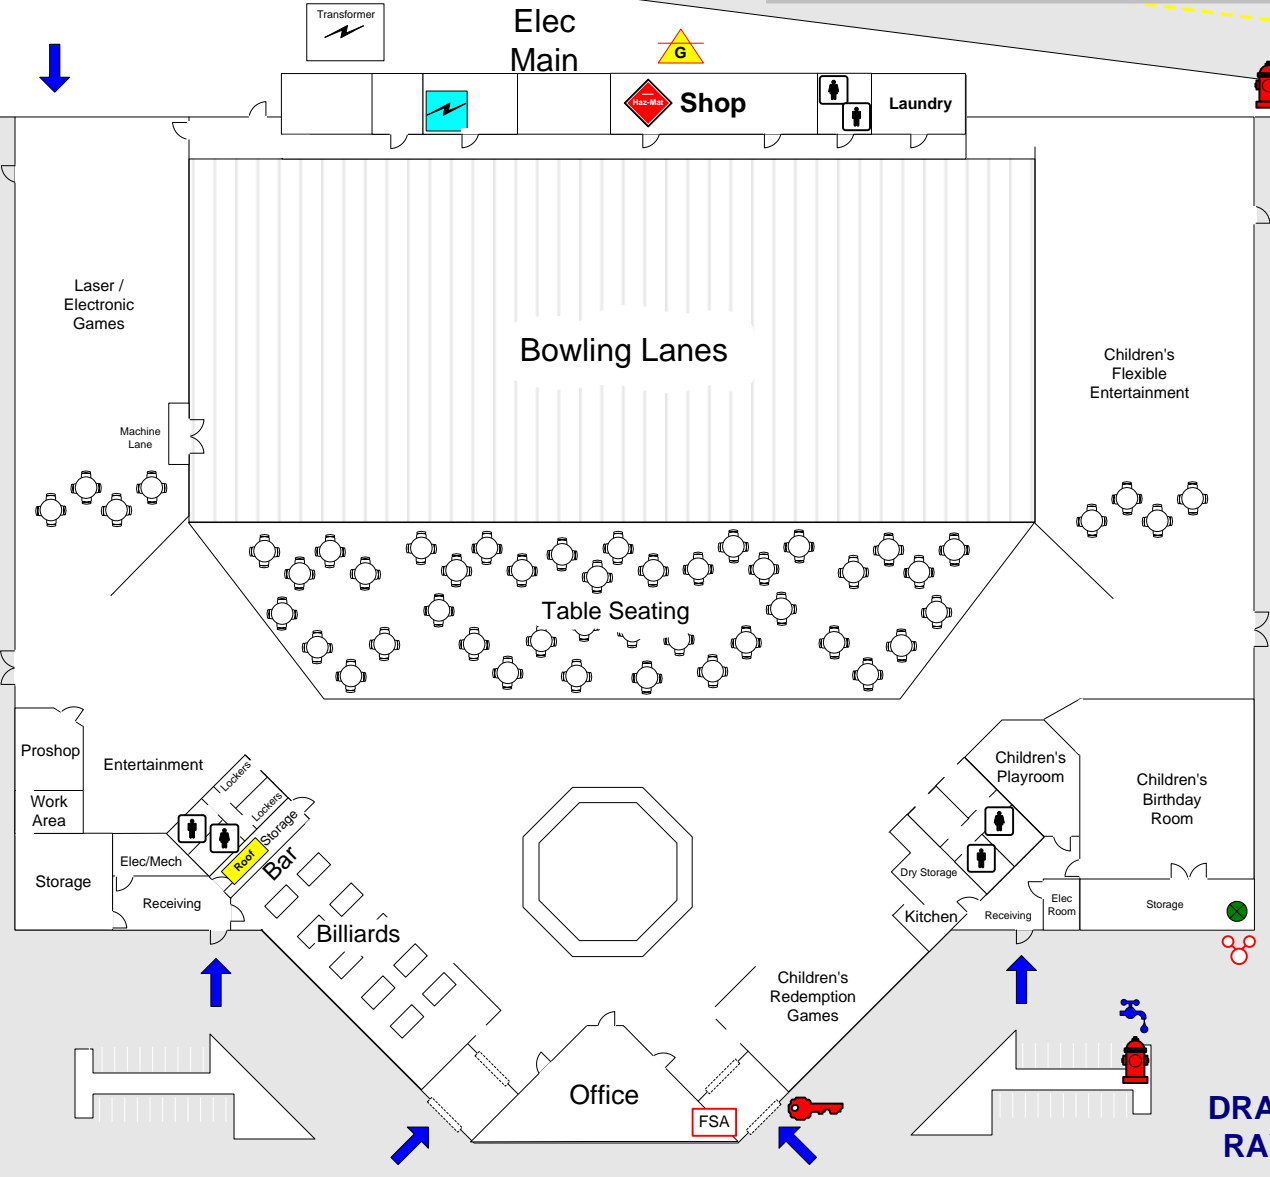

Commercial Dr.

**DRAWING BY:
RAY YAGER
4/20/00**