


4050 Beltline Rd.



FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	Hazardous Materials	
ENTRANCE / EXIT	ELECTRICAL MAIN		
KNOX BOX	GAS SHUTOFF VALVE		

DRAWING BY:  
Jared Schreher

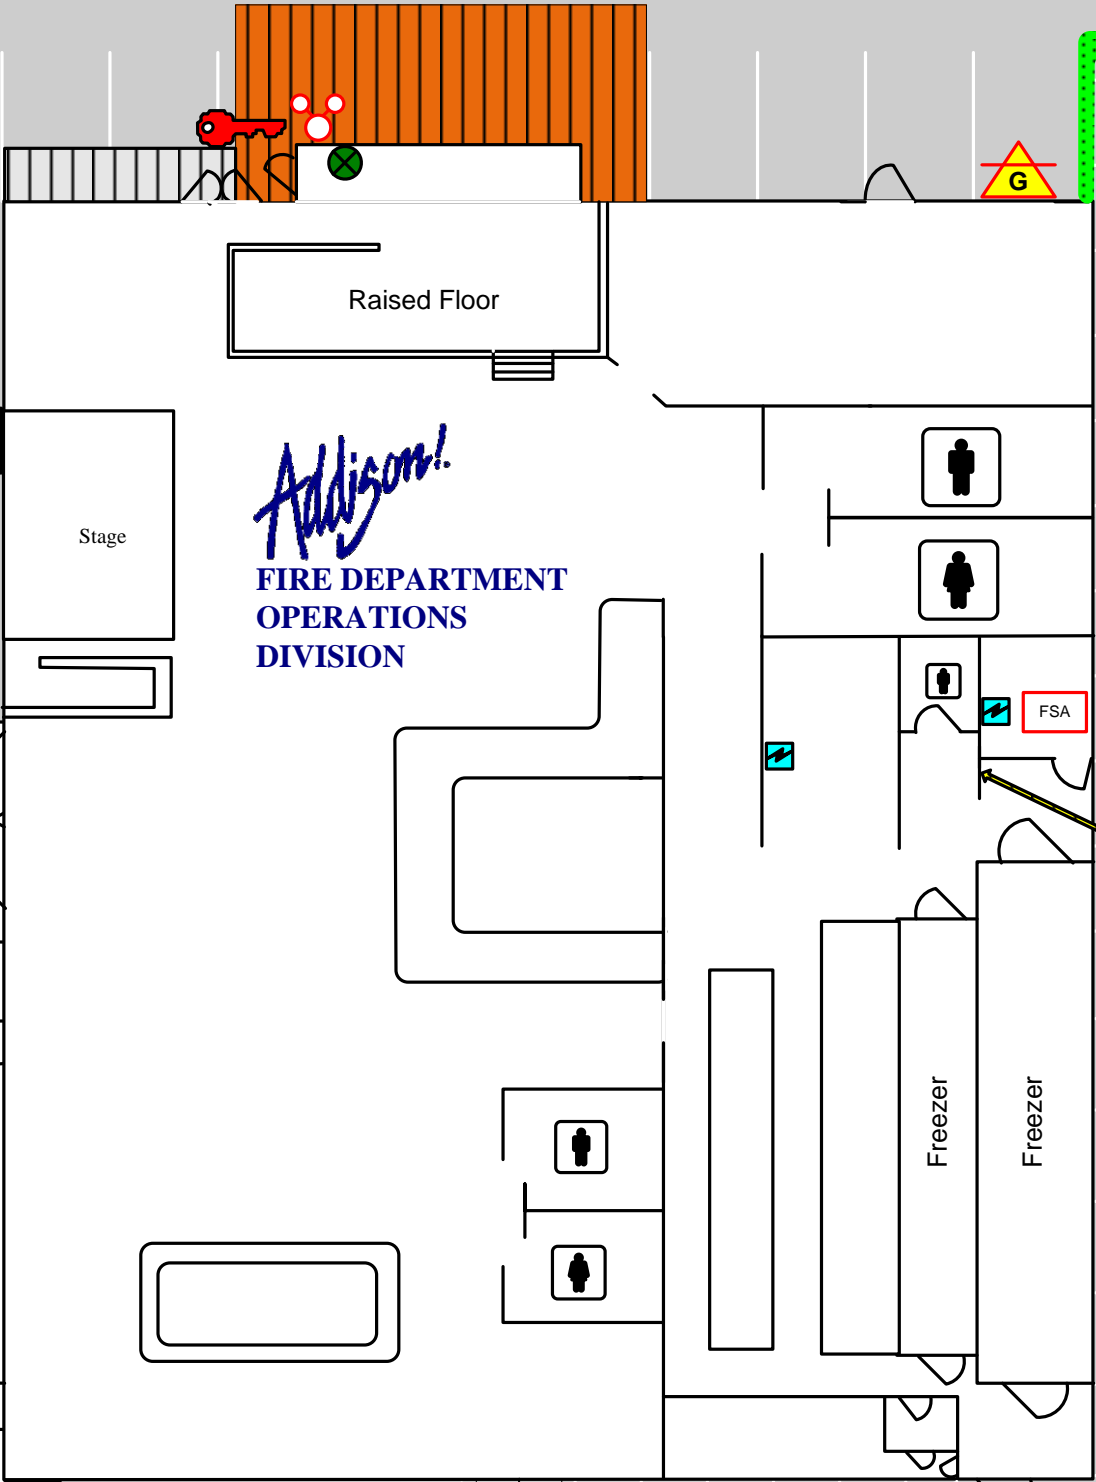