


# 4150 BELTLINE RD SAM'S WHOLESALE CLUB



To Beltline Rd  
↑

FSA FIRE ALARM PANEL	REMOVABLE BARRICADES	FIRE HYDRANT	SPRINKLER ISOLATION VALVE
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	<b>Roof</b> ROOF ACCESS	SPRINKLER RISER
ENTRANCE / EXIT	ELECTRICAL MAIN	Hazardous Materials	MAIN SPRINKLER SHUTOFF
KNOX BOX	GAS SHUTOFF VALVE	SMOKE DETECTOR	STANDPIPE

FRONT  
ENTRANCE  
←

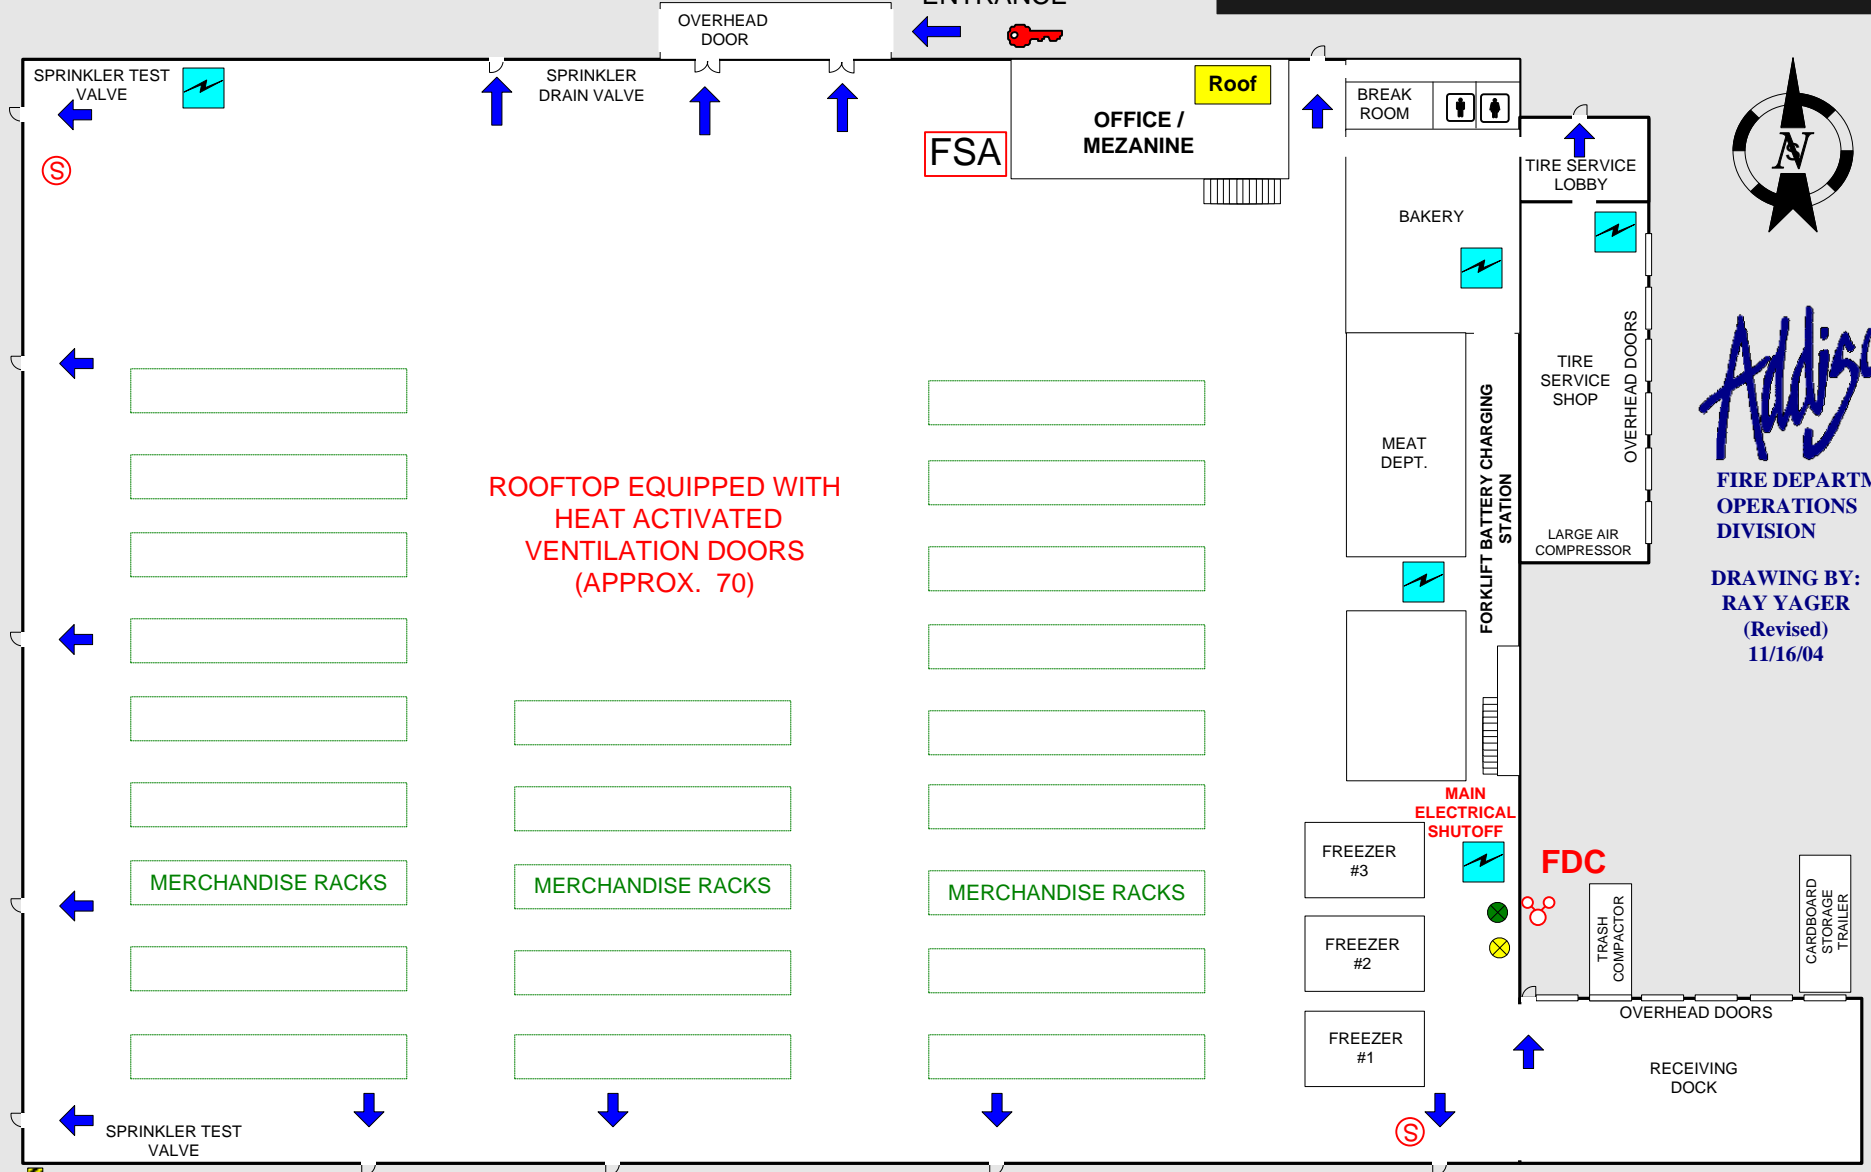

ROOFTOP EQUIPPED WITH  
HEAT ACTIVATED  
VENTILATION DOORS  
(APPROX. 70)



*Addison!*

FIRE DEPARTMENT  
OPERATIONS  
DIVISION

DRAWING BY:  
RAY YAGER  
(Revised)  
11/16/04

PARKING OF EMERGENCY APPARATUS NOT RECOMMENDED IN THIS AREA  
DURING FIRE CONDITIONS DUE TO POSSIBLE TILT WALL COLLAPSE

Brick Wall

Brick Wall