













4325 Beltline Rd MOTEL 6

Addison!

**FIRE DEPARTMENT
OPERATIONS
DIVISION**

DRAWING BY:
RAY YAGER
Revised 11/19/04

 FSA	FIRE ALARM PANEL		SPRINKLER RISER		FIRE HYDRANT
	FIRE DEPT. CONNECTION		MAIN WATER SHUTOFF		ROOF ACCESS
	ENTRANCE / EXIT		ELECTRICAL MAIN		Hazardous Materials
	KNOX BOX		GAS SHUTOFF VALVE		SPRINKLER ISOLATION VALVE




Jogging track, Playground
& Tennis courts in back

Jo Jo's
Restaurant

Pool
& Jacuzzi

Lobby

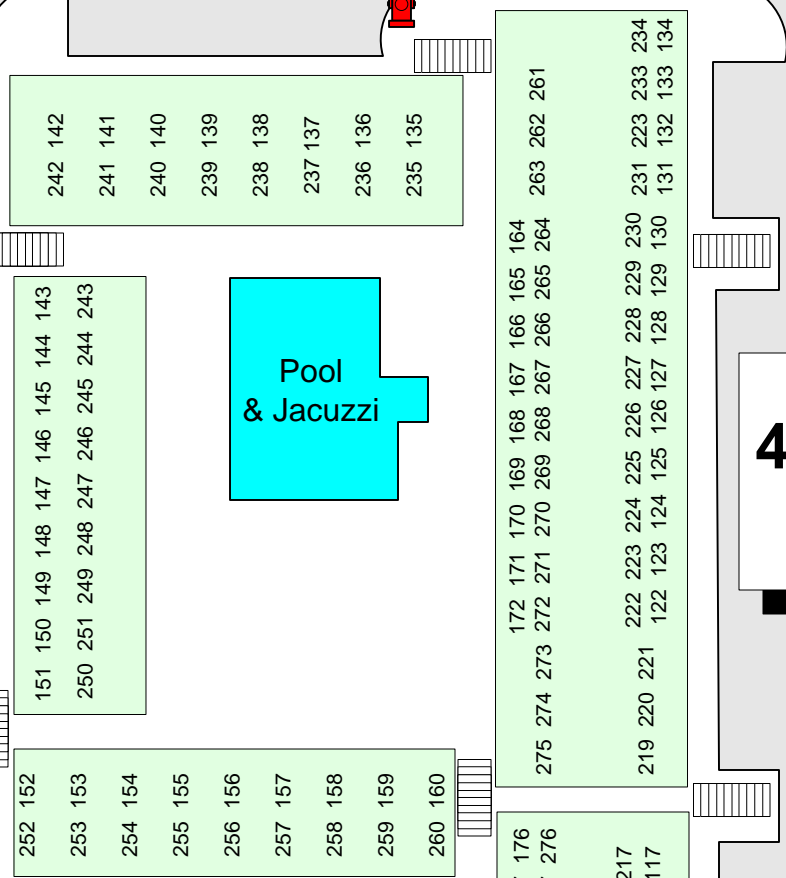

Beltline Rd