


Beltline Rd.

4500 Beltline Rd. Chili's Restaurant

Addison!

FIRE DEPARTMENT
OPERATIONS DIVISION

DRAWING BY:
RAY YAGER
5/01

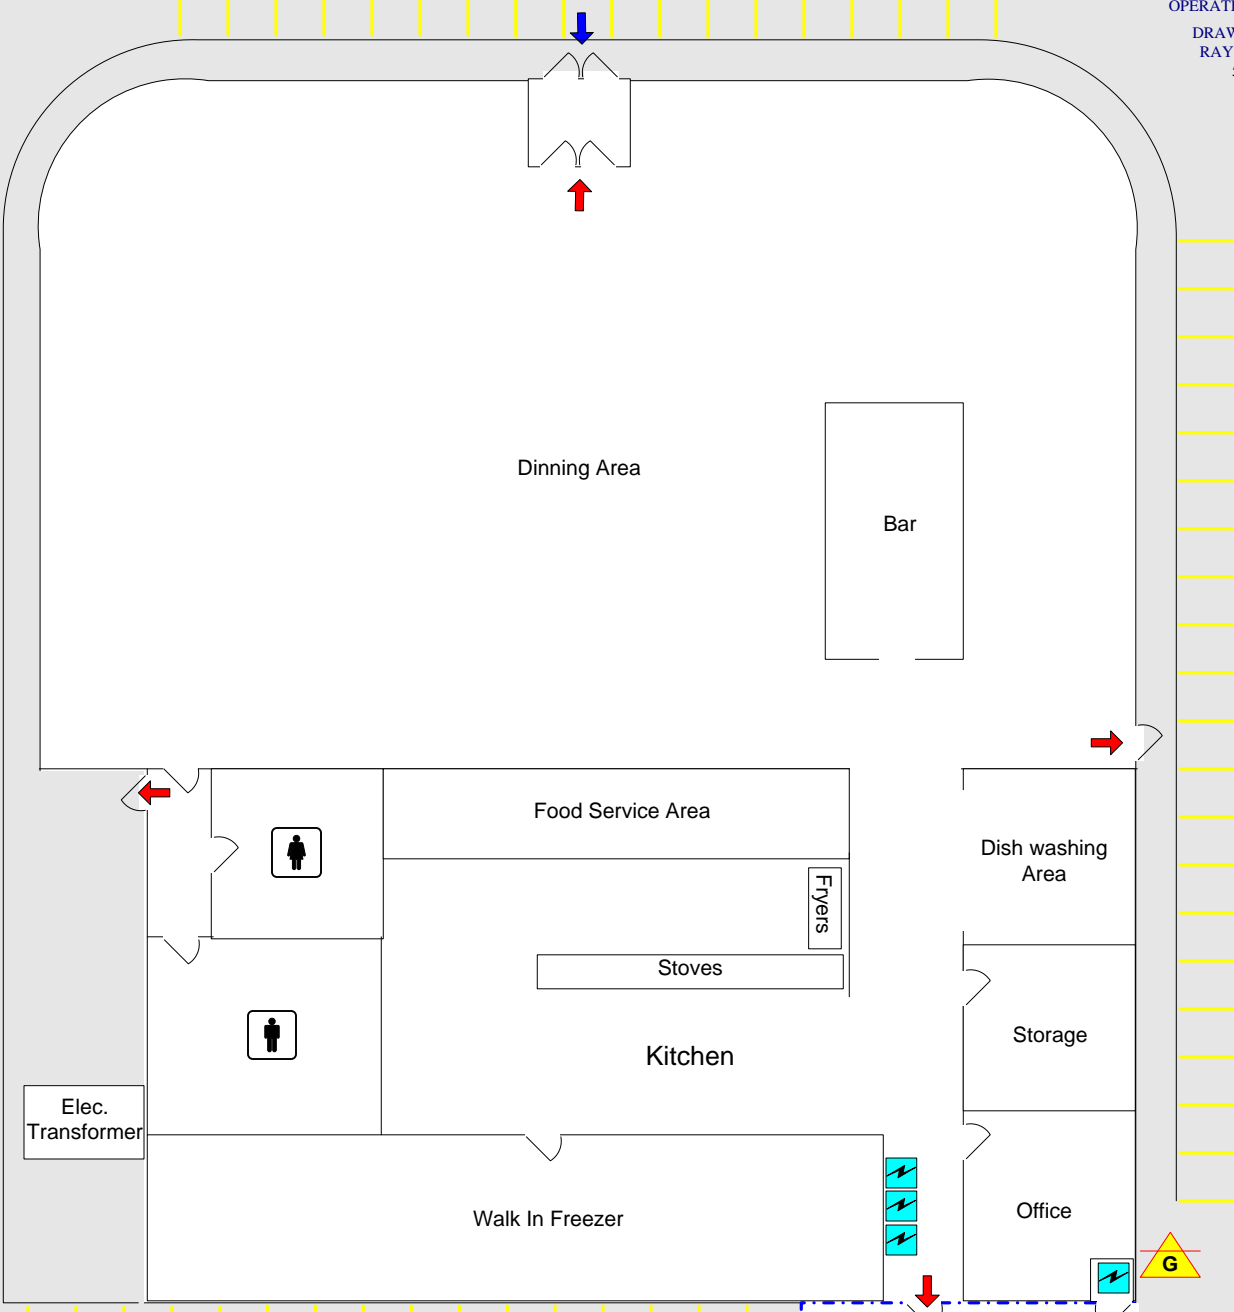

FSA	FIRE ALARM PANEL	GAS SHUTOFF VALVE	FIRE HYDRANT	ENTRANCE/EXIT	ENTRANCE / EXIT
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	ELECTRICAL PANEL	HIGH PRESSURE CYLINDERS (CO2)		

