



# 4555 Beltline Rd. Quality Suites Hotel (Ground Floor)

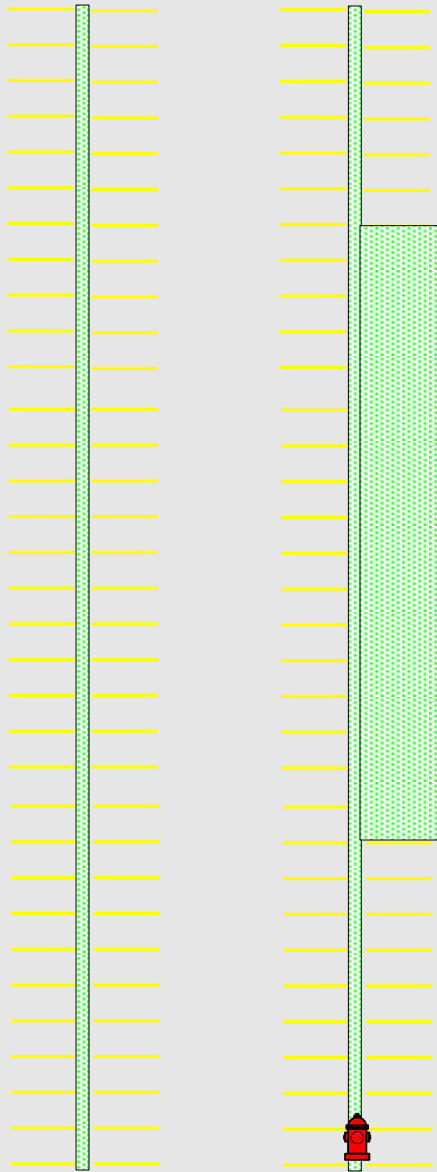

To  
Beltline Rd  
(200 FT)

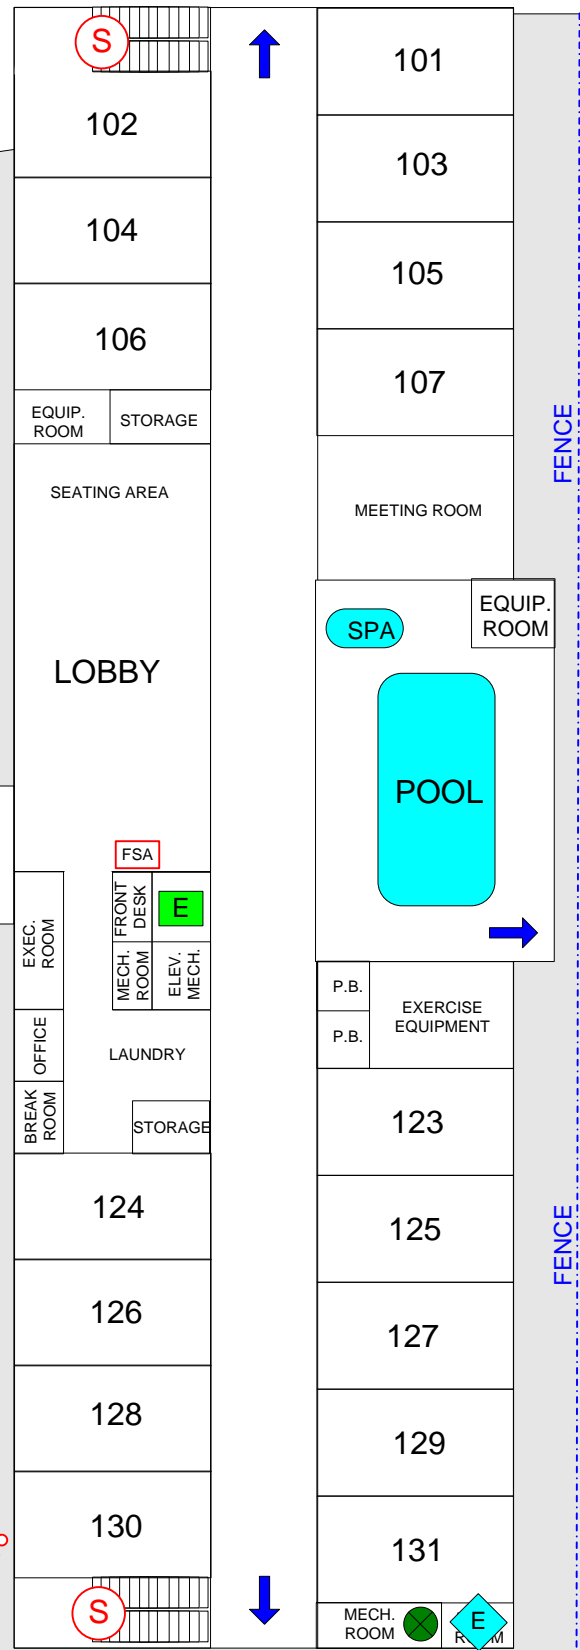

FENCE

FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	TRASH CHUTE	ELECTRONIC GATE	HEAT ACTIVATED FIRE DOOR
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	STANDPIPE CONNECTION	ELEVATOR	SPRINKLER ISOLATION VALVE	FIRE DOOR	MAIN SPRINKLER SHUTOFF
KNOX SWITCH	ELECTRICAL MAIN	STAIRS	HEAT DETECTOR	ENTRANCE / EXIT		
KNOX BOX	GAS SHUTOFF VALVE		SMOKE DETECTOR	PARKING ENTRANCE / EXIT		

*Addison!*  
FIRE DEPARTMENT  
OPERATIONS DIVISION  
DRAWING BY:  
RAY YAGER  
Revised 11/19/04

