


5300 BELTLINE RD ADDISON TOWN HALL (GROUND FLOOR & BASEMENT)




FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	SPRINKLER ISOLATION VALVE
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	Roof	Roof Access	
ENTRANCE / EXIT	ELECTRICAL MAIN	Hazardous Materials		
KNOX BOX	GAS SHUTOFF VALVE	SMOKE DETECTOR		

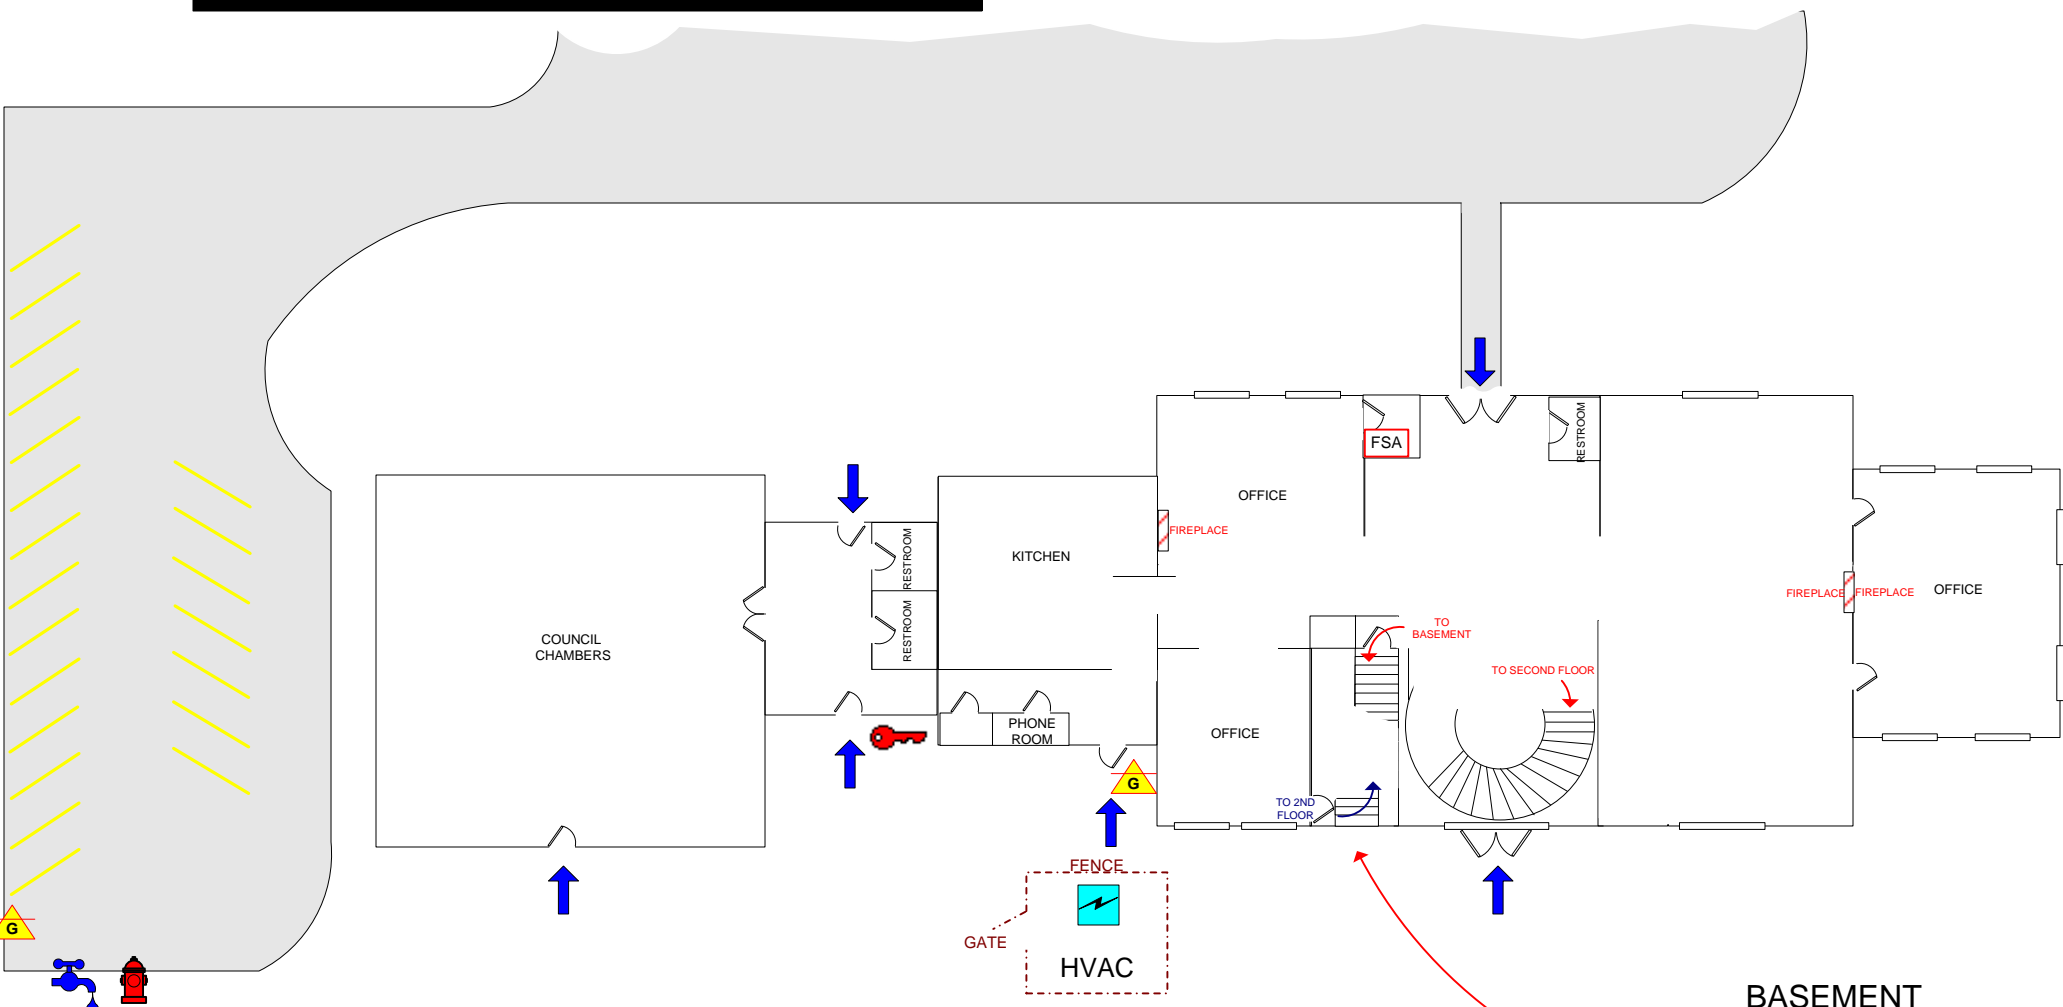

Addison!
FIRE DEPARTMENT
OPERATIONS
DIVISION

BASEMENT



DRAWING BY:
RAY YAGER
1/24/00