










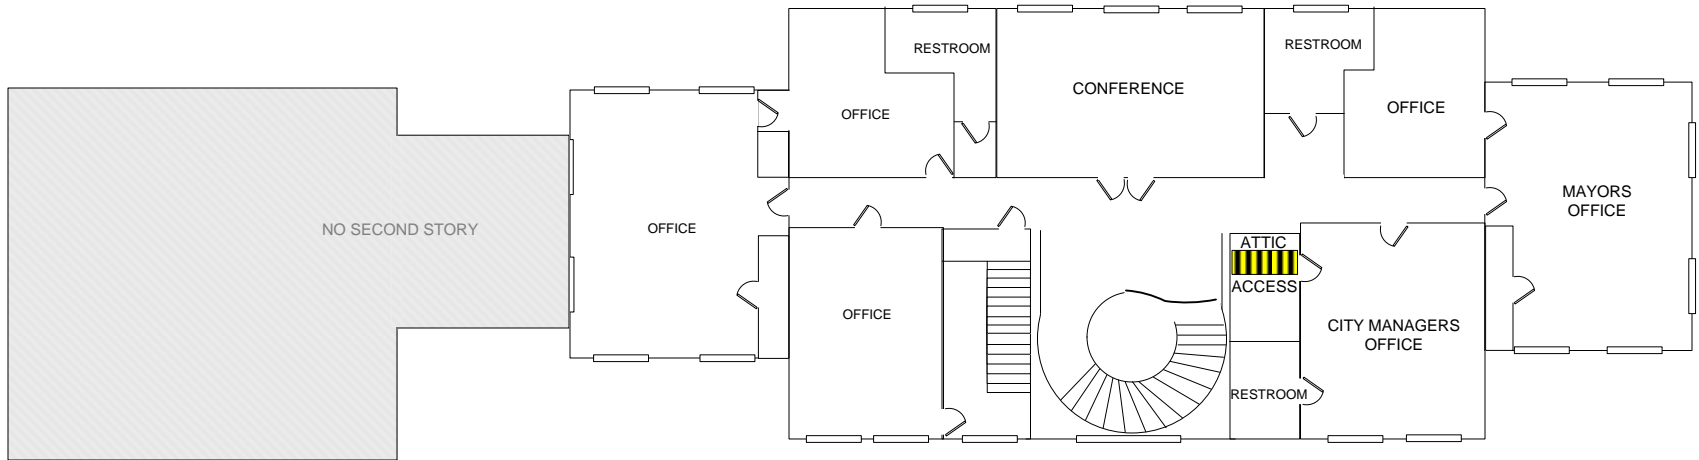




5300 BELTLINE RD ADDISON TOWN HALL (2nd Floor)



 FSA	FIRE ALARM PANEL		SPRINKLER RISER		FIRE HYDRANT		SPRINKLER ISOLATION VALVE
	FIRE DEPT. CONNECTION		MAIN WATER SHUTOFF		Roof Access		
	ENTRANCE / EXIT		ELECTRICAL MAIN		Hazardous Materials		
	KNOX BOX		GAS SHUTOFF VALVE		SMOKE DETECTOR		



Addison!

FIRE DEPARTMENT
OPERATIONS
DIVISION

DRAWING BY:
RAY YAGER
1/24/00