


Surveyor Blvd



Beltway Dr

	FIRE ALARM PANEL
	SPRINKLER RISER
	FIRE HYDRANT
	GAS SHUTOFF

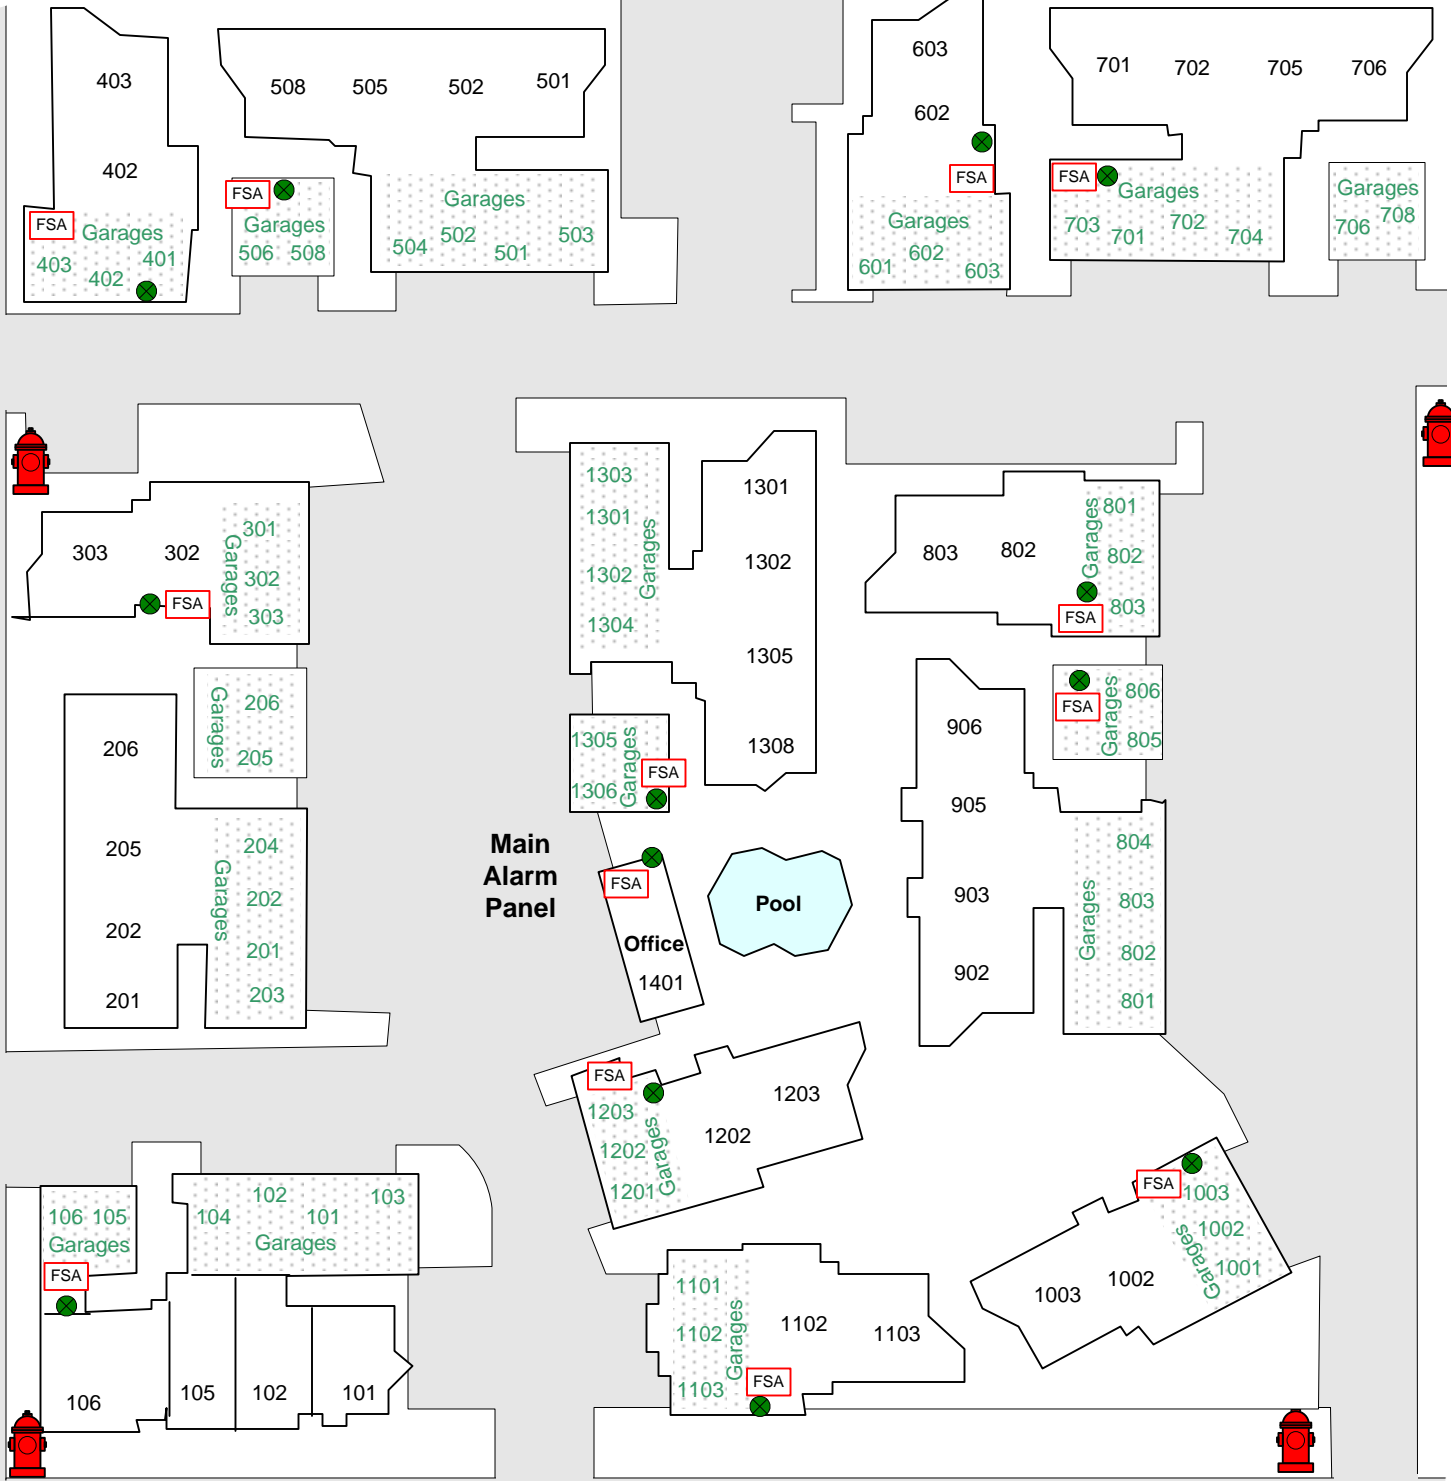

Addison!

**FIRE DEPARTMENT
OPERATIONS
DIVISION**

**4051 BELTWAY DRIVE
WALNUT SQUARE
CONDOMINIUMS**

Drawing by: Ray Yager 12/19/04