

4555 Beltway Dr Hampton Inn (Ground Floor)




FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	SMOKE DETECTOR
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	STANDPIPE CONNECTION	SPRINKLER ISOLATION VALVE	
KNOX BOX	ELECTRICAL MAIN	ELEVATOR	GAS SHUTOFF VALVE	
ENTRANCE / EXIT	STAIRS			

Addison!

FIRE DEPARTMENT
OPERATIONS
DIVISION

DRAWING BY:
RAY YAGER
4/20/00

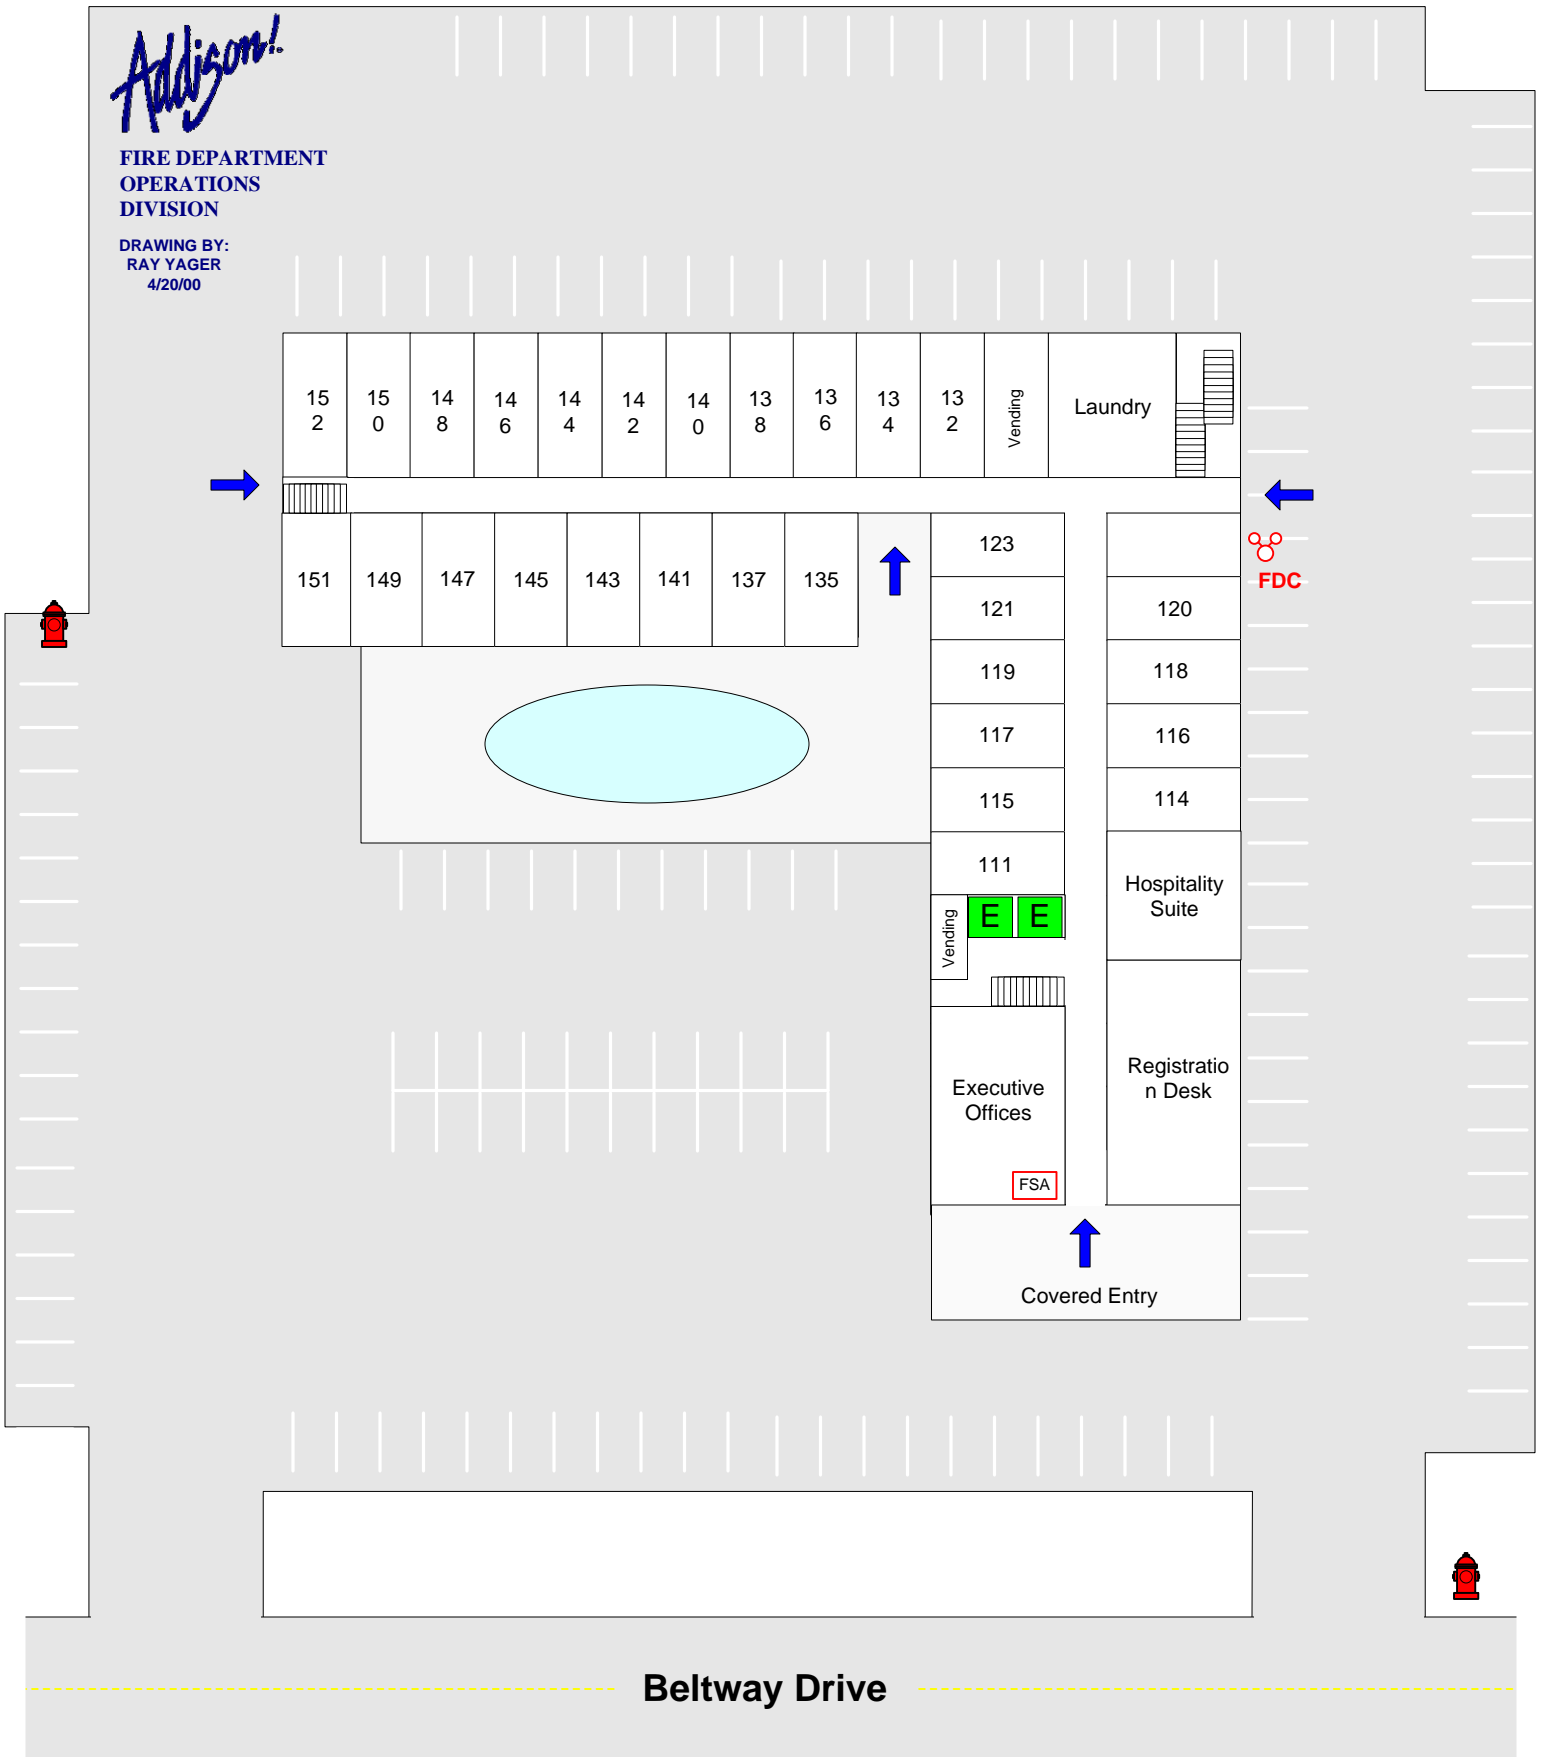

Beltway Drive