


4555 Beltway Dr Hampton Inn(Floors 2-4)

Addison!


FIRE DEPARTMENT
OPERATIONS
DIVISION

DRAWING BY:
RAY YAGER
4/20/00


FSA FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	SMOKE DETECTOR
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	STANDPIPE CONNECTION	SPRINKLER ISOLATION VALVE
KNOX BOX	ELECTRICAL MAIN	ELEVATOR	
ENTRANCE / EXIT	STAIRS	GAS SHUTOFF VALVE	

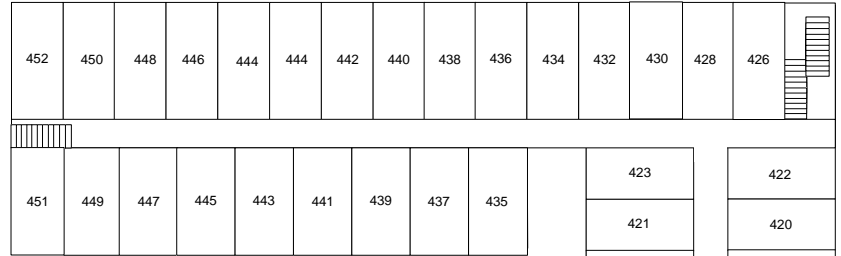

Floor 4

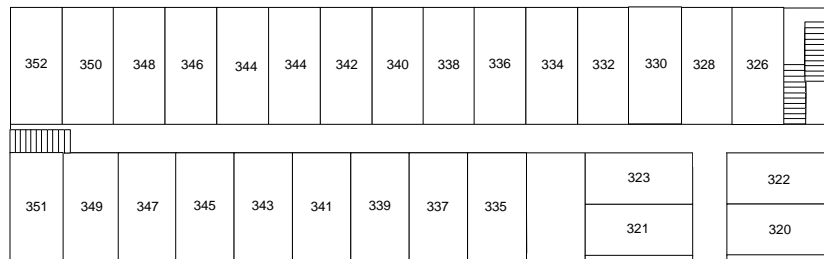

Floor 3

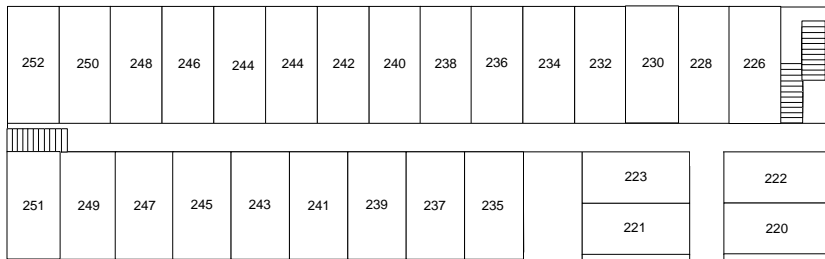

Floor 2