


# 14901 Dallas Pkwy Marriott Hotel (Basement Level)



*Addison!*  
FIRE DEPARTMENT  
OPERATIONS DIVISION

DRAWING BY:  
RAY YAGER  
09/20/00

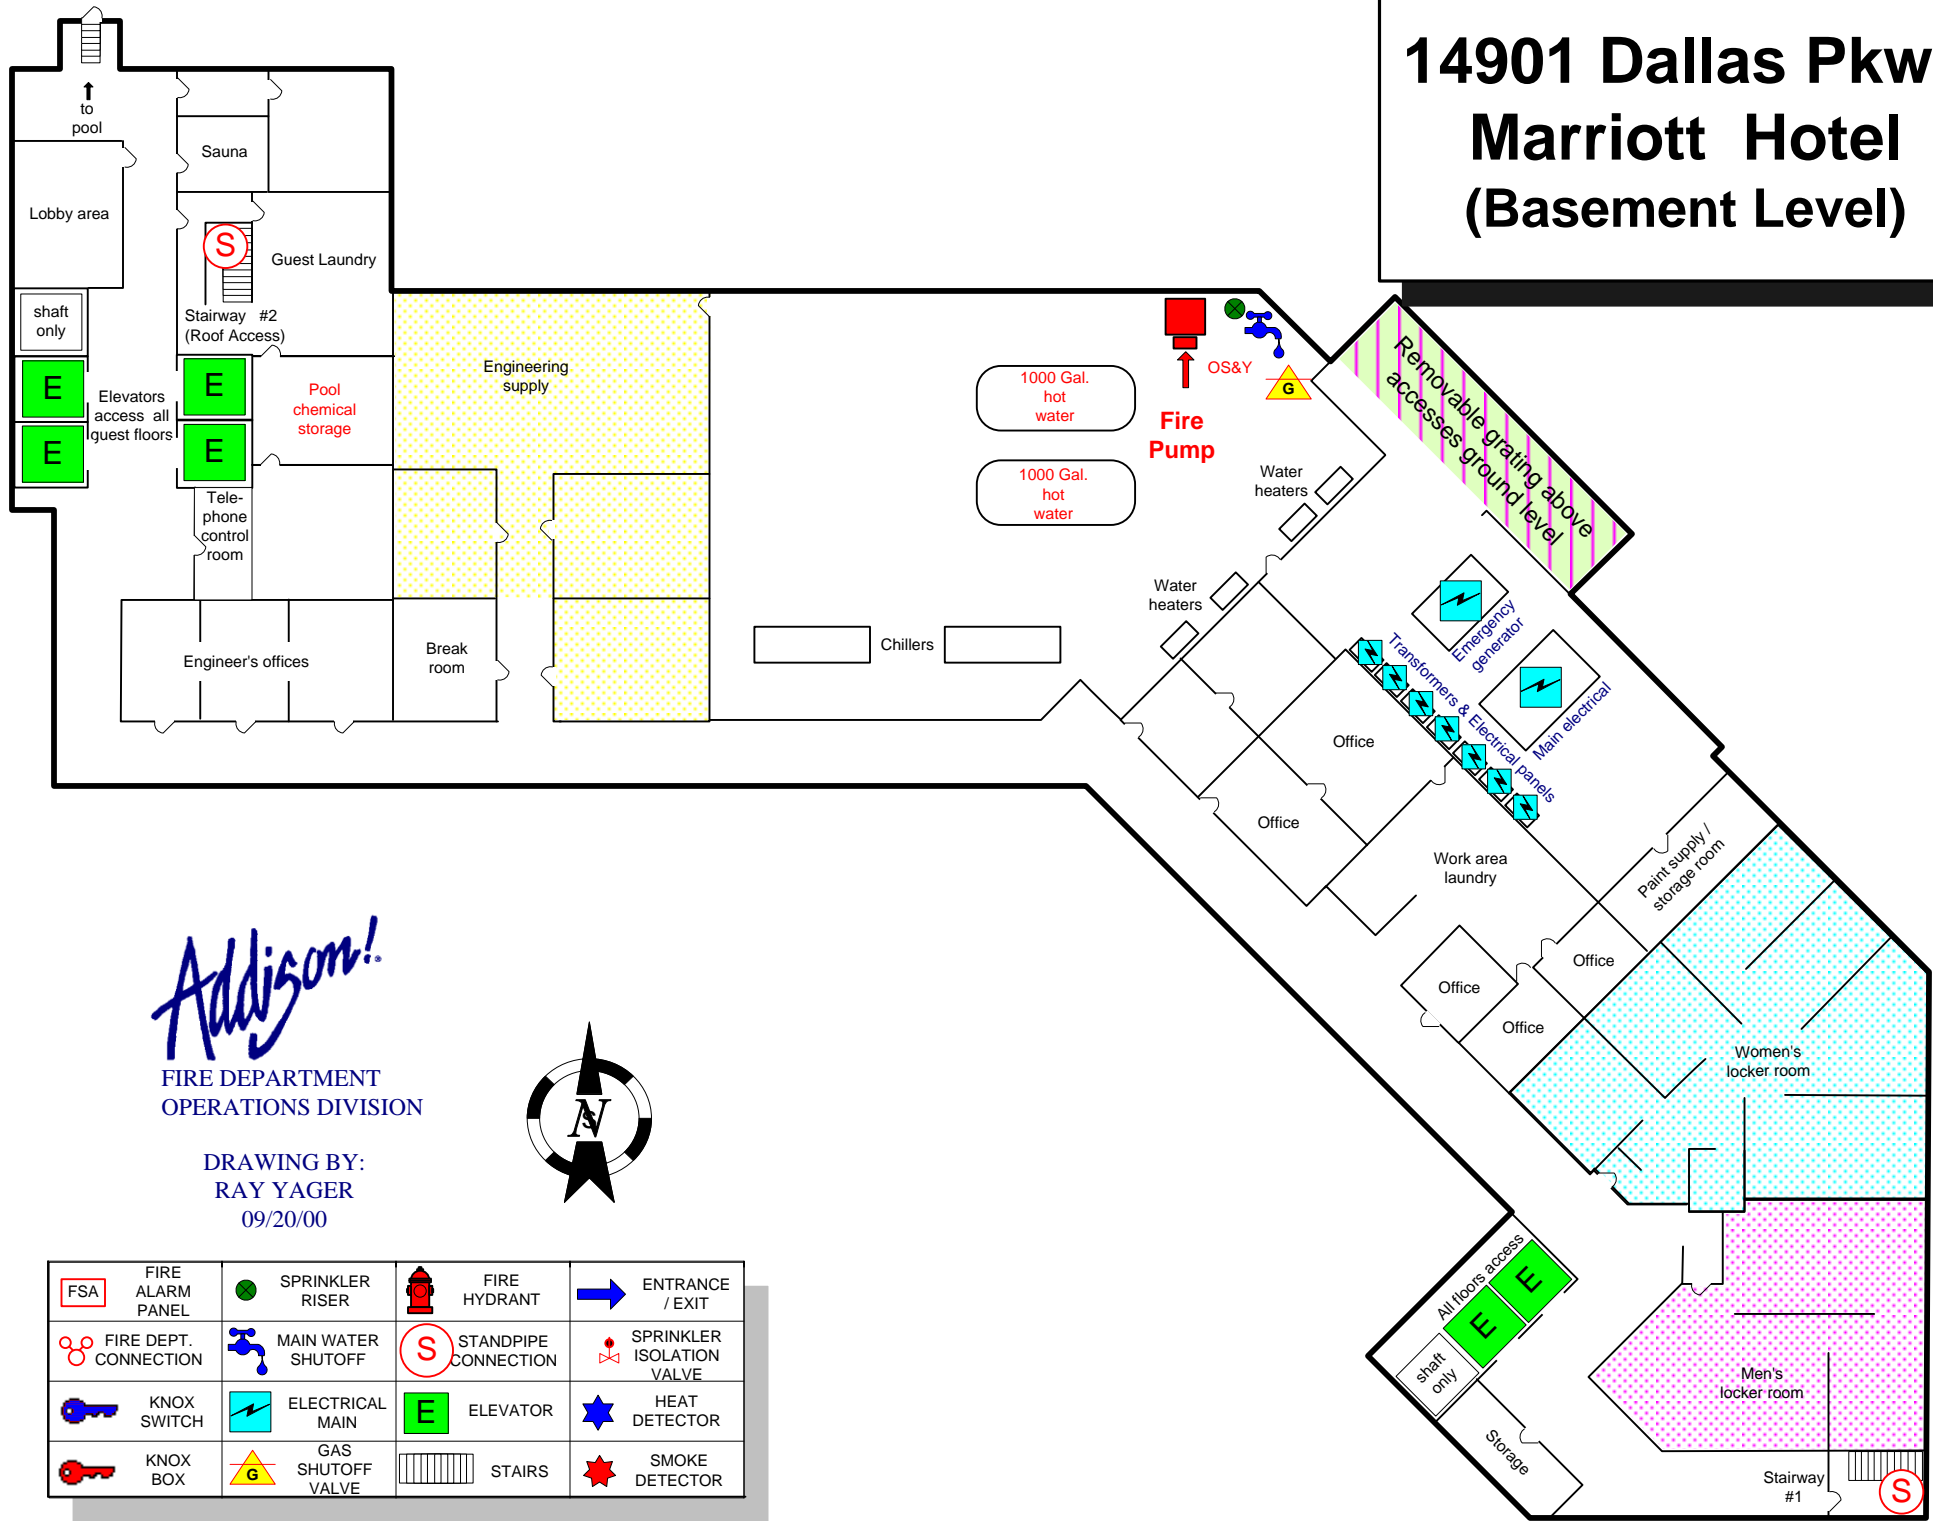

FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	ENTRANCE / EXIT
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	STANDPIPE CONNECTION	SPRINKLER ISOLATION VALVE	
KNOX SWITCH	ELECTRICAL MAIN	ELEVATOR	HEAT DETECTOR	
KNOX BOX	GAS SHUTOFF VALVE	STAIRS	SMOKE DETECTOR	