
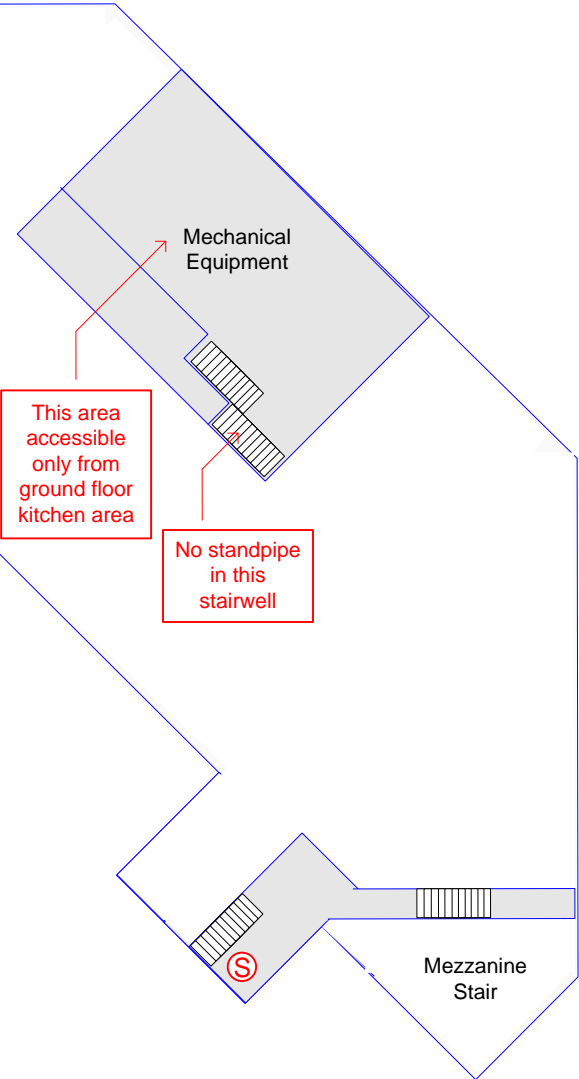


14901 Dallas Pkwy Marriott Hotel (Mezzanine Level)

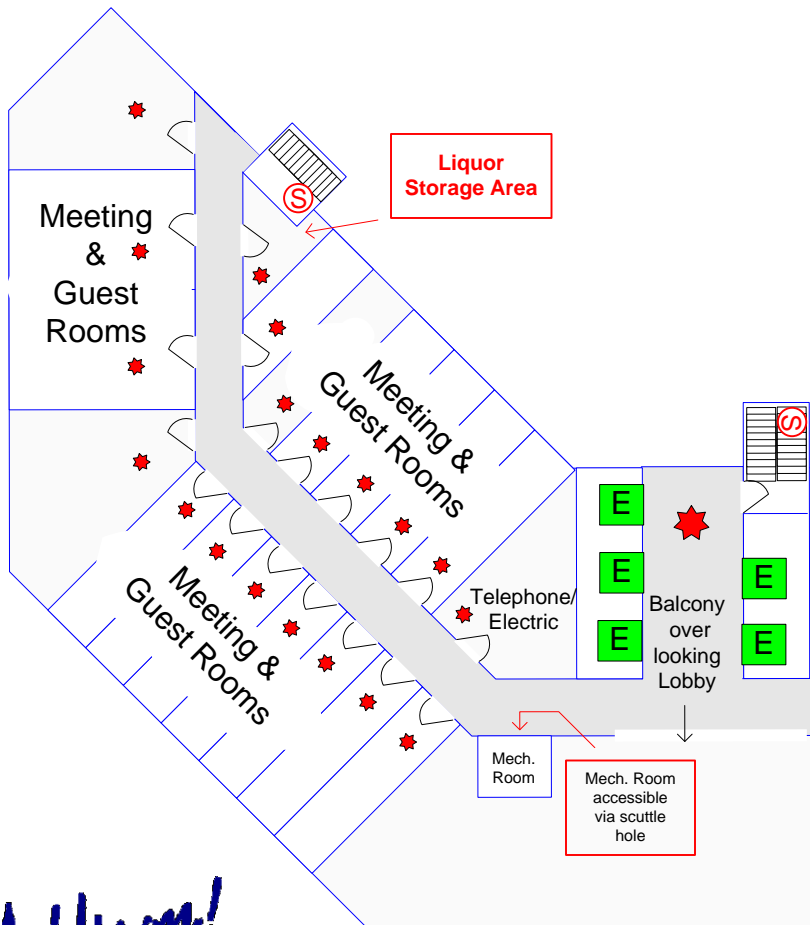

Addison!

FIRE DEPARTMENT
OPERATIONS DIVISION

DRAWING BY:
RAY YAGER
11/28/00



Note
Smoke detectors located in individual Guest Rooms are not tied to building alarm system
Guest Room detectors will provide an audible alarm within that room only

FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	ENTRANCE/EXIT
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	STANDPIPE CONNECTION	EXIT	
ELECTRICAL MAIN	ELEVATOR	HEAT DETECTOR	SMOKE DETECTOR	
GAS SHUTOFF VALVE	STAIRS			