


# 14901 Dallas Pkwy Marriott Hotel (Floors 3-11)



*Addison!*  
FIRE DEPARTMENT  
OPERATIONS DIVISION

DRAWING BY:  
RAY YAGER  
11/28/00

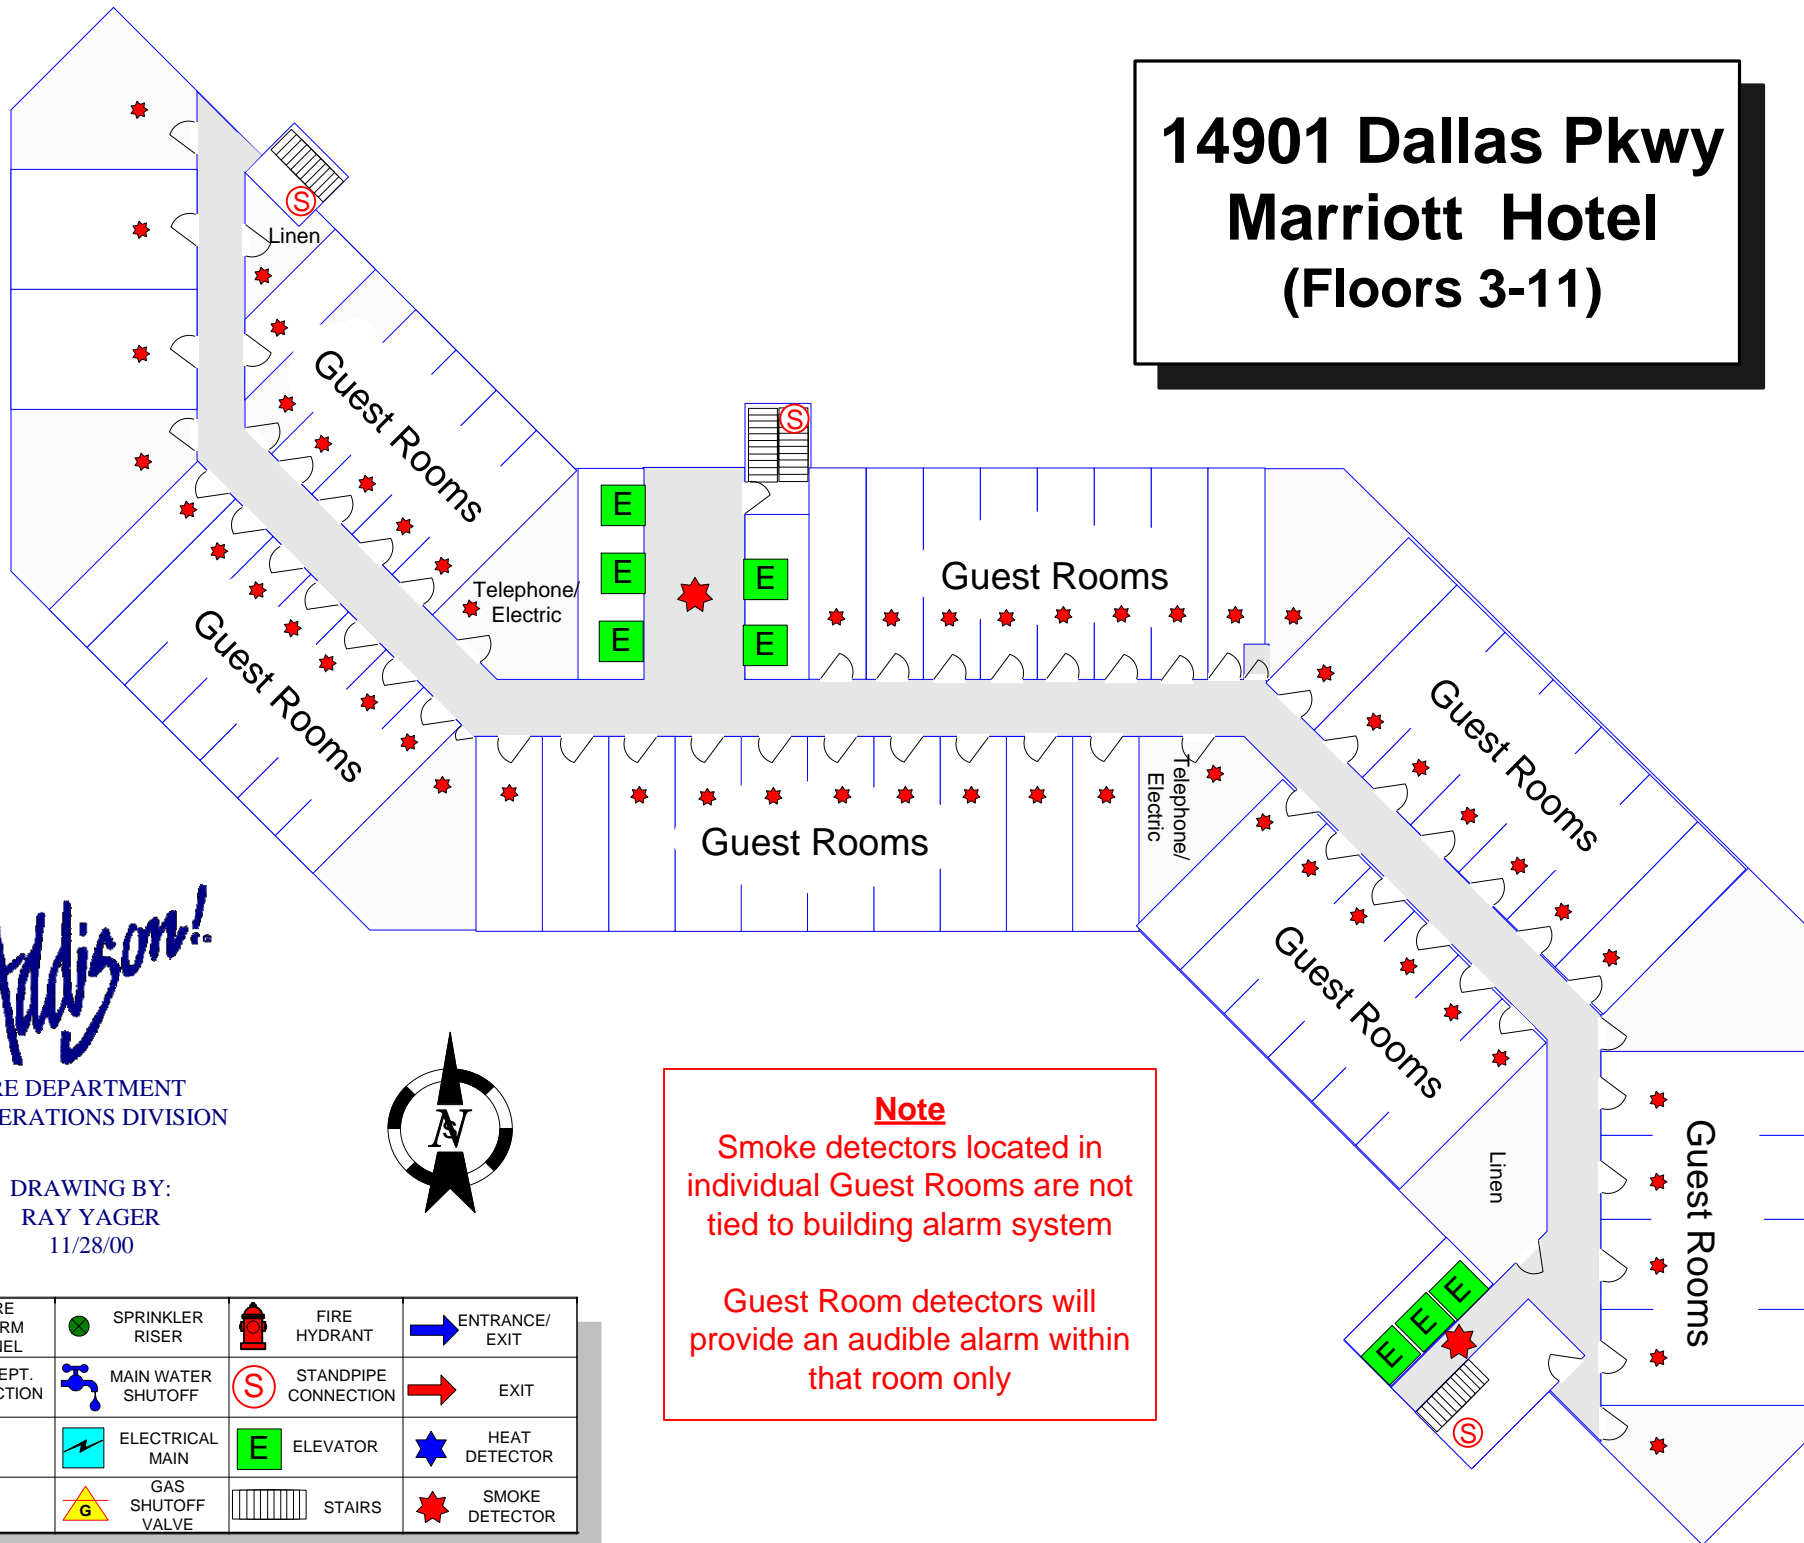

**Note**  
Smoke detectors located in individual Guest Rooms are not tied to building alarm system  
  
Guest Room detectors will provide an audible alarm within that room only

FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	ENTRANCE/EXIT
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	STANDPIPE CONNECTION	EXIT	
ELECTRICAL MAIN	ELEVATOR	HEAT DETECTOR		
GAS SHUTOFF VALVE	STAIRS	SMOKE DETECTOR		