


Addison Rd.

Dallas Pkwy.

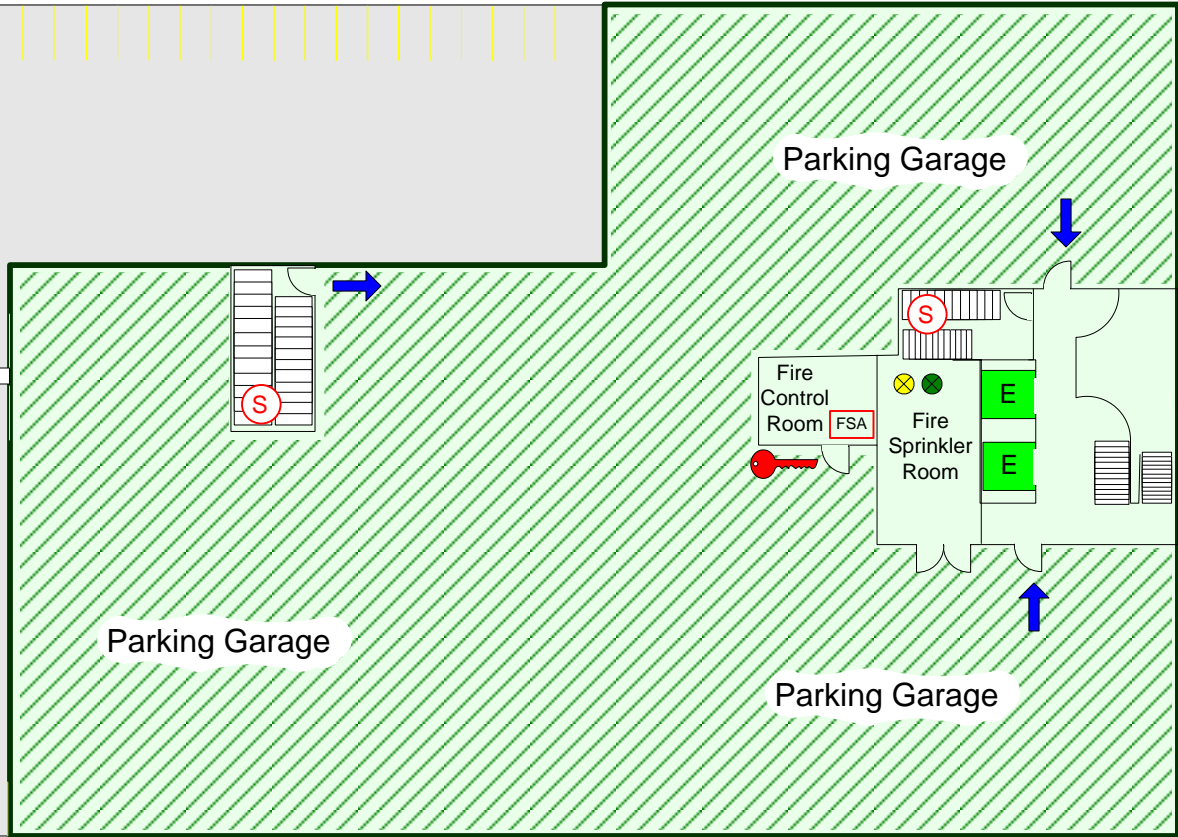

	ENTRANCE/ EXIT		FIRE DEPT. CONNECTION
	Knox Key		SPRINKLER RISER
	ELEVATOR		STANDPIPE CONNECTION
	STAIRS		SPRINKLER ISOLATION VALVE
	FIRE ALARM PANEL		MAIN SPRINKLER SHUTOFF
	SMOKE DETECTOR		ELECTRICAL
	HEAT DETECTOR		MAIN WATER SHUTOFF
	FIRE HYDRANT		Gas Shutoff

*Addison!*

**FIRE DEPARTMENT  
OPERATIONS  
DIVISION**

**DRAWING BY:  
RAY YAGER**



16885  
Dallas Parkway  
Ground Floor  
Jani-king Building

