



Addison Rd
Entrance



17225 Dallas Pkwy
TWO ROWS RESTAURANT

	FIRE ALARM PANEL
	FIRE DEPT. CONNECTION
	ELECTRICAL
	GAS SHUTOFF VALVE
	SPRINKLER RISER
	ENTRANCE/EXIT
	KNOX BOX
	FIRE HYDRANT

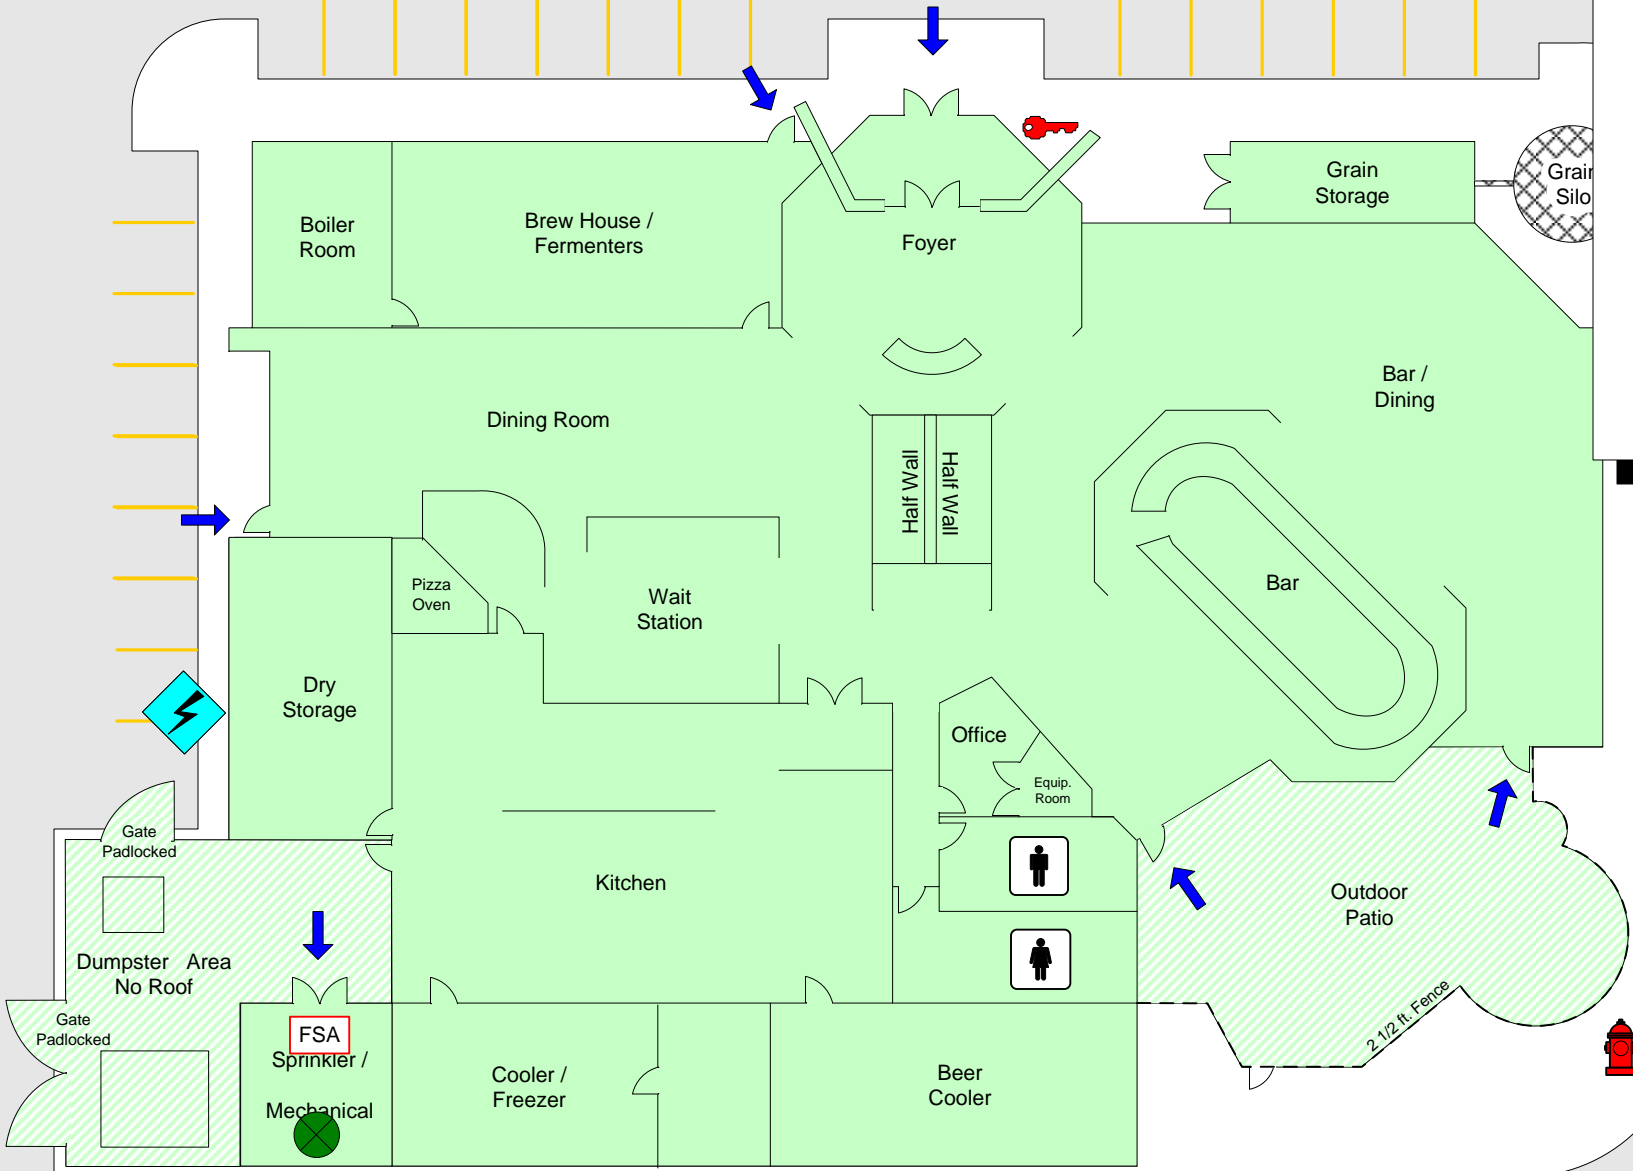

Addison!

FIRE DEPARTMENT
OPERATIONS
DIVISION

DRAWING BY:
RAY YAGER
9/26/03

FDC

Dallas Parkway
Entrance

