


# 14315 Midway Rd Crown Plaza Hotel (Lobby Level)



FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	ENTRANCE/EXIT
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	STANDPIPE CONNECTION	EXIT	HEAT DETECTOR
ELECTRICAL MAIN	ELEVATOR	STAIRS	SMOKE DETECTOR	
GAS SHUTOFF VALVE				

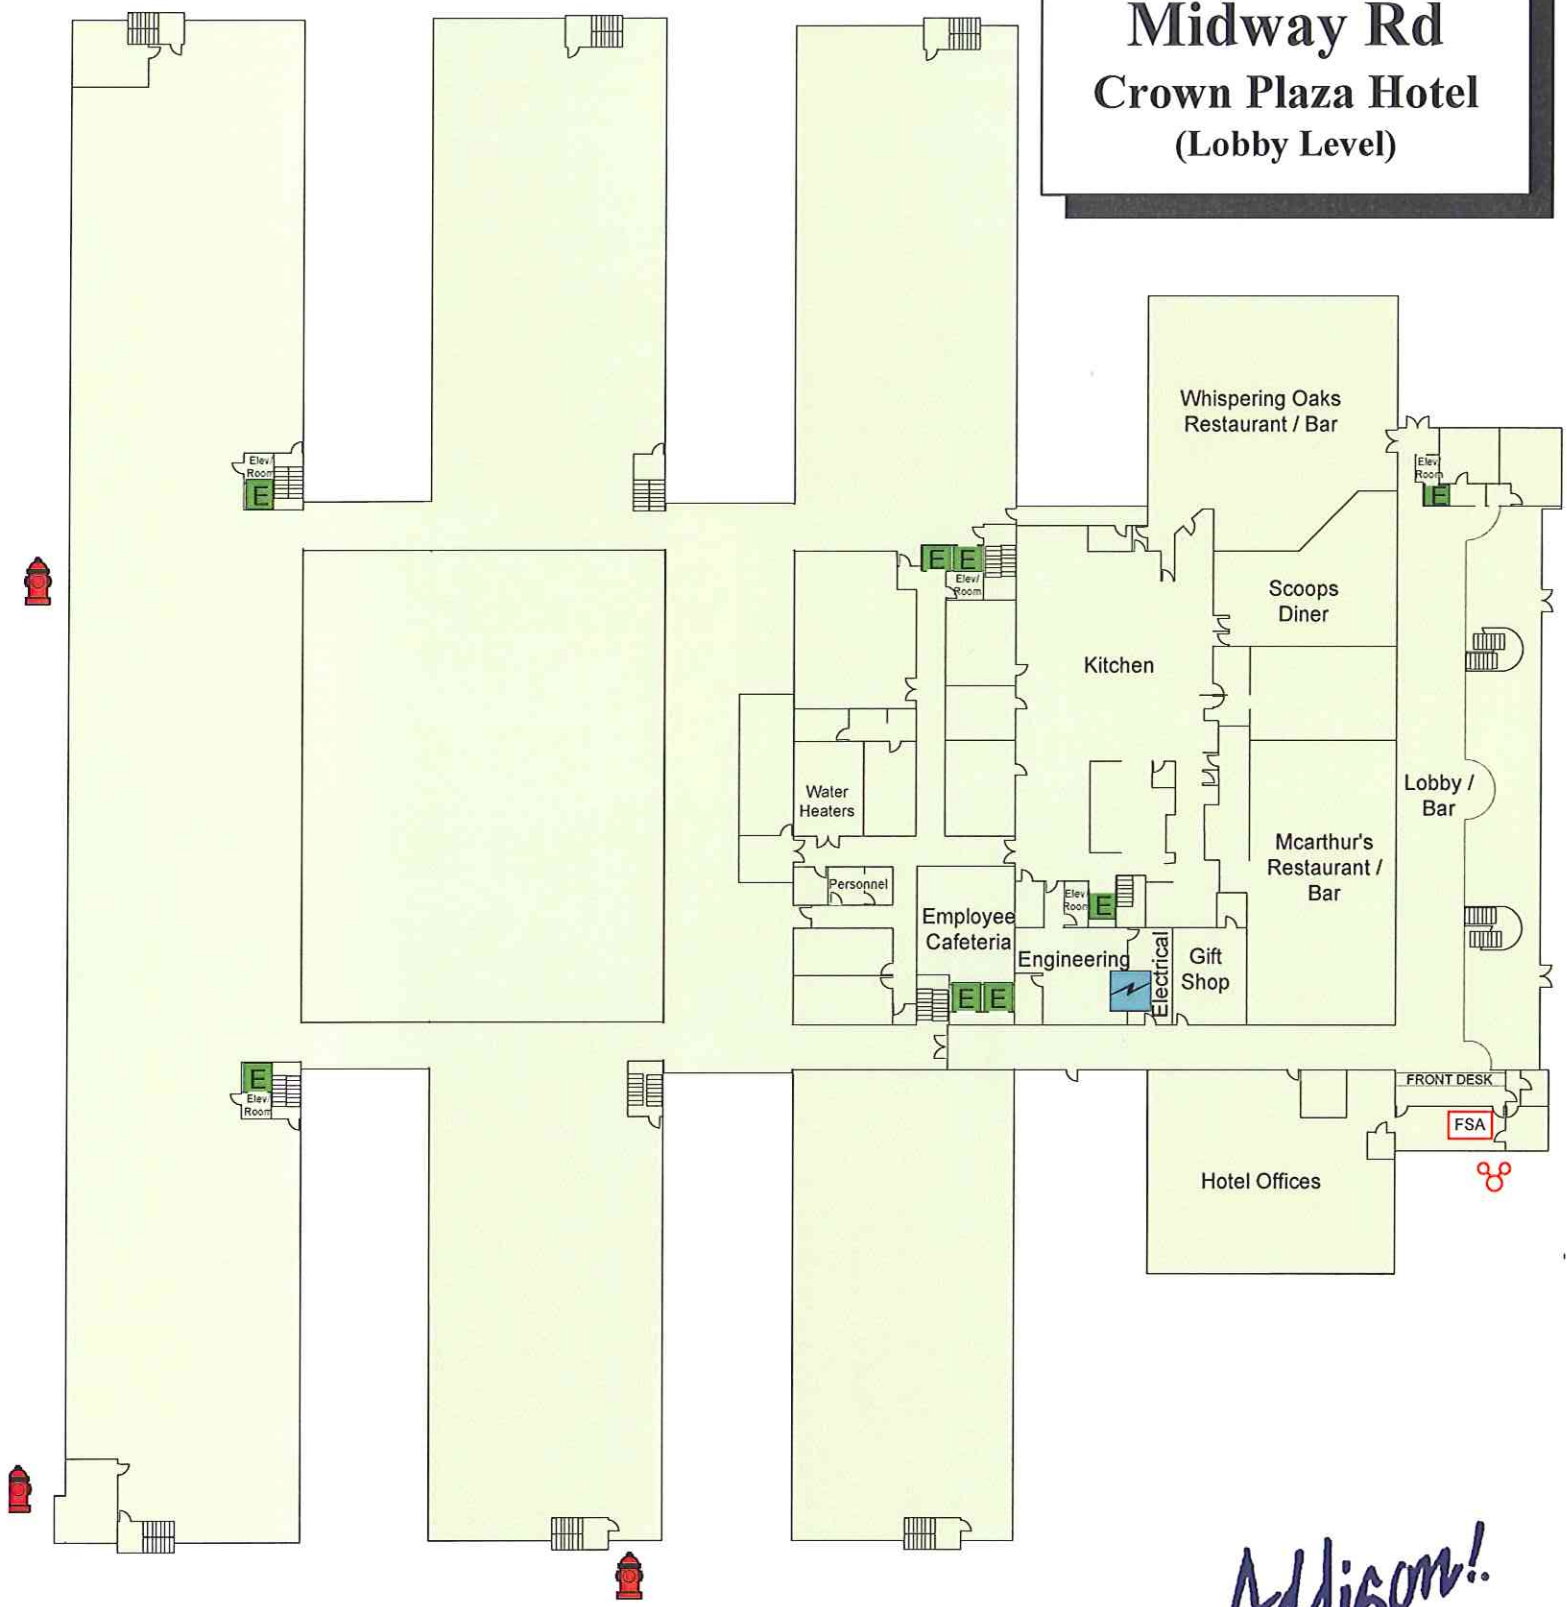

*Addison!*

FIRE DEPARTMENT  
OPERATIONS DIVISION

Drawing by: Ray Yager  
07/31/03