


Iceoplex 15100 Midway

Hydrant located
across Midway & Railroad
Tracks 300 feet North

Hydrant located
across Midway
200 feet south

Midway Road

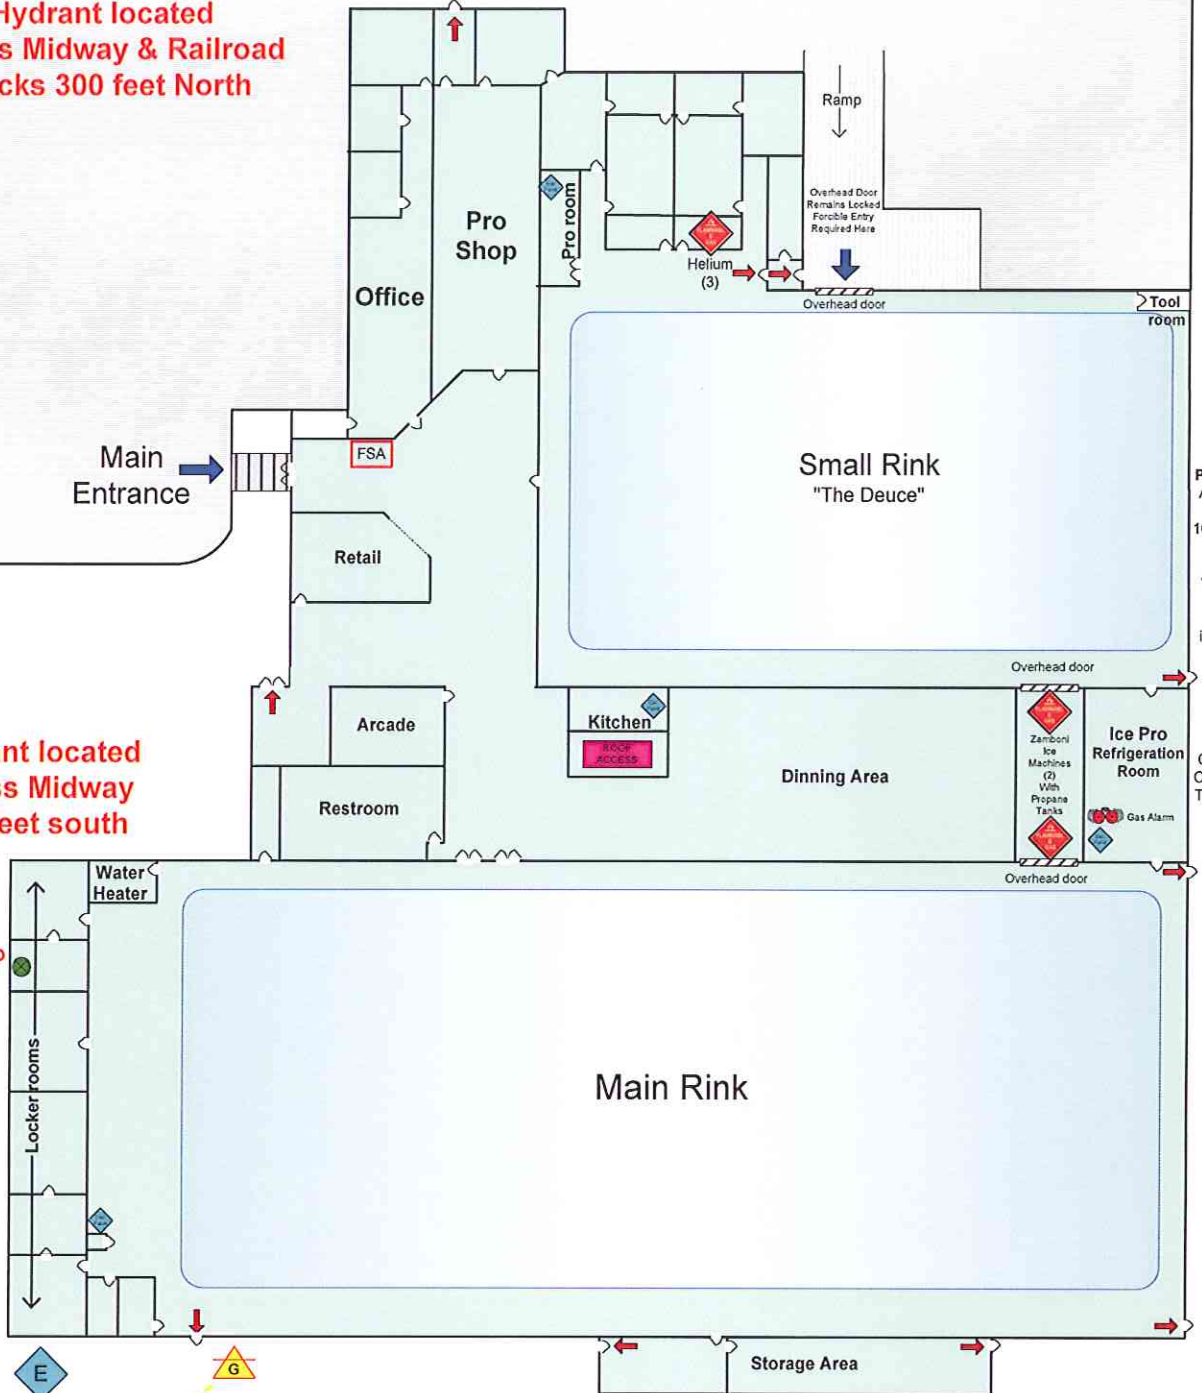

Propane
Approx.
10-20
10 Gallon
Tanks
Stored in locked
Rack

Chiller
Cooling
Towers

N/A	FIRE HYDRANT	Electric Panel	Circuit Breaker Panel	ROOF ACCESS	ROOF ACCESS
FSA	MAIN WATER SHUTOFF	Gas Detector Alarm (Freon)	ENTRANCE	ENTRANCE	ENTRANCE
FIRE DEPT. CONNECTION	OS&Y Valve	FLAMMABLE GAS	EXIT	EXIT	EXIT
SPRINKLER RISER	ELECTRICAL MAIN	GAS SHUTOFF VALVE			

Addison!
FIRE DEPARTMENT
OPERATIONS DIVISION
DRAWING BY:
RAY YAGER

03/21/00

