


Goodman Ave

4940
GOODMAN AVE.
Floor 2

4960
GOODMAN AVE.
Floor 2

4980
GOODMAN AVE.
Floor 2

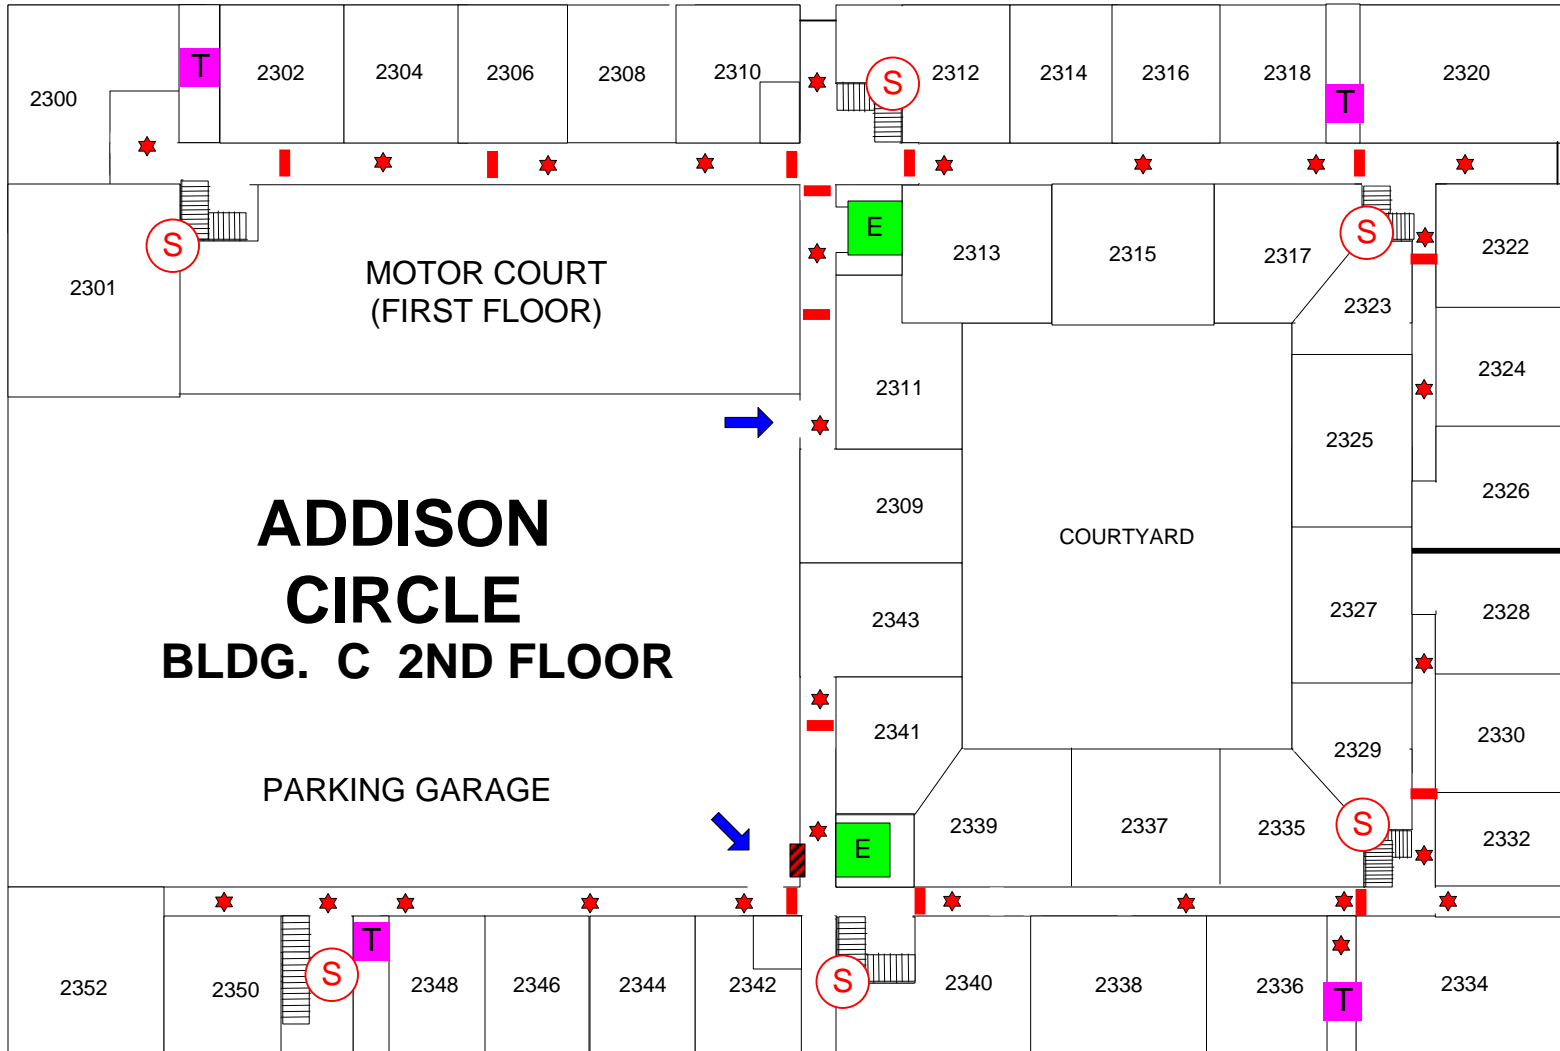

15735
QUORUM
DR.

15735
QUORUM
DR.

15705
QUORUM
DR.

4945
MORRIS AVE.

4975
MORRIS AVE.

FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	TRASH CHUTE	ELECTRONIC GATE	HEAT ACTIVATED FIRE DOOR
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	STANDPIPE CONNECTION	SPRINKLER ISOLATION VALVE	FIRE DOOR	MAIN SPRINKLER SHUTOFF	
KNOX SWITCH	ELECTRICAL MAIN	ELEVATOR	HEAT DETECTOR	ENTRANCE / EXIT		
KNOX BOX	GAS SHUTOFF VALVE	STAIRS	SMOKE DETECTOR	PARKING ENTRANCE / EXIT		

Addison!
FIRE DEPARTMENT
OPERATIONS DIVISION
DRAWING BY:
RAY YAGER

