

GOODMAN AVE.

4940
GOODMAN AVE.


GOODMAN AVE.

BLDG. FDC

ALARM PANEL & SPRINKLER RISER

4960
GOODMAN AVE.

4980
GOODMAN AVE.

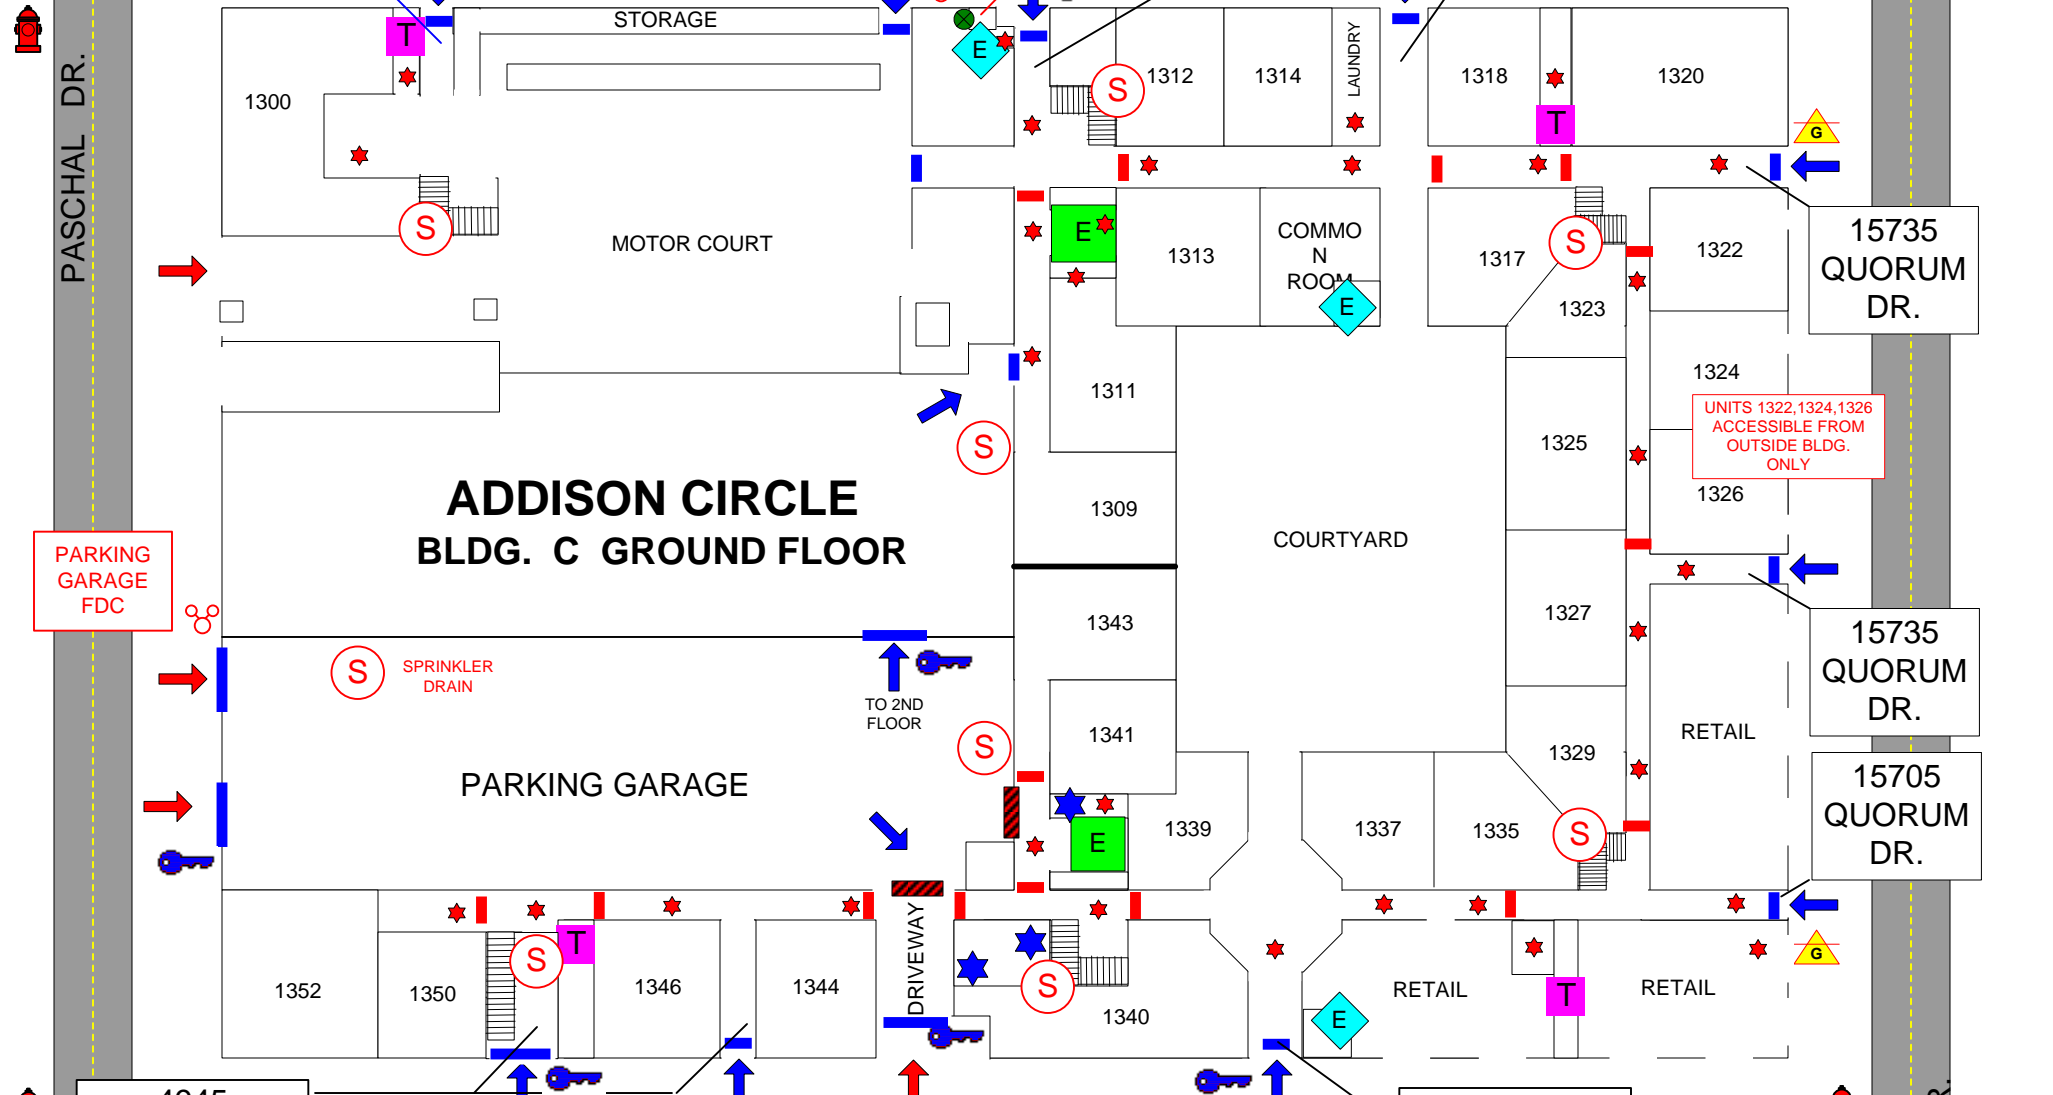

**ADDISON CIRCLE
BLDG. C GROUND FLOOR**

UNITS 1322, 1324, 1326
ACCESSIBLE FROM
OUTSIDE BLDG.
ONLY

PARKING GARAGE
FDC

(S) SPRINKLER DRAIN

TO 2ND FLOOR

4945
MORRIS AVE.

4975
MORRIS AVE.

MORRIS AVE

FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	TRASH CHUTE	ELECTRONIC GATE	HEAT ACTIVATED FIRE DOOR
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	STANDPIPE CONNECTION	SPRINKLER ISOLATION VALVE	FIRE DOOR	MAIN SPRINKLER SHUTOFF
KNOX SWITCH	ELECTRICAL MAIN	ELEVATOR	ELEVATOR	HEAT DETECTOR	ENTRANCE / EXIT
KNOX BOX	GAS SHUTOFF VALVE	STAIRS	SMOKE DETECTOR	PARKING ENTRANCE / EXIT	

Addison!
FIRE DEPARTMENT
OPERATIONS DIVISION
DRAWING BY:
RAY YAGER

↑
N

QUORUM DR.