15530 Lewis Place
Level 4

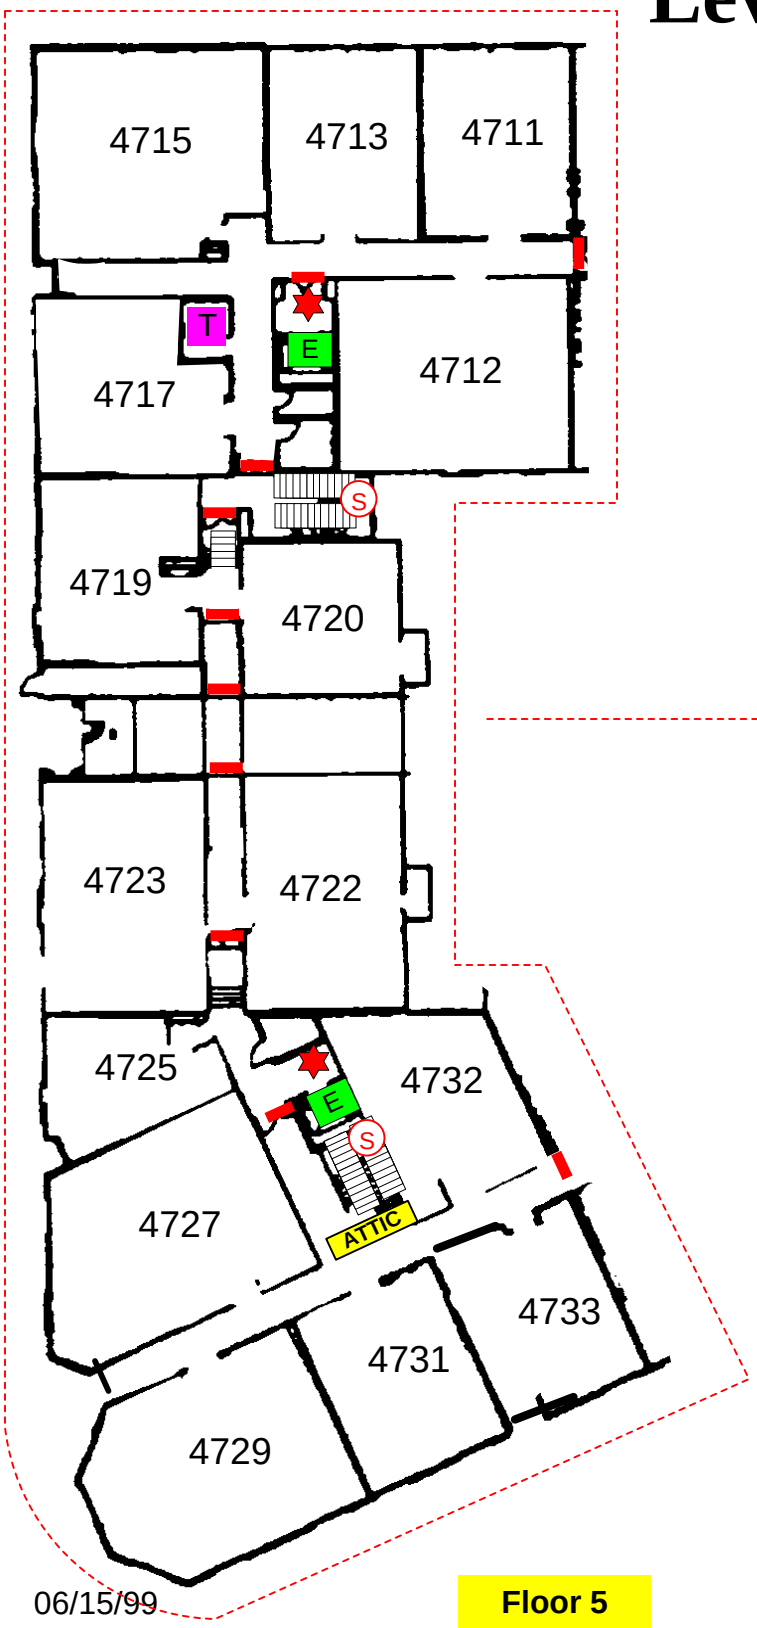

06/15/99

Floor 5

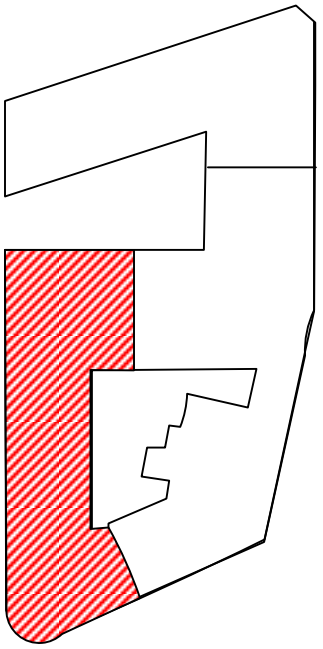

Addison Circle
P - Block

FSA FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	T TRASH CHUTE	ELECTRONIC GATE	HEAT ACTIVATED FIRE DOOR
FIRE DEPT. CONNECTION	W MAIN WATER SHUTOFF	S STANDPIPE CONNECTION	SPRINKLER ISOLATION VALVE	FIRE DOOR	MAIN SPRINKLER SHUTOFF
KNOX SWITCH	E ELECTRICAL MAIN	ELEVATOR E	HEAT DETECTOR	ENTRANCE / EXIT	
KNOX BOX	G GAS SHUTOFF VALVE	STAIRS	SMOKE DETECTOR	PARKING ENTRANCE /EXIT	

N

Addison!
FIRE DEPARTMENT
OPERATIONS DIVISION ©

DRAWING BY:
RAY YAGER