



15530 Lewis Place

Level 5

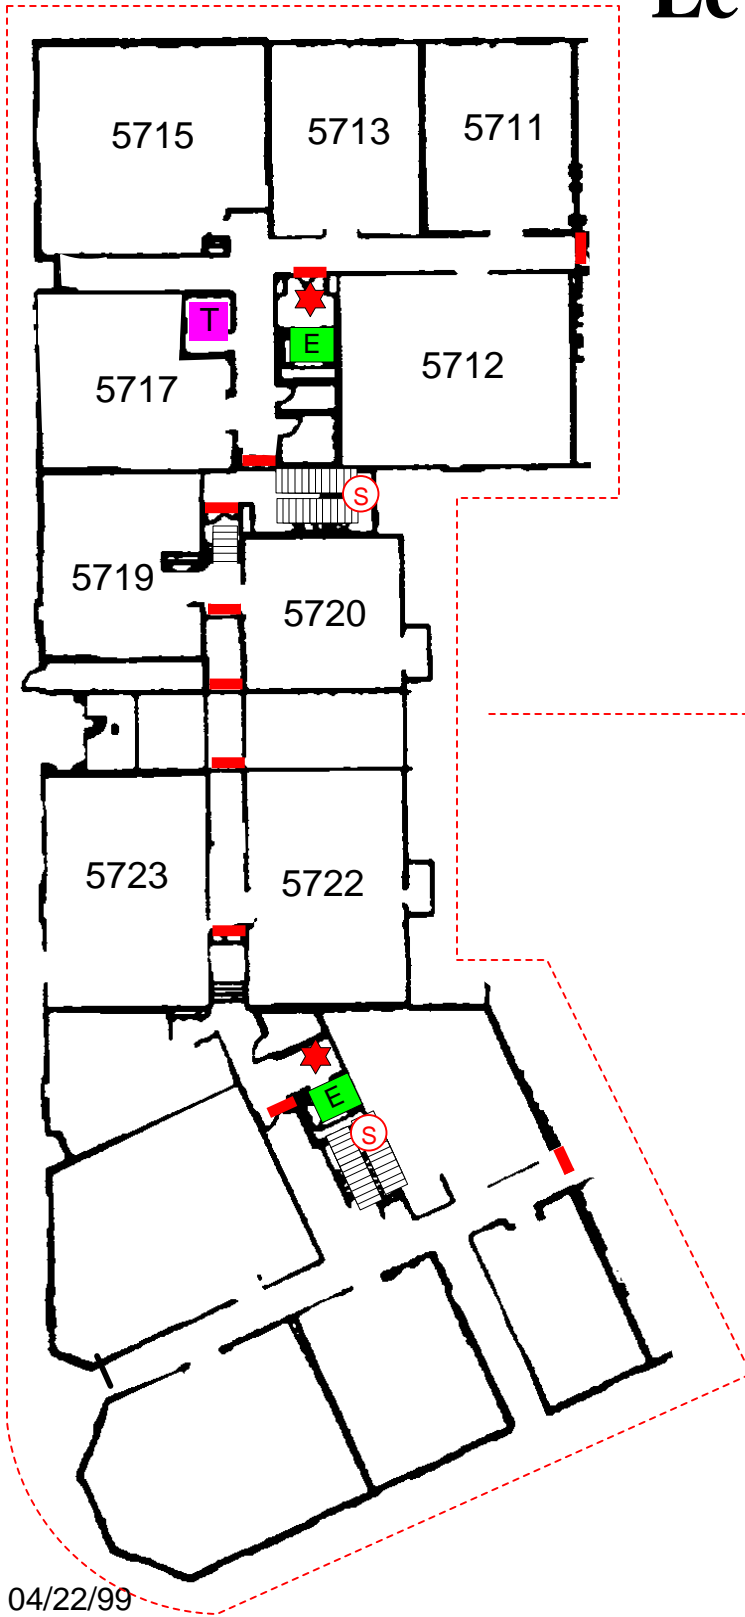

Addison Circle
P - Block

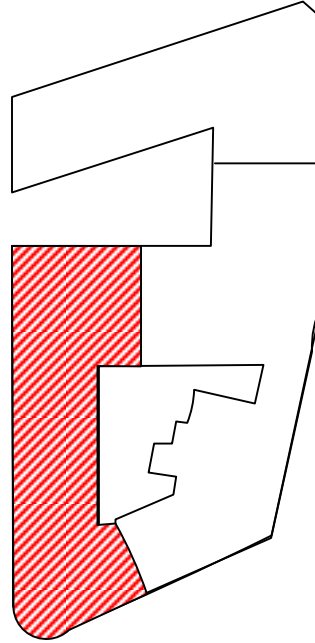

04/22/99

| | | | | | |
|-----------------------|--------------------|----------------------|---------------------------|-------------------------|--------------------------|
| FIRE ALARM PANEL | SPRINKLER RISER | FIRE HYDRANT | TRASH CHUTE | ELECTRONIC GATE | HEAT ACTIVATED FIRE DOOR |
| FIRE DEPT. CONNECTION | MAIN WATER SHUTOFF | STANDPIPE CONNECTION | SPRINKLER ISOLATION VALVE | FIRE DOOR | MAIN SPRINKLER SHUTOFF |
| KNOX SWITCH | ELECTRICAL MAIN | ELEVATOR | ELEVATOR | ENTRANCE / EXIT | |
| KNOX BOX | GAS SHUTOFF VALVE | STAIRS | SMOKE DETECTOR | PARKING ENTRANCE / EXIT | |

