


14315 Midway Rd Crown Plaza Hotel (Level 2)



FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	ENTRANCE/EXIT
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	STANDPIPE CONNECTION	EXIT	
ELECTRICAL MAIN	ELEVATOR	HEAT DETECTOR		
GAS SHUTOFF VALVE	STAIRS	SMOKE DETECTOR		

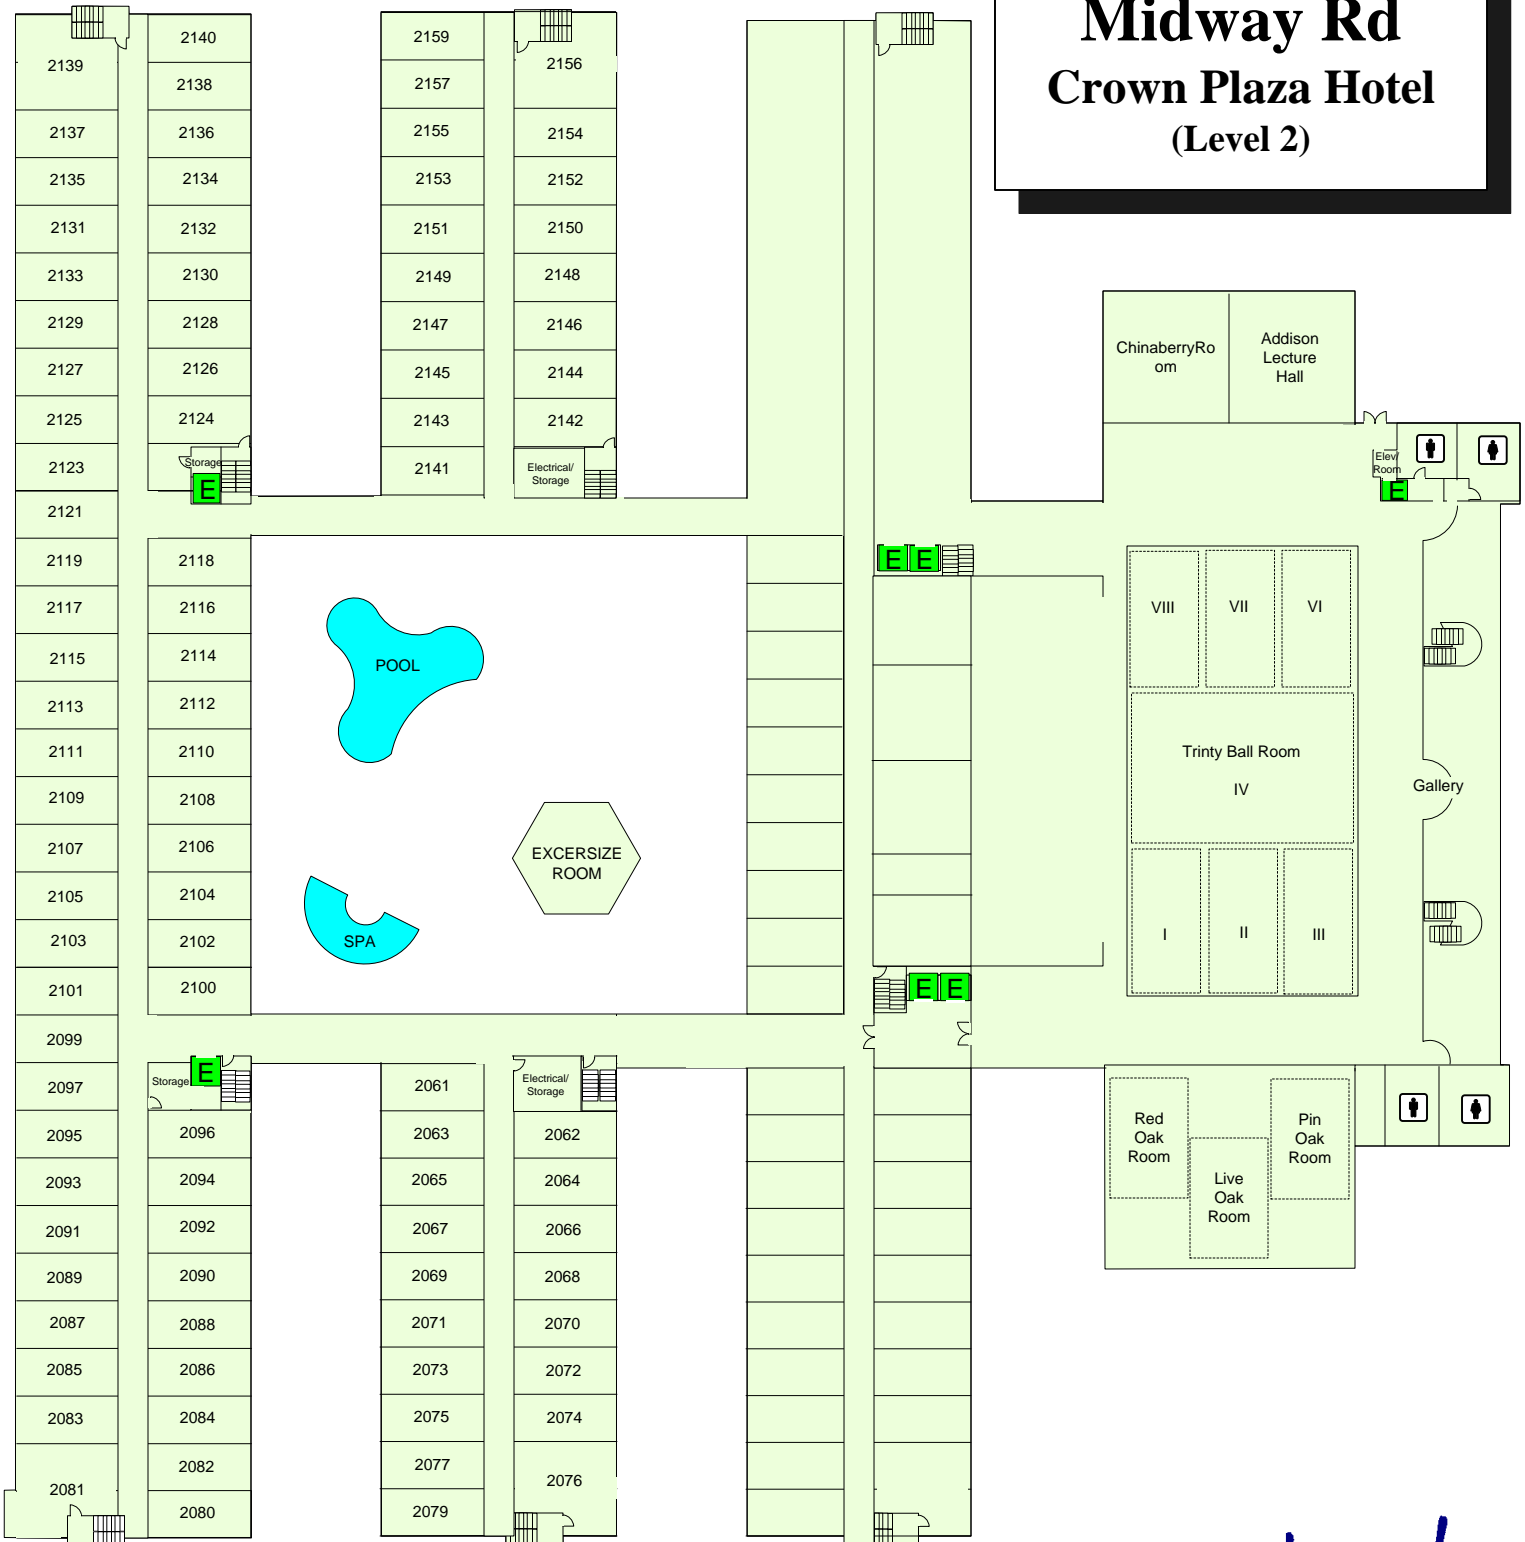

Addison!

FIRE DEPARTMENT
OPERATIONS DIVISION

Drawing by: Ray Yager
07/31/03