
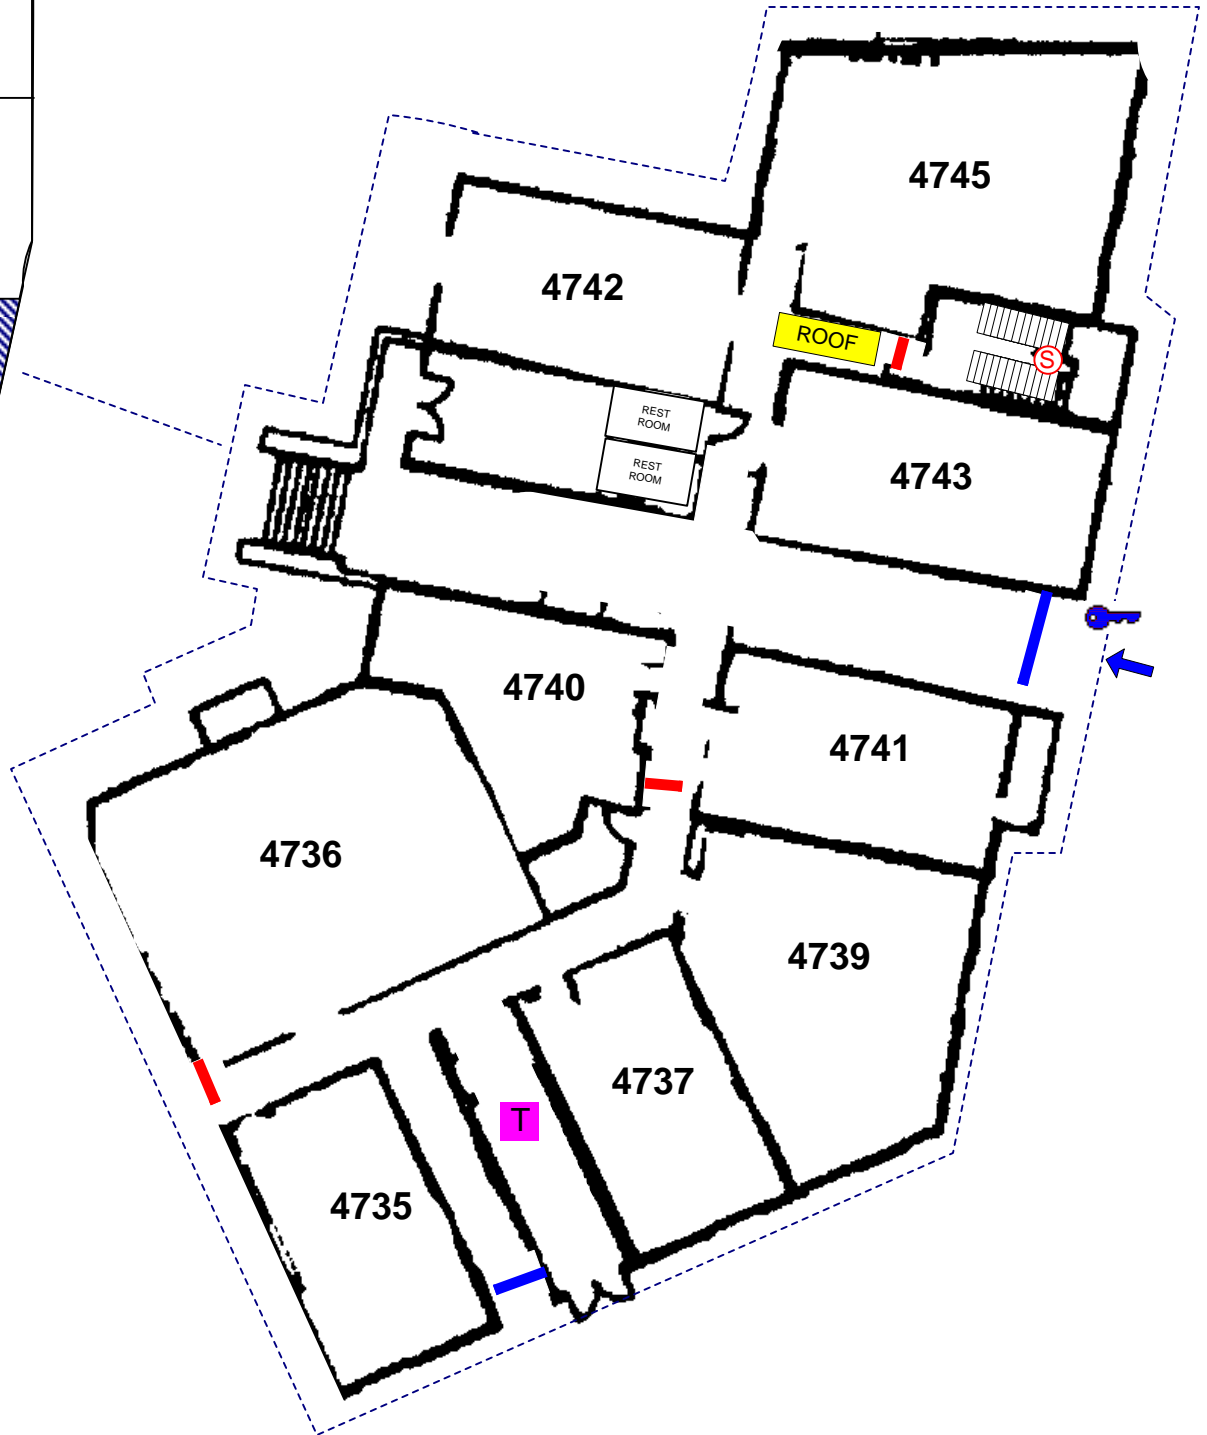


15525 Spectrum Level 4

Addison Circle
P - Block

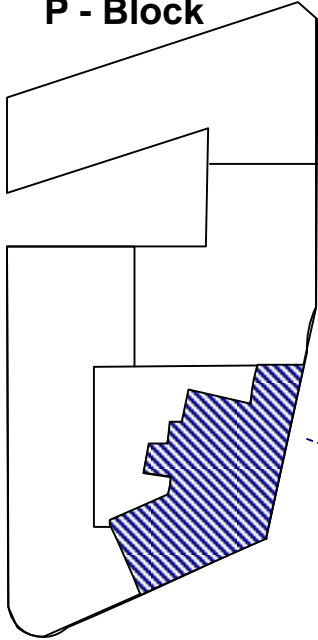

06/15/99

FSA	FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT	TRASH CHUTE	ELECTRONIC GATE	HEAT ACTIVATED FIRE DOOR
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	STANDPIPE CONNECTION	SPRINKLER ISOLATION VALVE	ELEVATOR	HEAT DETECTOR	MAIN SPRINKLER SHUTOFF
KNOX SWITCH	ELECTRICAL MAIN	STAIRS	SMOKE DETECTOR	ENTRANCE / EXIT	PARKING ENTRANCE / EXIT	
KNOX BOX	GAS SHUTOFF VALVE					



Addison!
FIRE DEPARTMENT
OPERATIONS DIVISION
DRAWING BY:
RAY YAGER