


Hydrant
300 ft.

Hydrant
100 ft.

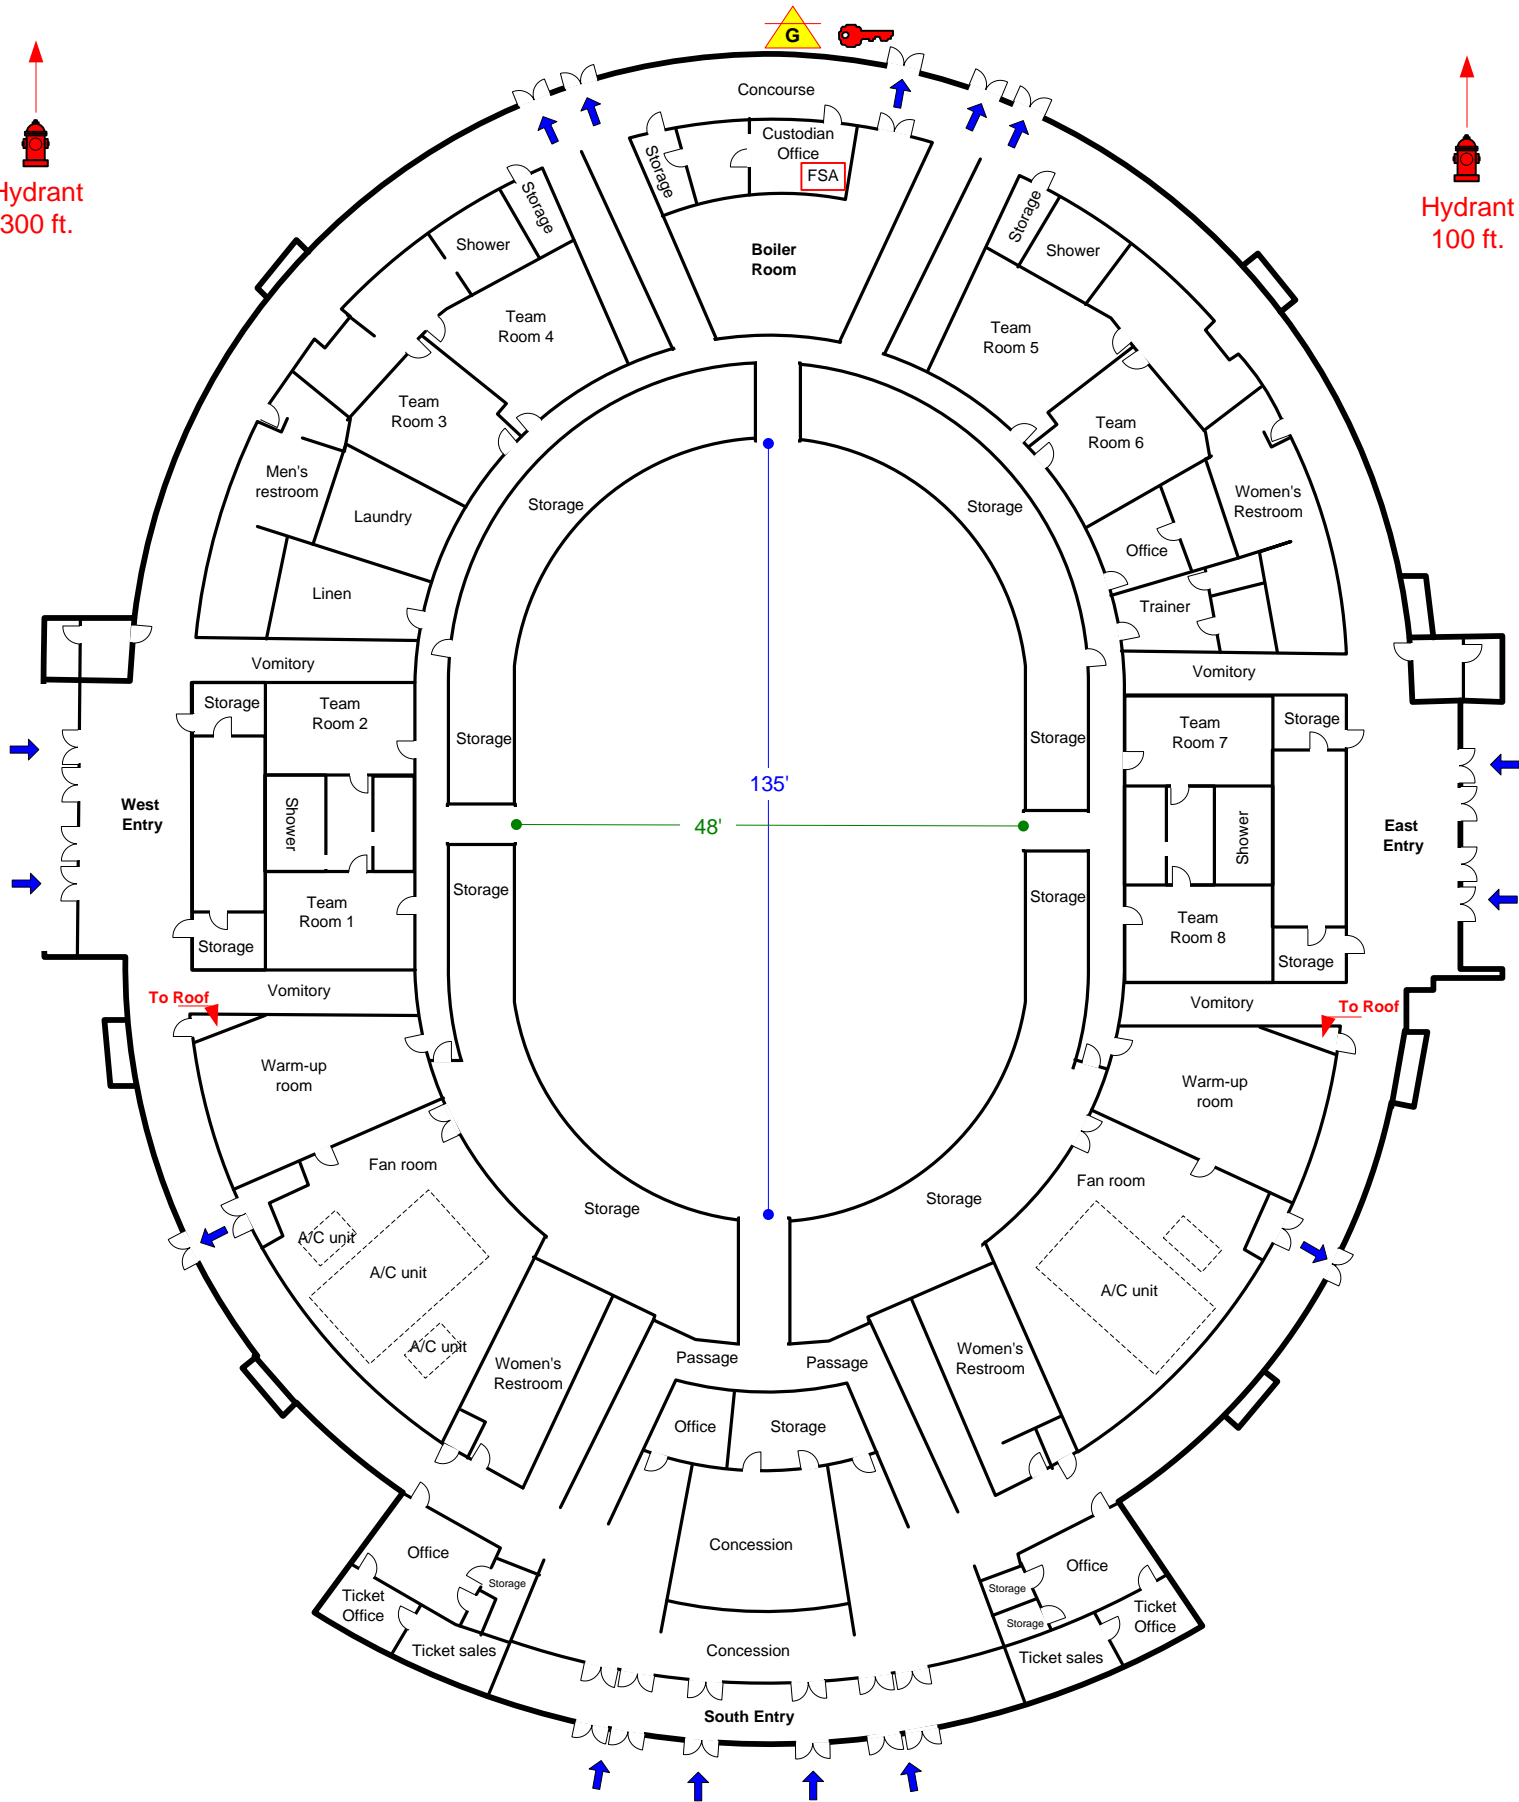

FIRE ALARM PANEL	SPRINKLER RISER	FIRE HYDRANT
FIRE DEPT. CONNECTION	MAIN WATER SHUTOFF	ELEVATOR
ENTRANCE / EXIT	ELECTRICAL MAIN	STAIRS
KNOX BOX	GAS SHUTOFF VALVE	STANDPIPE CONNECTION

3815 Spring Valley Rd
A. J. Loos Fieldhouse
 (Ground Level)