




**06 VENTILATION - INTAKE DETAIL**  
 M1-1 N.T.S.

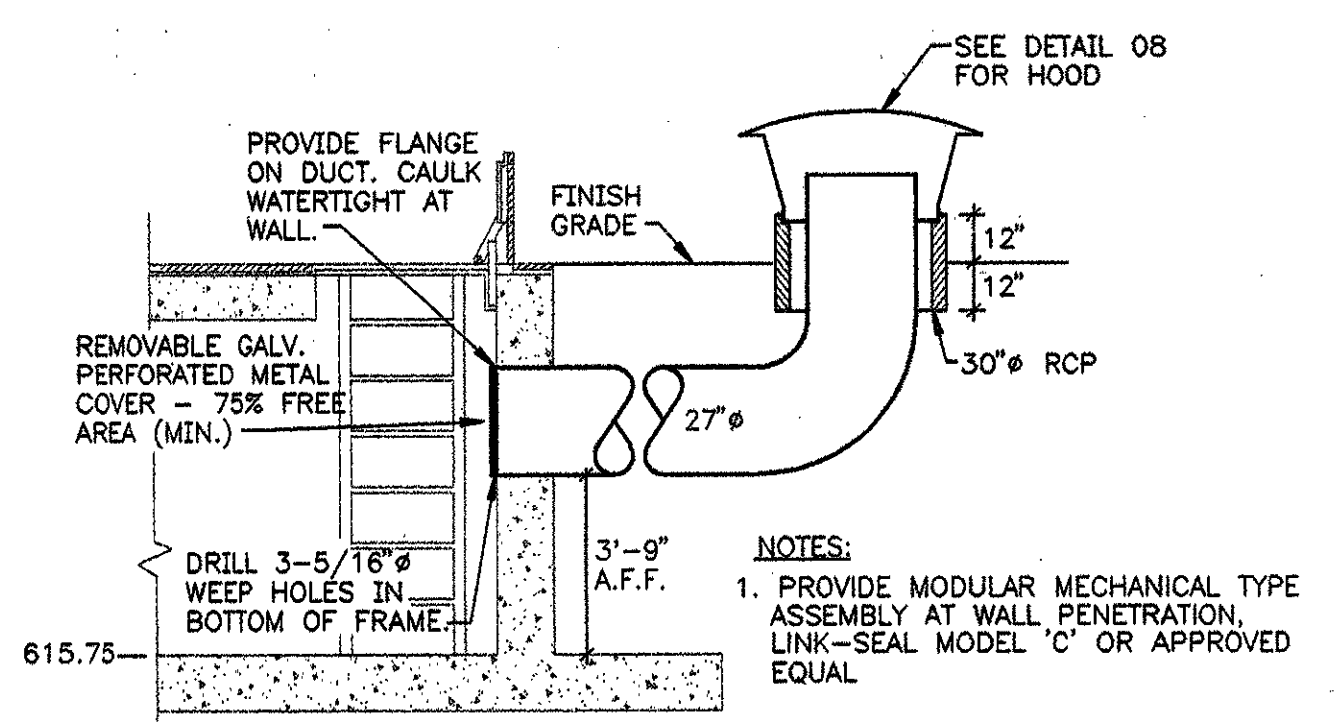


**03 EXHAUST FAN MOUNTING DETAIL - EF 1A/B**  
 M1-1 N.T.S.

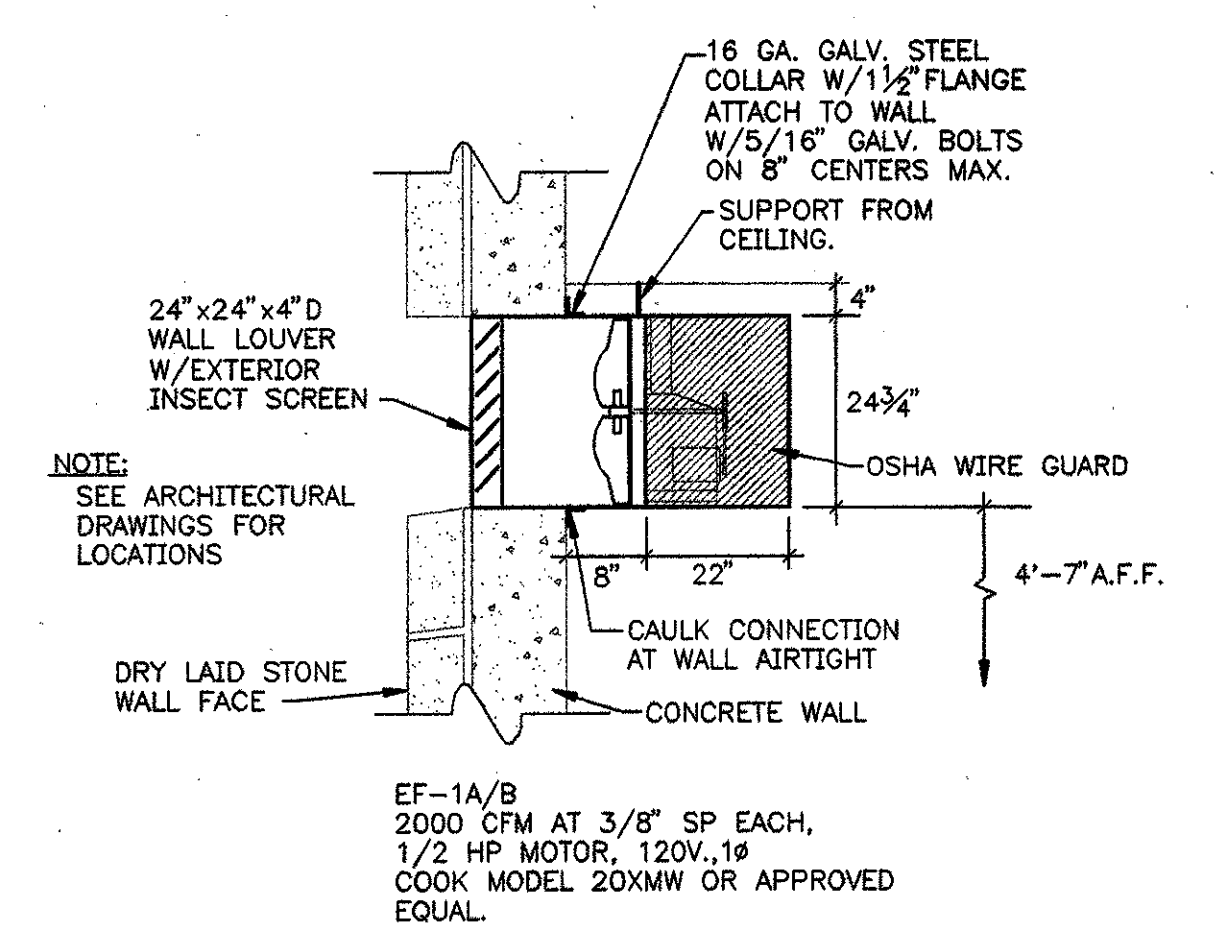


**07 VENTILATION - EXHAUST DETAIL**  
 M1-1 N.T.S.

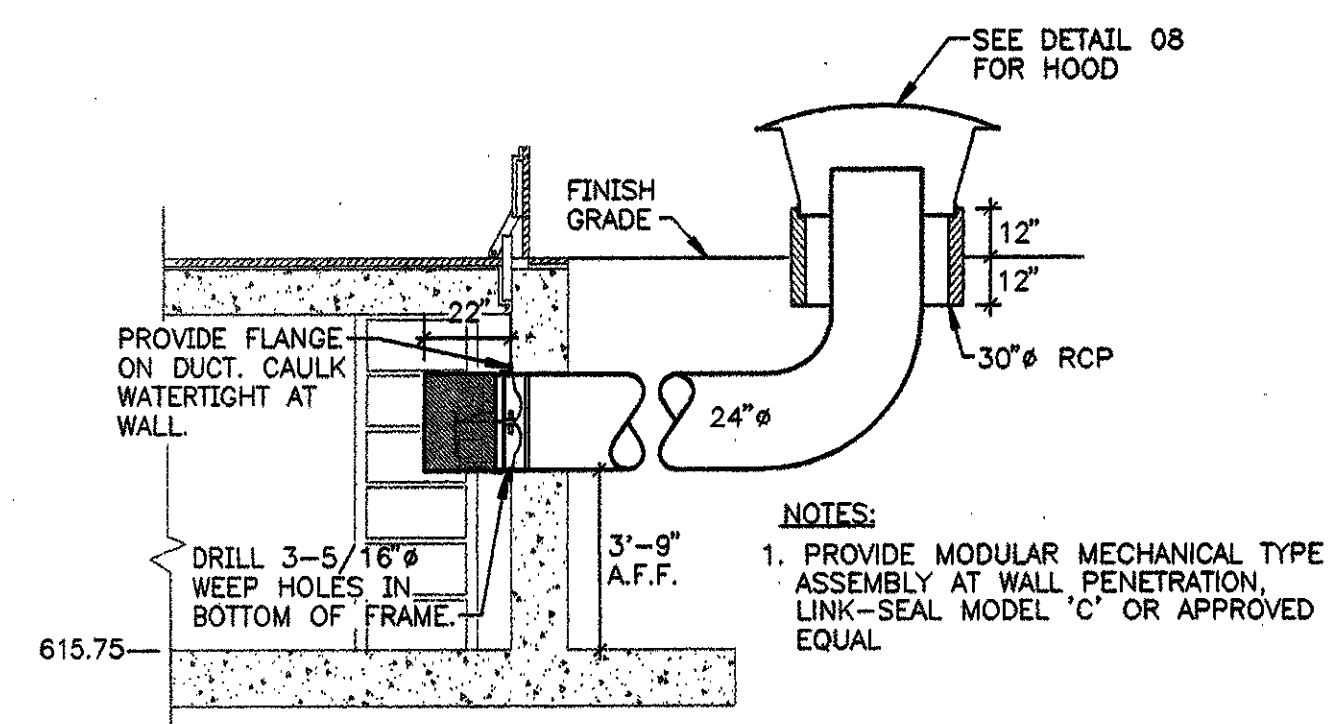


**04 DUPLEX SUMP PUMP DETAIL - SP-1A/B**  
 M1-1 N.T.S.

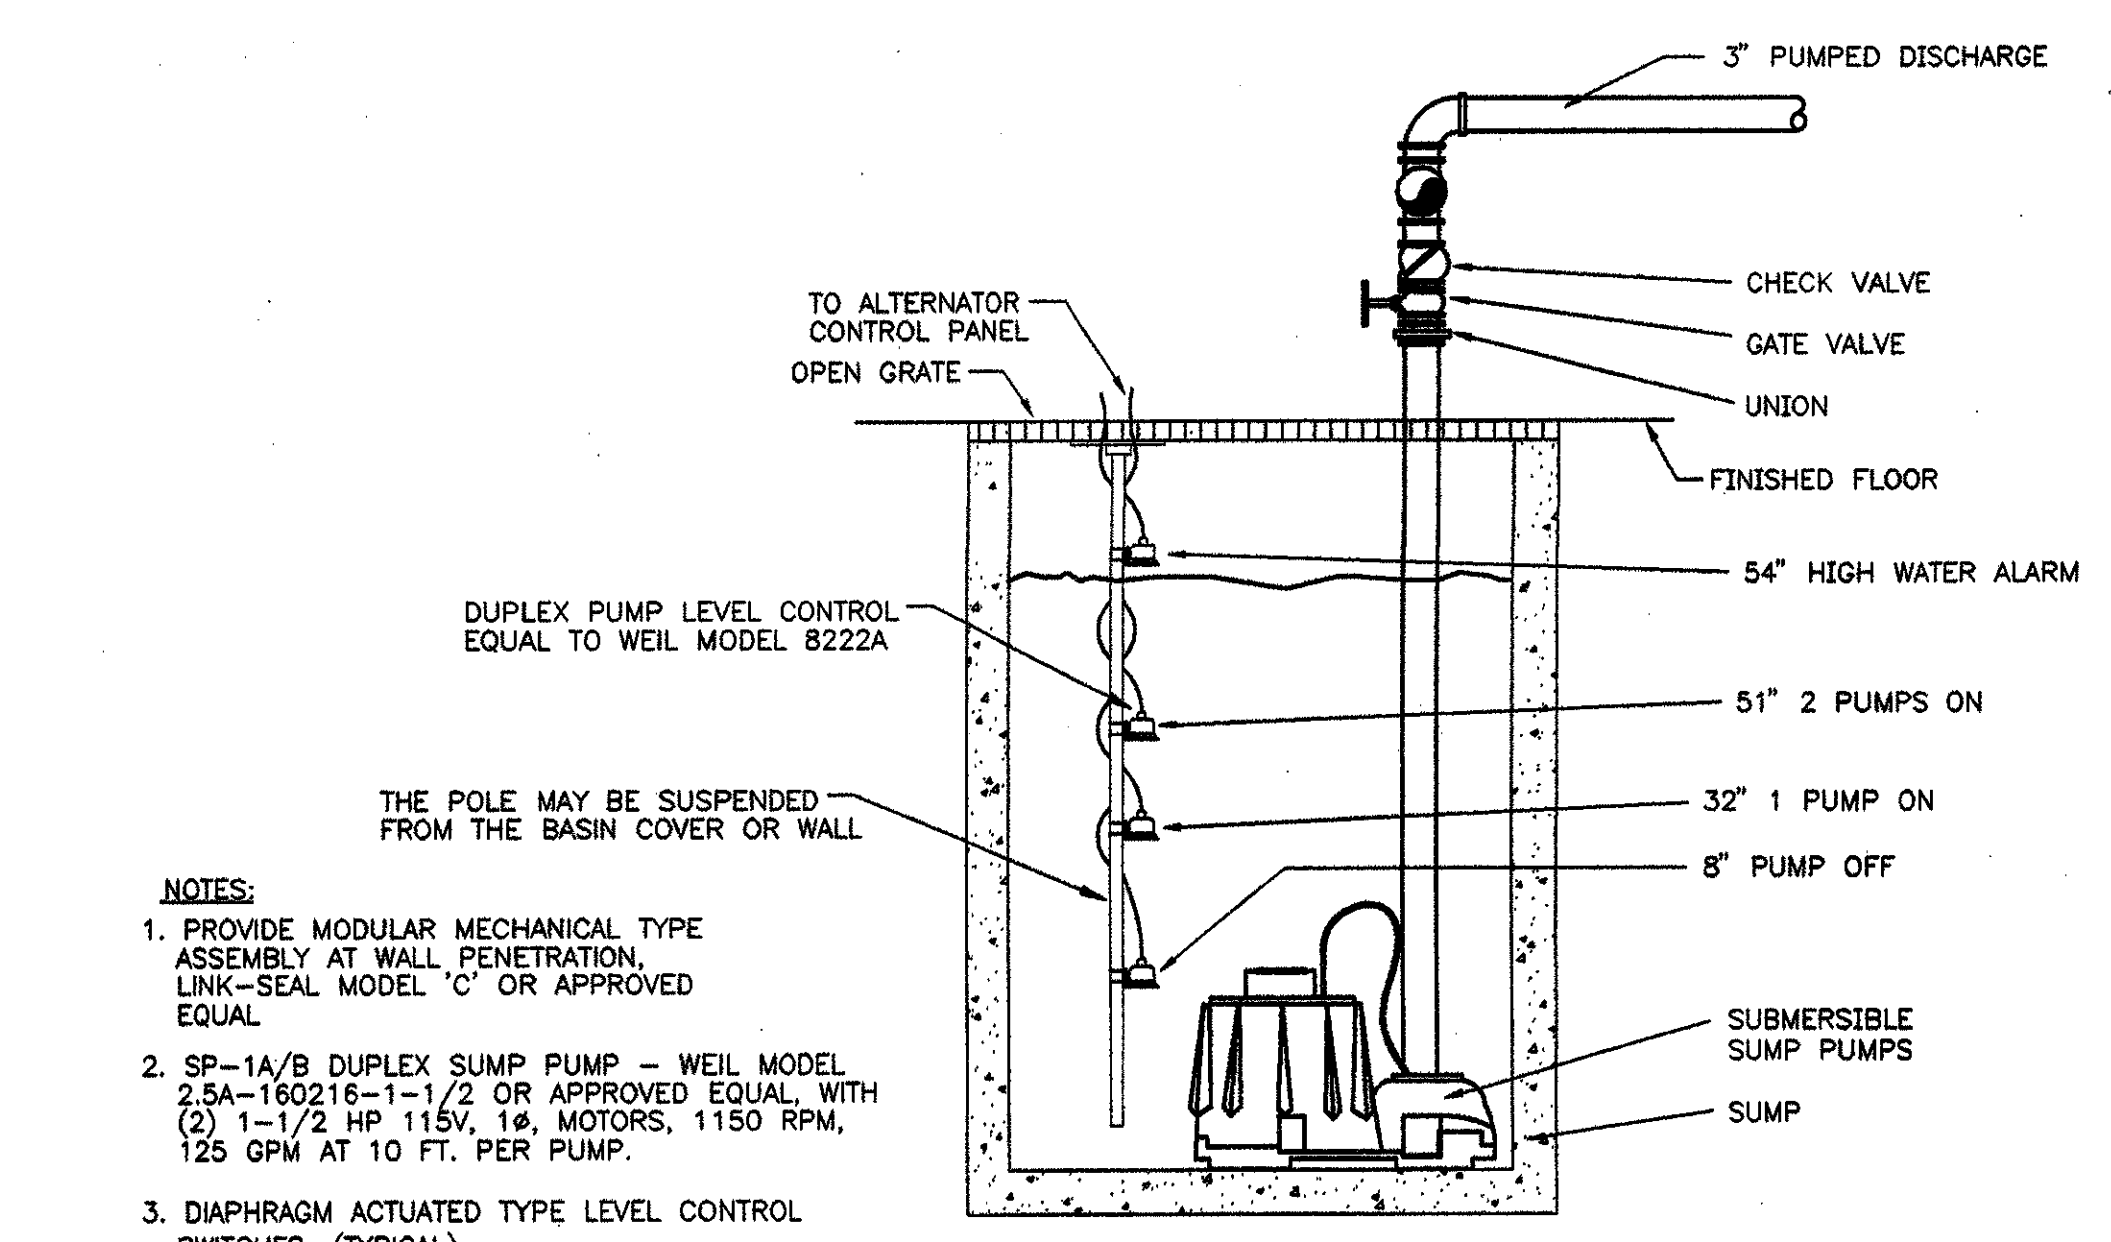

**08 VENTILATION - HOOD DETAIL**  
 M1-1 N.T.S.

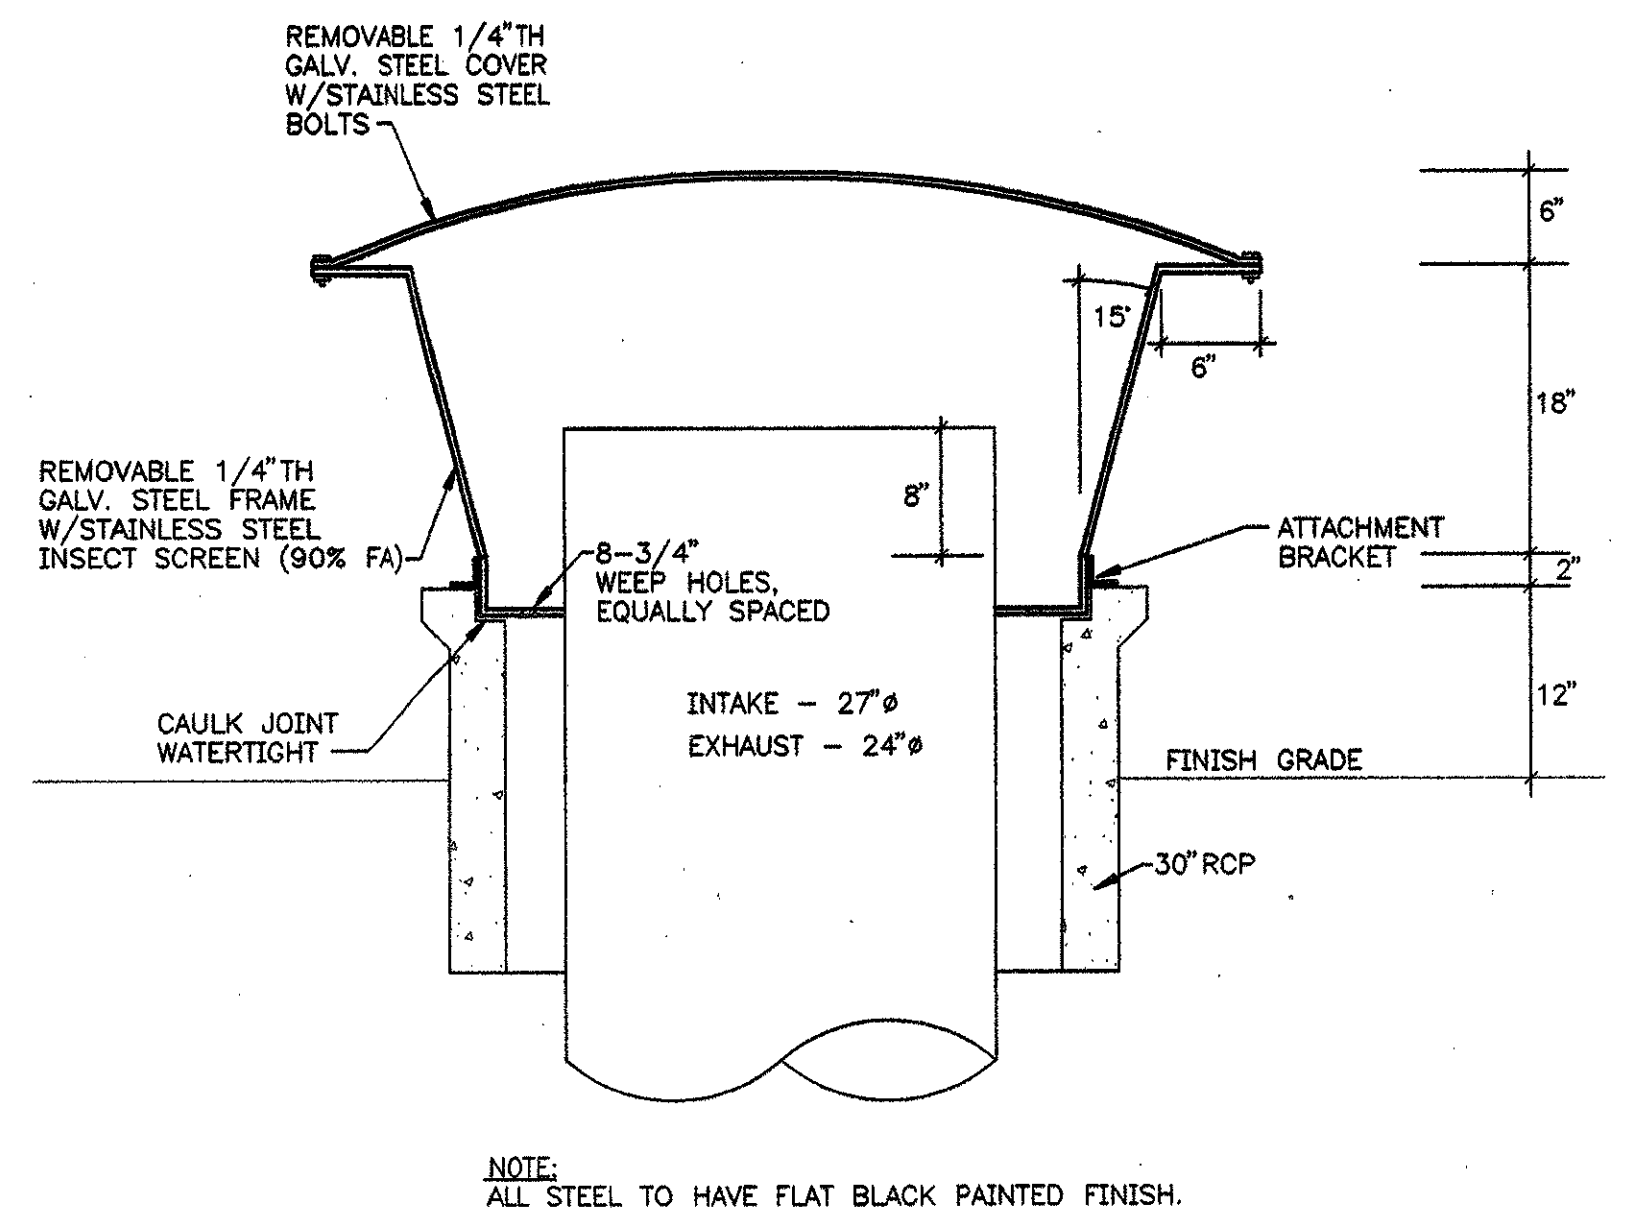

**05 SIMPLEX SUMP PUMP DETAIL - SP-2**  
 M1-1 N.T.S.

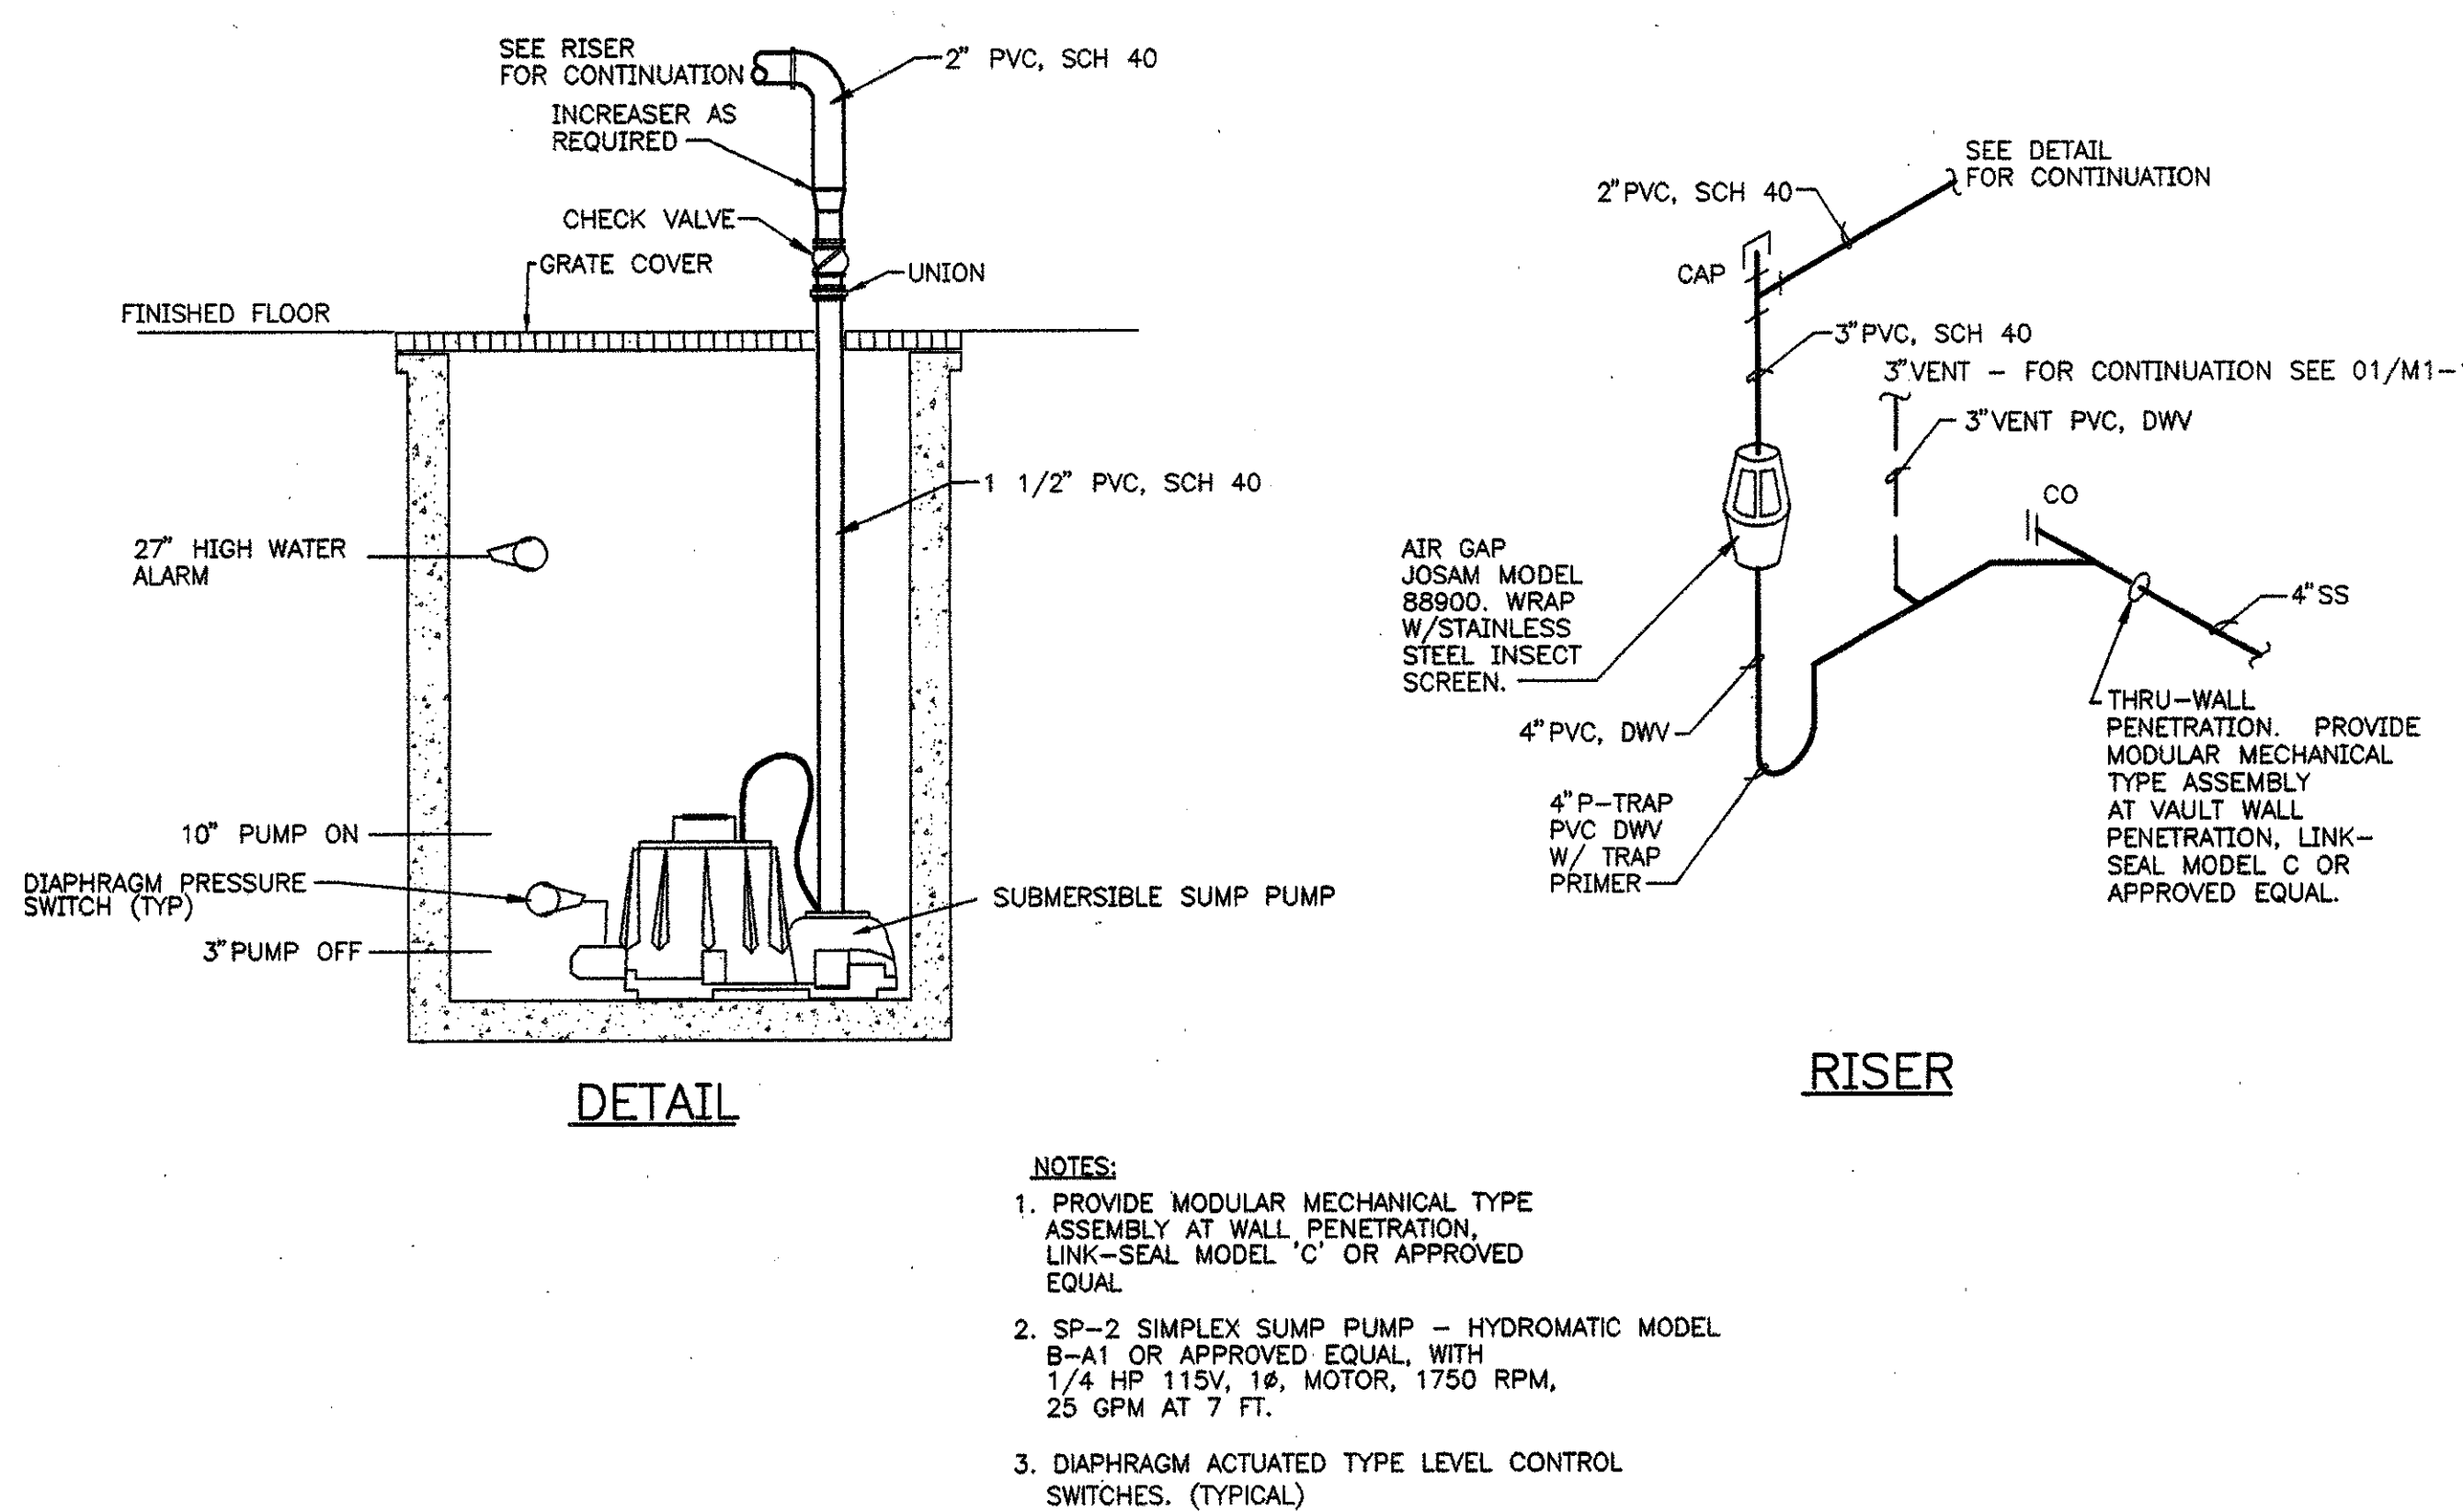


TO EF-2 - 2-STAGE THERMOSTAT  
 STAGE 1-OPERATES EF-2 AT LOW SPEED AT 91F (FIELD ADJUSTABLE)  
 STOPS AT 88.5F.  
 STAGE 2-OPERATES EF-2 AT HIGH SPEED AT 100F (FIELD ADJUSTABLE)  
 STOPS AT 96.5F.  
 HONEYWELL MODEL T631B OR APPROVED EQUAL MOUNT THERMOSTAT ON 3/4" MARINE PLYWOOD. COORDINATE LOCATION.

ELECTRONIC TRAP PRIMER PANEL  
 PRECISION PLUMBING PRODUCTS  
 MODEL - MPB-500-115V W/NEMA 1 ENCLOSURE OR APPROVED EQUAL. PROVIDE W/ SO CORD AND PLUG AND CONNECT TO NEAREST 115V RECEPTACLE.

**NOTES BY SYMBOL "O"**

- 1 EF-2 VAULT VENTILATION FAN, 2800 CFM AT 3/8" S.P., 1/2 HP, 2 SPEED MOTOR, 120V., 19, WITH OSHA WIRE GUARD. COOK MODEL #20XMM OR APPROVED EQUAL.
- 2 SP-2 SIMPLEX SUMP PUMP.
- 3 UH-1 ELECTRIC HEATER, BRASCH MODEL BTUH 2.2-2081 OR APPROVED EQUAL, 2.2KW AT 208/1 PHASE, W/ BUILT-IN THERMOSTAT SET FOR 45F (FIELD ADJUSTABLE).



**01 FOUNTAIN EQUIPMENT VAULT - MECHANICAL**  
 M1-1 1/8" = 1'-0"

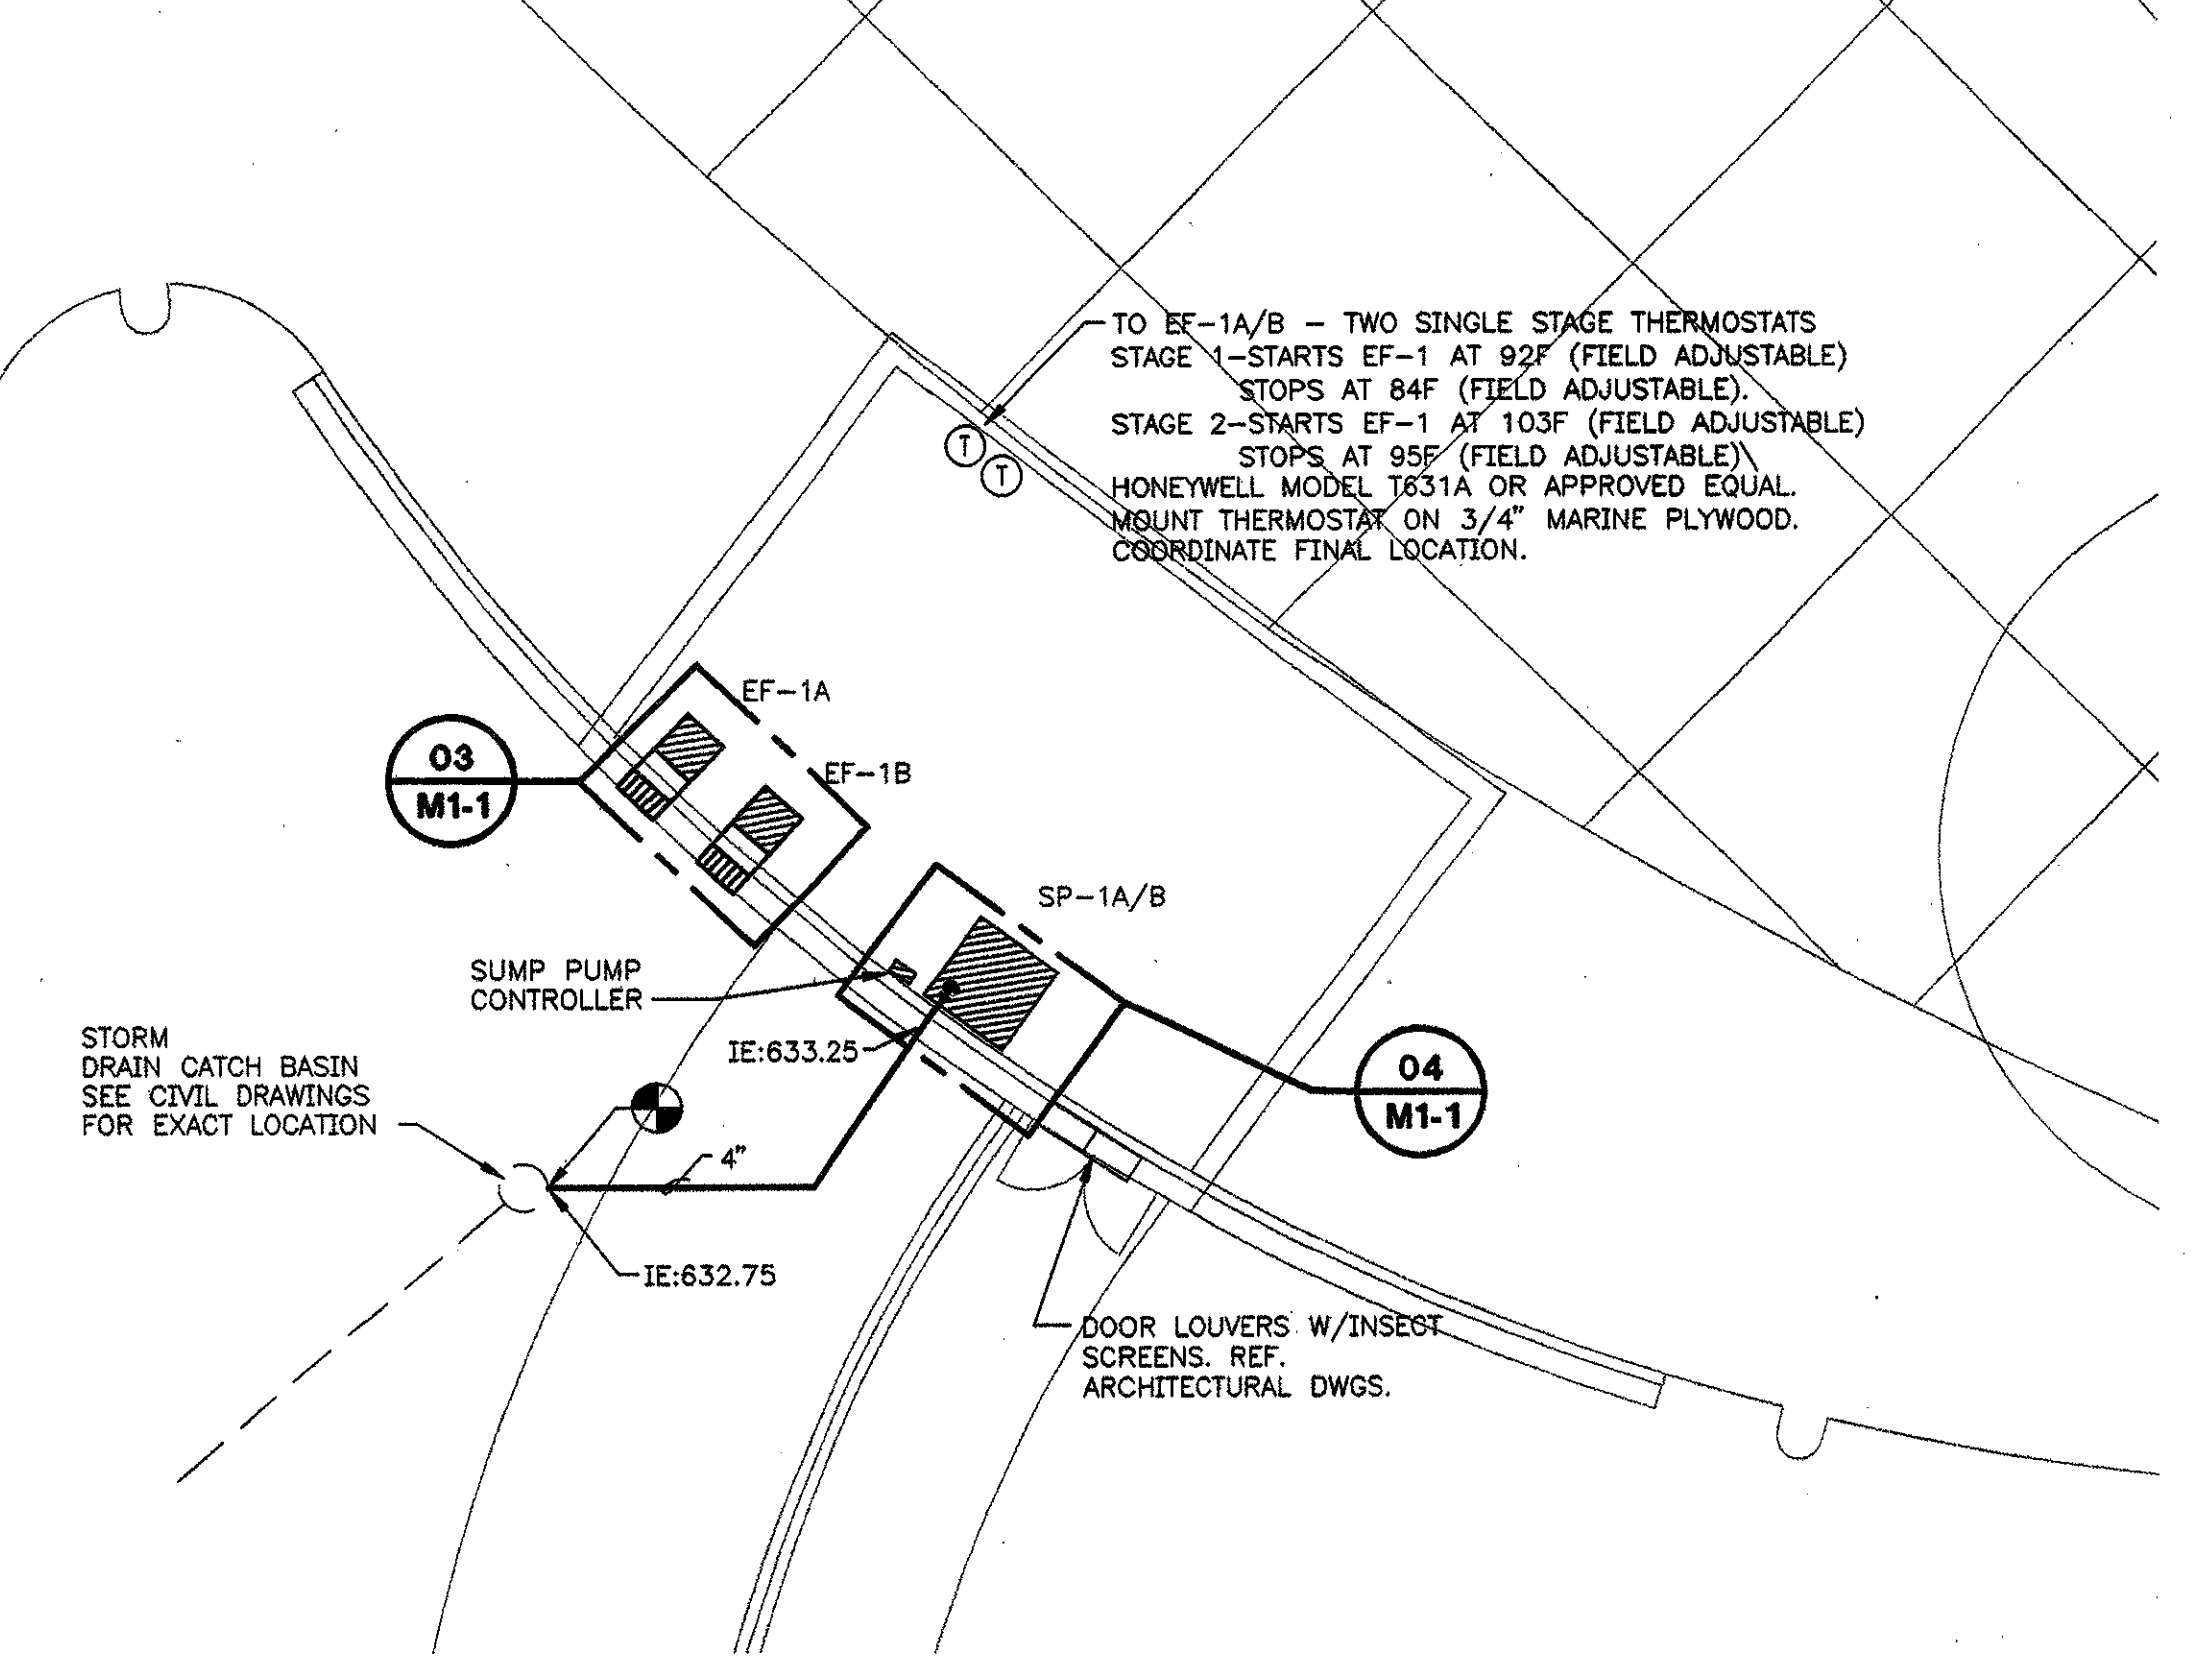

**02 ELECTRICAL ROOM AT MAIN STAGE - MECHANICAL**  
 M1-1 1/8" = 1'-0"

|                         |             |      |
|-------------------------|-------------|------|
| ADDENDUM #2             | 10-21-02    |      |
| ISSUED FOR CONSTRUCTION | 09-30-02    |      |
| No.                     | Description | Date |

|                              |  |
|------------------------------|--|
| DWG ISSUE & REVISION HISTORY |  |
| Stamp                        |  |
|                              |  |

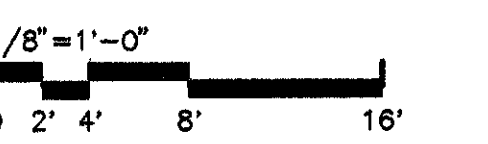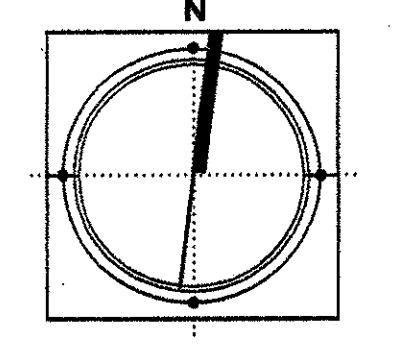

Project Title:  
**ADDISON ARTS & EVENTS DISTRICT**  
 ADDISON, TEXAS

Drawing Title:  
**MECHANICAL PLAN**

Project No. 14516.00 Scale: SHOWN  
 Drawn By: GC  
 Checked By: BK  
 Approved By: BK  
 Date: 09/30/02

Drawing No. **M1-1**