


EMBEDMENT DETAIL  
(P.V.C. PIPE OR ADS NI2 PIPE)  
LOAD FACTOR = 2.0  
NTS

TYPICAL NATIVE MATERIAL COMPACTED TO:  
95% OF STANDARD PROCTOR DENSITY AT  
OPTIMUM MOISTURE 0 TO +3% UNDER PAVEMENT  
95% OF STANDARD PROCTOR DENSITY AT  
OPTIMUM MOISTURE 0 TO +3% OUTSIDE CURB LINES  
JETTING IS NOT ALLOWED  
BACKFILL TO BE COMPACTED IN 6\"/>

PPF ROTATION=90.000000  
 F:\NML\ASHTON\DR\10T\W\400N\3017062.dgn  
 11/18/2009 10:23:12 AM  
 DAVID E. MEYERS, P.E.  
 81512  
 REGISTERED PROFESSIONAL ENGINEER  
 STATE OF TEXAS  
 12/16/99

THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY DAVID E. MEYERS, P.E. 81512

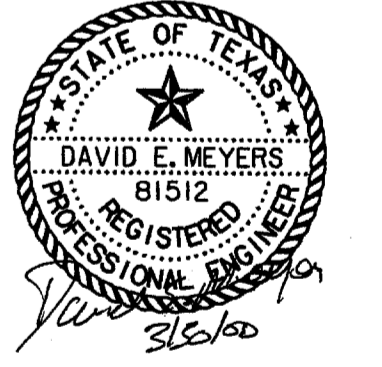

DATE	DESCRIPTION	REF NO.
3/30/00	ISSUED FOR CONSTRUCTION	N/A
1/24/00	ISSUED FOR BID	N/A
12/16/99	CITY SUBMITTAL	N/A

DRAINAGE PLAN						
THE ASHTON						
PRIVATE						
TOWN OF ADDISON, TEXAS						
DESIGN	DRAWN	APPR.	SCALE	DATE	PROJECT NO.	NO.
HZI	HZI	DEM	1"=20'	MAR. 00	01-2617-06	C12