

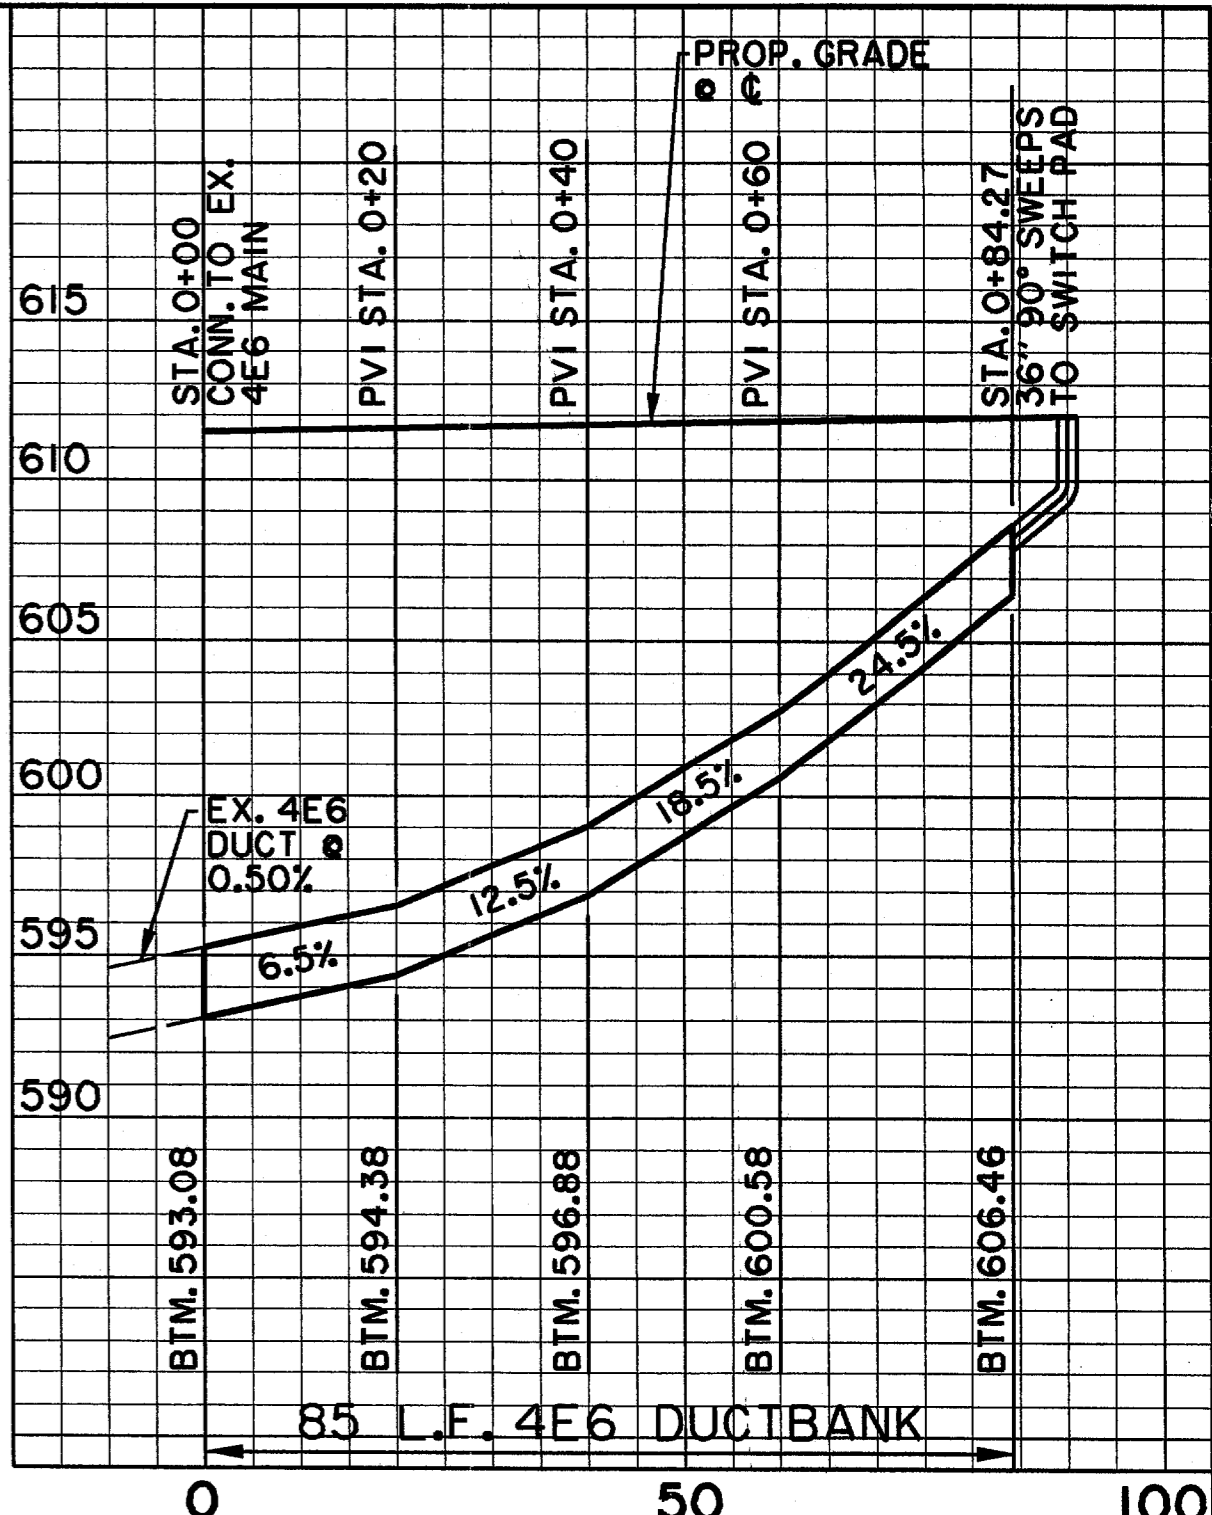



- GENERAL NOTES:
- CONDUIT TO BE 6" P.V.C., TYPE DB.
 - CONCRETE ENCASUREMENT: ALL CONCRETE TO HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI AT TWENTY-EIGHT DAYS.
 - CONDUIT RUN BETWEEN MANHOLES TO BE INSTALLED WITH A MINIMUM SLOPE OF 4" PER 100 FEET TO DRAIN THROUGHOUT ITS ENTIRE LENGTH INTO A MANHOLE OR MANHOLES.
 - INSTALL 6" PVC, TYPE DB CONDUIT BENDS AND ADAPTERS ON ANGLES GREATER THAN 15°.
 - SPACERS (CARLON #289RLN [BASE] AND 289LN [INTERMEDIATE] ARE REQUIRED. THEY SHALL BE SPACED AT 5" INTERVALS AND ARE TO BE TIED TOGETHER BY NON-METALLIC TIE-WRAPS. ALL SPACERS TO PROVIDE 3" VERTICAL AND HORIZONTAL SEPARATION BETWEEN CONDUITS.
 - WHEN COMPLETE, ALL CONDUIT WILL BE CHECKED BY PULLING A MANDREL/SWAB THROUGH ENTIRE LENGTH OF CONDUIT.
 - CONSTRUCTION PLANS SHOW APPROXIMATE RIM ELEVATION; HOWEVER, IT IS THE CONTRACTOR'S RESPONSIBILITY TO INSTALL THE NECESSARY AMOUNT OF NECK TO BRING THE TOP OF THE COVER 2" ABOVE FINISHED GRADE OR FLUSH WITH STREET GRADE WHEN COVER IS IN STREET.
 - BACKFILL OPERATION SHALL BEGIN AFTER CONCRETE HAS HAD TIME TO CURE (CURING TIME IS AT THE DISCRETION OF TU'S INSPECTOR). BACKFILL SHALL HAVE NO ROCKS LARGER THAN 1" IN DIAMETER AND SHALL BE COMPACTED TO 95% STANDARD PROCTOR DENSITY BETWEEN 0% AND 3% OF OPTIMUM MOISTURE CONTENT.

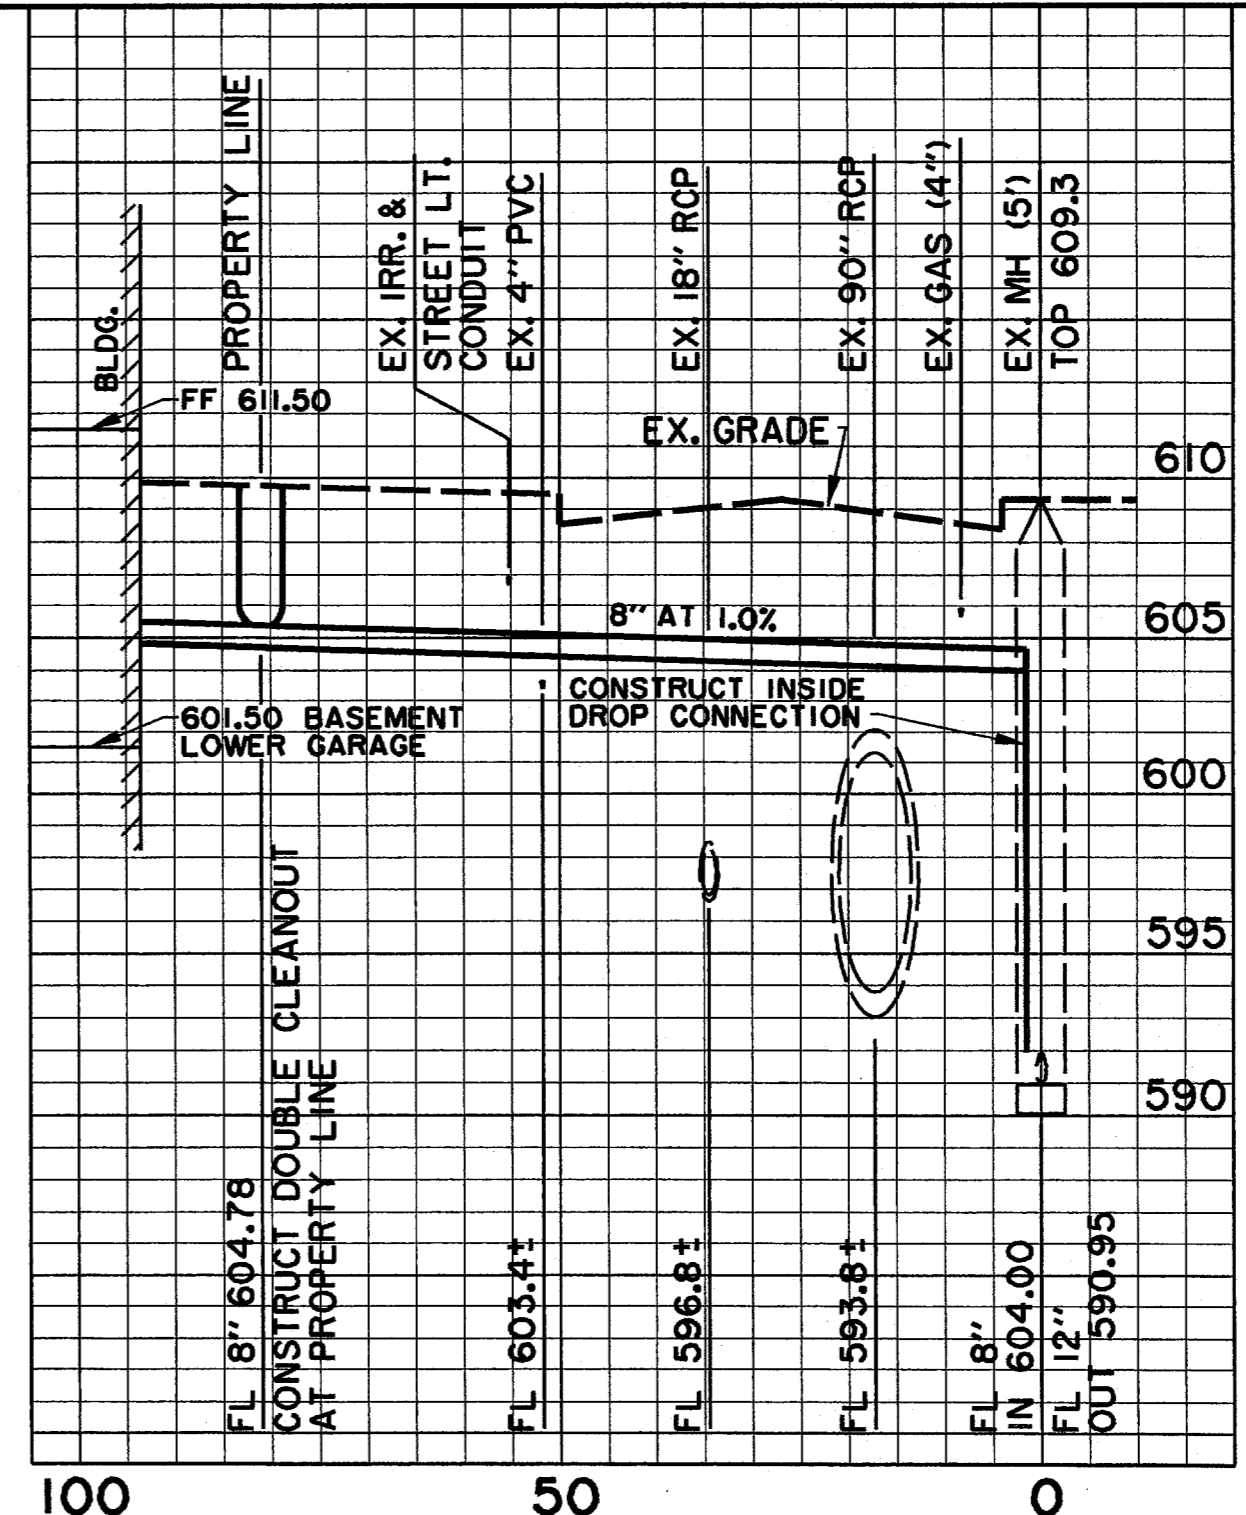

NOTE:
METERS, METER CANS, VAULTS AND BACKFLOW PREVENTION ASSEMBLIES TO BE INSTALLED AND TESTED PER TOWN OF ADDISON GENERAL REQUIREMENTS.

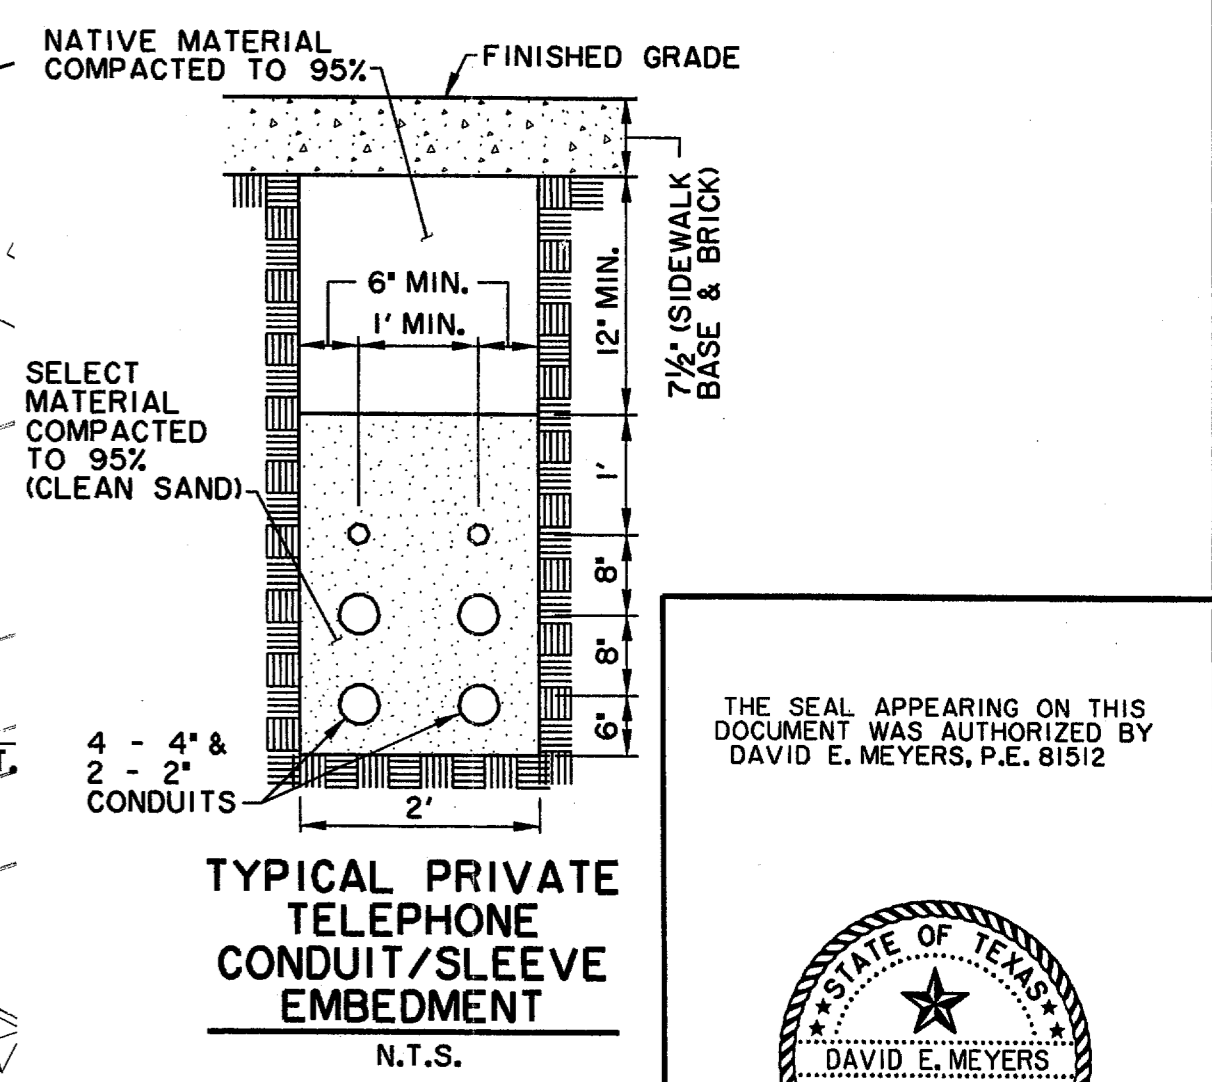

THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY DAVID E. MEYERS, P.E. 81512

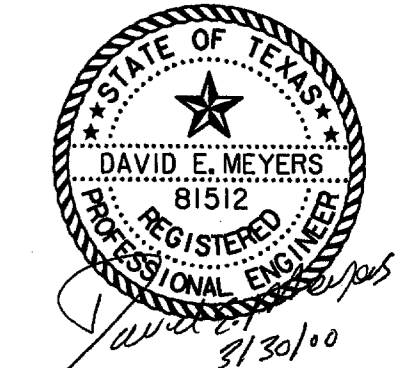

DATE	DESCRIPTION	REF NO.
3/30/00	ISSUED FOR CONSTRUCTION; ADDENDUM #2	▲
1/24/00	ISSUED FOR BID	N/A
12/16/99	CITY SUBMITTAL	N/A

UTILITY PLAN						
THE ASHTON						
PRIVATE						
TOWN OF ADDISON, TEXAS						
DESIGN	DRAWN	APPR.	SCALE	DATE	PROJECT NO.	NO.
HZ1	HZ1	DEM	1"=20'	MAR. 00	01-2617-06	C13

U:\PROJECTS\2000\11-2617-06\11-2617-06.dwg
 PLOT DATE: 03/30/00 10:54:56 AM
 PLOT BY: J. H. HARRIS
 PLOT SCALE: 1"=20'
 PLOT SHEET: 1 OF 1
 PLOT AREA: 11.2617-06.dwg