


NO.	REINFORCEMENT	STIRRIPS
B1	3 #7 CONT. T & B	1@2", 1@4", 1@6", 1@8" @ 10" O.C. FROM EACH SUPPORT
B2	2 #7 CONT. T & B	1@2", 1@4", 1@6", 1@8" @ 10" O.C. FROM EACH SUPPORT
B3	2 #6 CONT. T & B	1@2", 1@4", 1@6", @ 10" O.C. FROM EACH SUPPORT
B4	2 #5 CONT. T & B	1@2", 1@6", @ 12" O.C. FROM EACH SUPPORT

NO.	DIAMETER (IN)	3' PENETRATION	VERT. REBARS	REMARKS
P1	18" Ø	6-#6	3' PENETRATION	
P2	16" Ø	6-#5	"	
P3	12" Ø	4-#4	"	

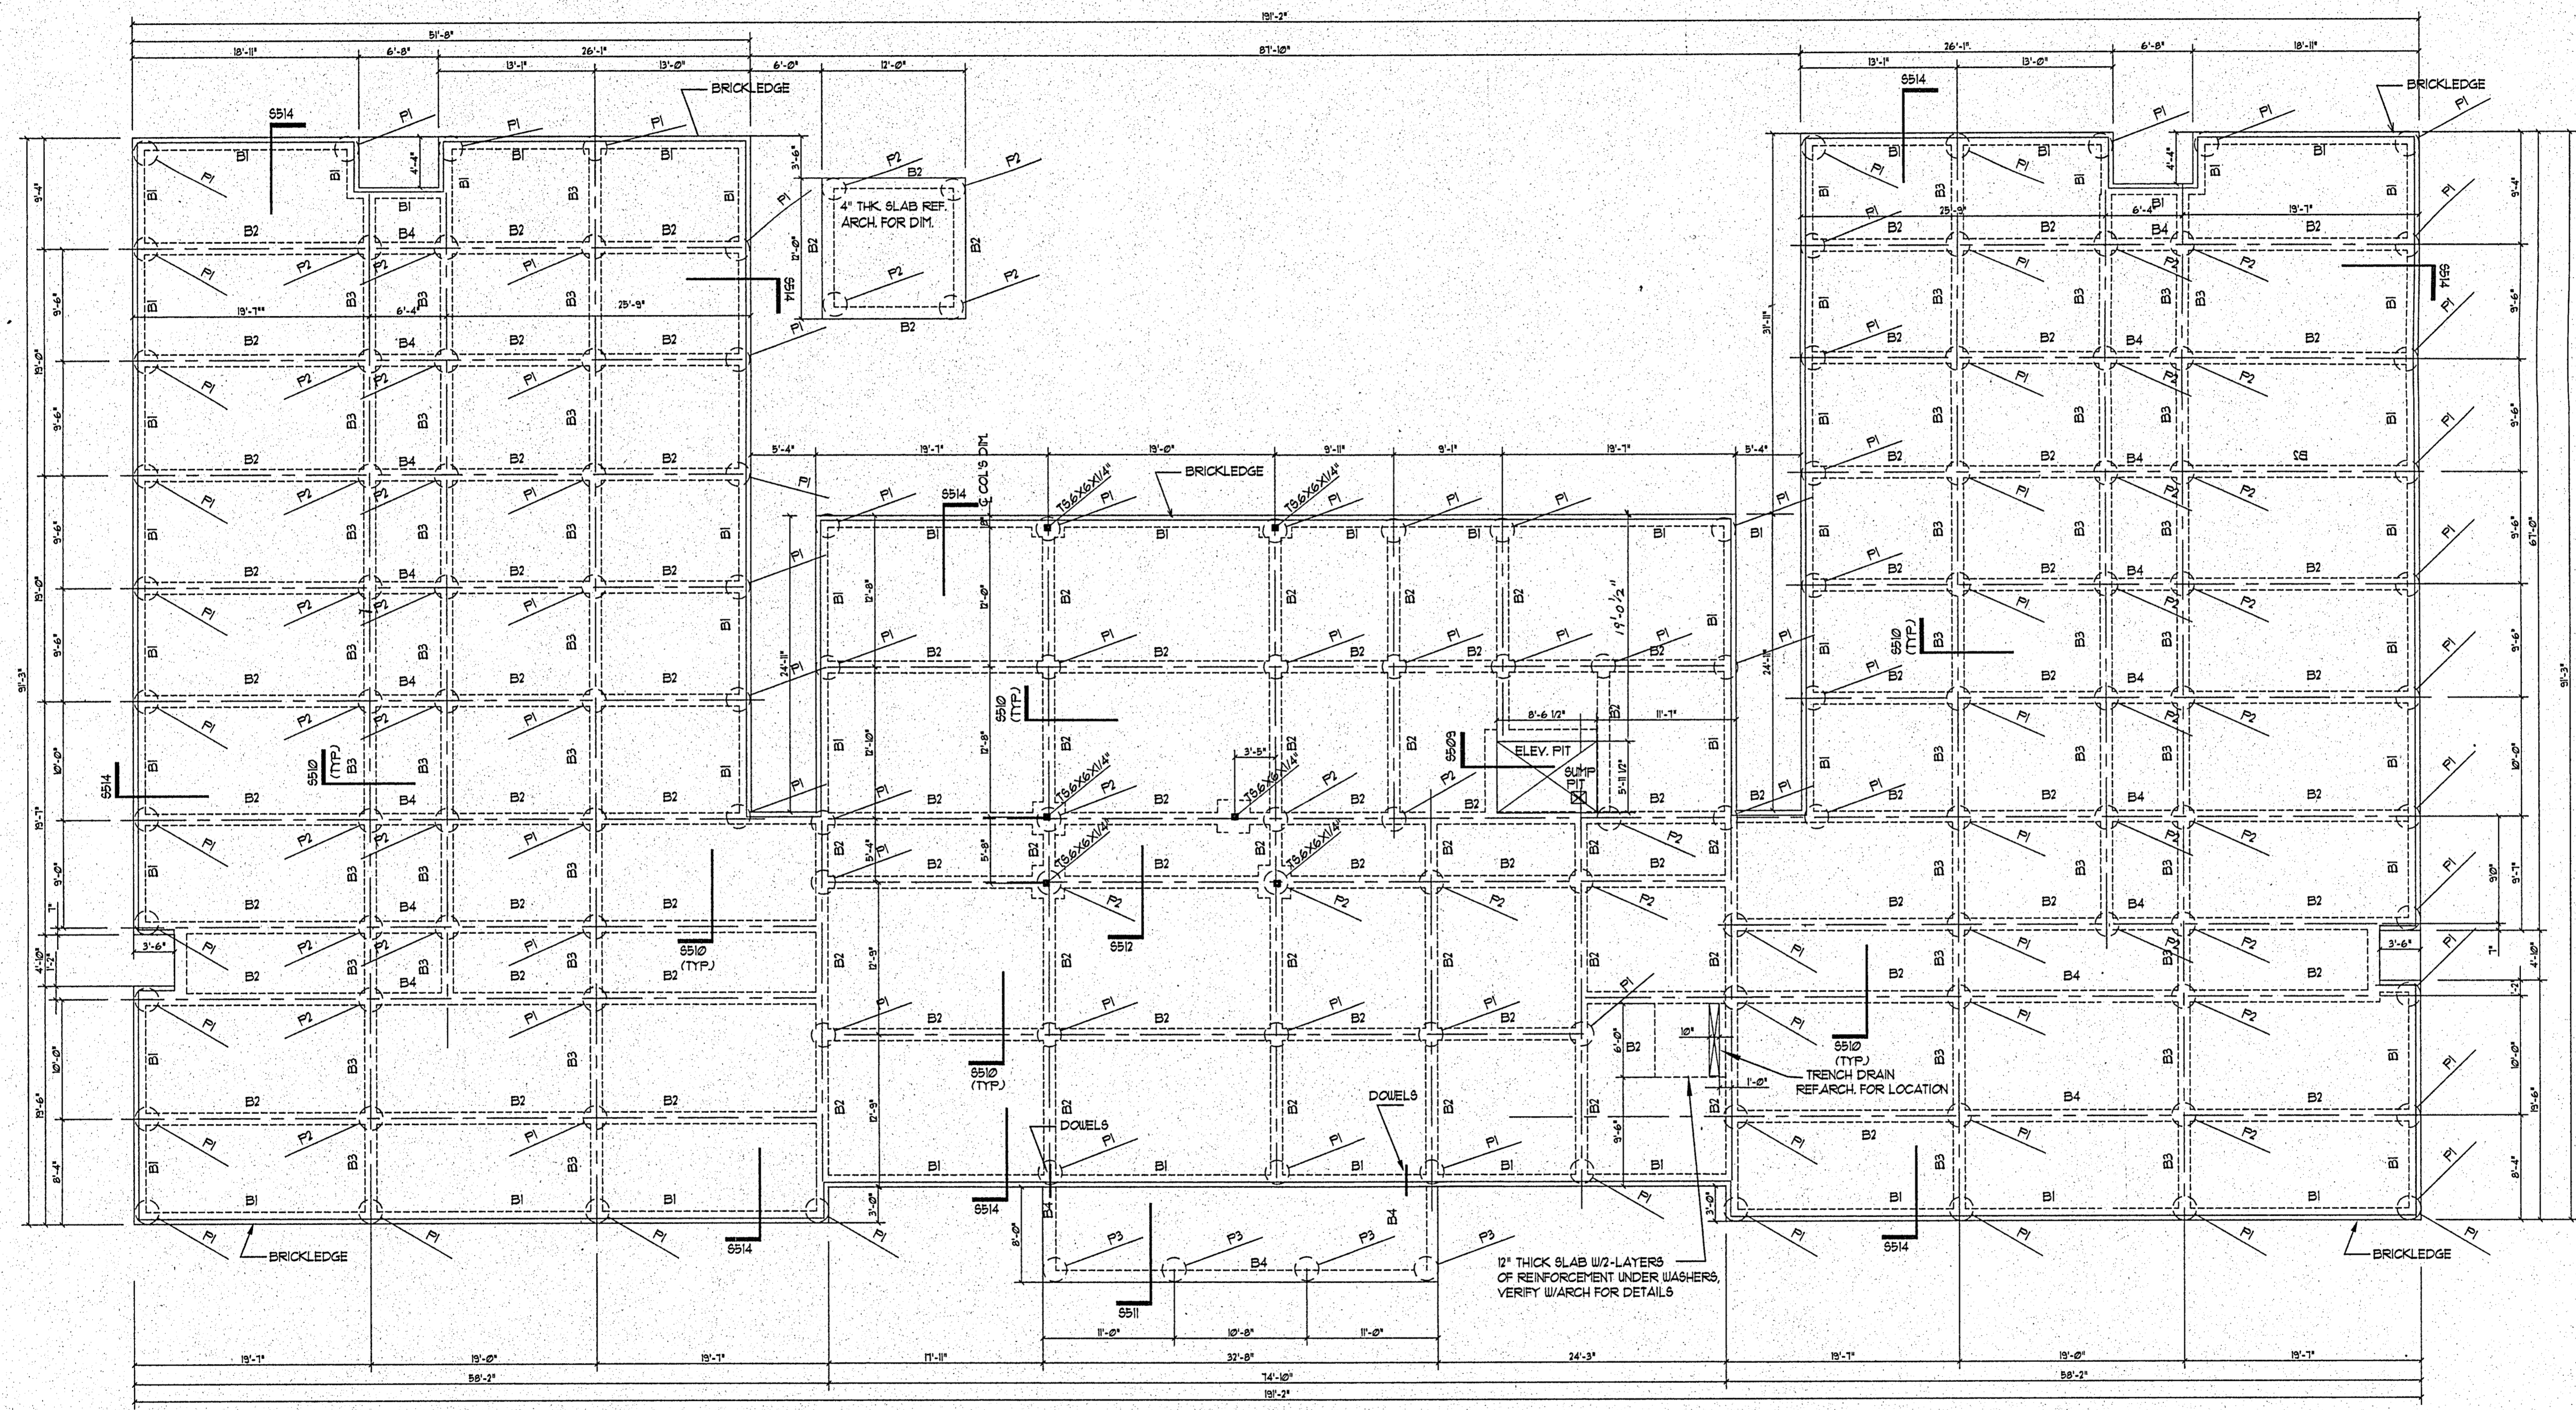

- FOUNDATION PLAN NOTES**
- REFER TO SHEET S-5 FOR GENERAL NOTES AND FOUNDATION DETAILS.
 - TOP OF CONCRETE FINISH FLOOR SLAB = 10'-0" (ASSUMED DATUM).
 - CONCRETE SLAB SHALL BE 4" THK SLAB ON GRADE FOUNDATION REINFORCED W/ #5 @ 18" O.C. (TYP).
 - REFER TO ARCHITECTURAL FOR EXACT SIZE AND LOCATION OF ELEVATOR.
 - CONTRACTOR TO LOCATE ALL INTERIOR COLUMNS AND WALLS PER ARCHITECTURAL PLANS.
 - FOR POOL CONSTRUCTION LAYOUT SEE ARCHITECTURAL PLANS.
 - ALL BEAMS ARE 12"x24" REINFORCED W/ 2-#6 CONT. T&B UNLESS NOTED OTHERWISE.
 - SUBGRADE PREPARATION PER SOIL REPORT CAN REDUCE POTENTIAL UPWARD MOVEMENT UP TO AN INCH.
 - CONCRETE IN PIER HOLES SHALL BE POURED WITHIN 6 HR OF DRILLING.
 - ALL PIERS ARE TO BE 18" Ø W/ 3-Ø" PENETRATION INTO GRAY SHALEY LIMESTONE STRATUM # 12' TO 19' BELOW GRADE UNLESS NOTED.
 - ALL STEEL COLUMNS ARE 18" Øx14" UNLESS NOTED ON PLAN.

1 FOUNDATION PLAN
SCALE: 1/8" = 1'-0"
FOUND.

K.S. ATWAL & ASSOCIATES, INC.
CONSULTING ENGINEERS, STRUCTURAL
6804 E. PARKER ROAD, PARKER, TEXAS 75002
PH (972) 442-0821 FAX (972) 442-5404

9.11.98