

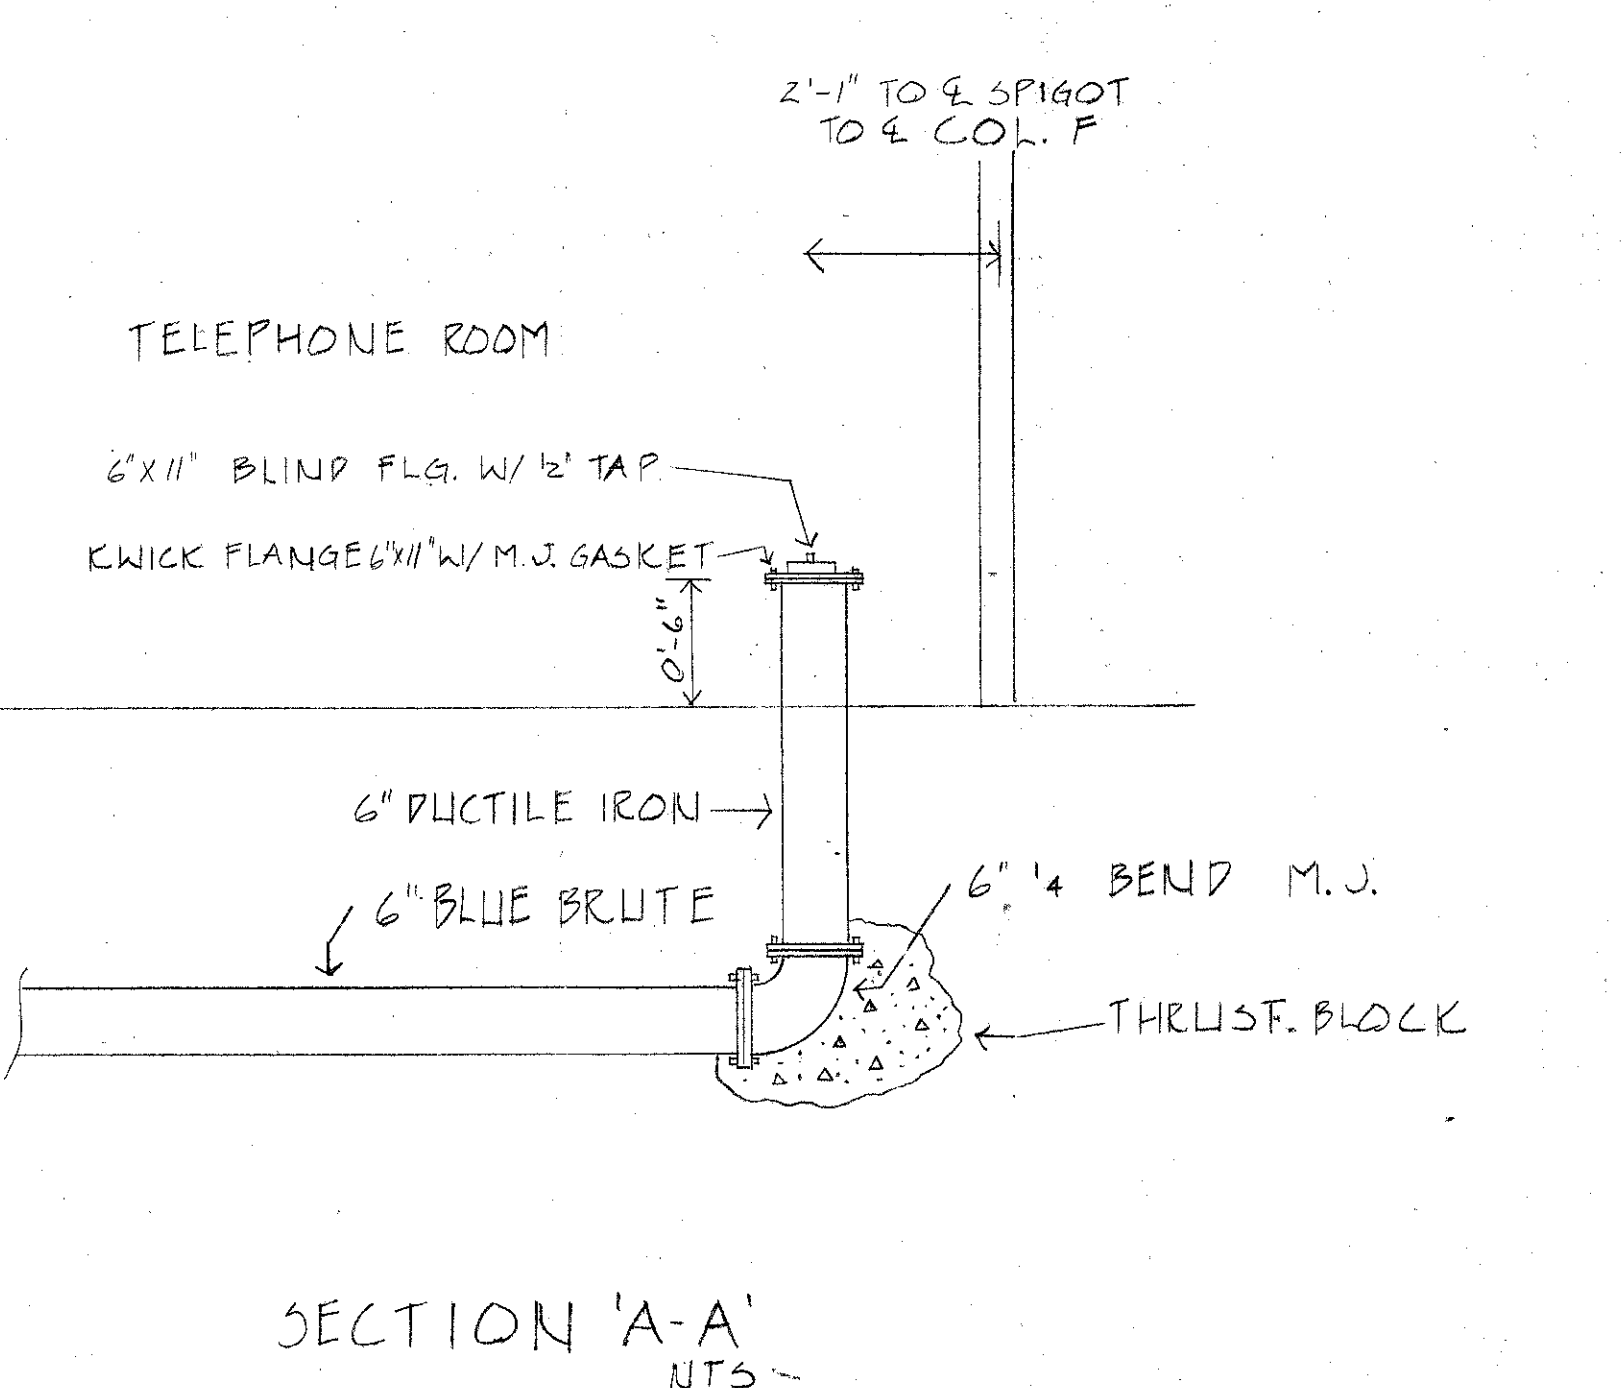


CONSTRUCTION NOTE:
 - UNDERGROUND PIPE TO BE SAND ENCASED, 6" ALL AROUND 42" MINIMUM COVER AND COMPACT BACKFILL UP TO 75%.
 - CONCRETE THRUST BLOCKING TO BE USED ON ALL TEES, BENDS, OR WHERE APPROPRIATE.
 UNDERGROUND PIPE SHALL BE CHLORINATED IN ACCORDANCE W/ CITY OF ADDISON
 A #12 COATED COPPER WIRE OR METALLIC TRACER TAPE EQUIVALENT SHALL BE PLACED IN THE TRENCH OVER ALL WATER LINES.

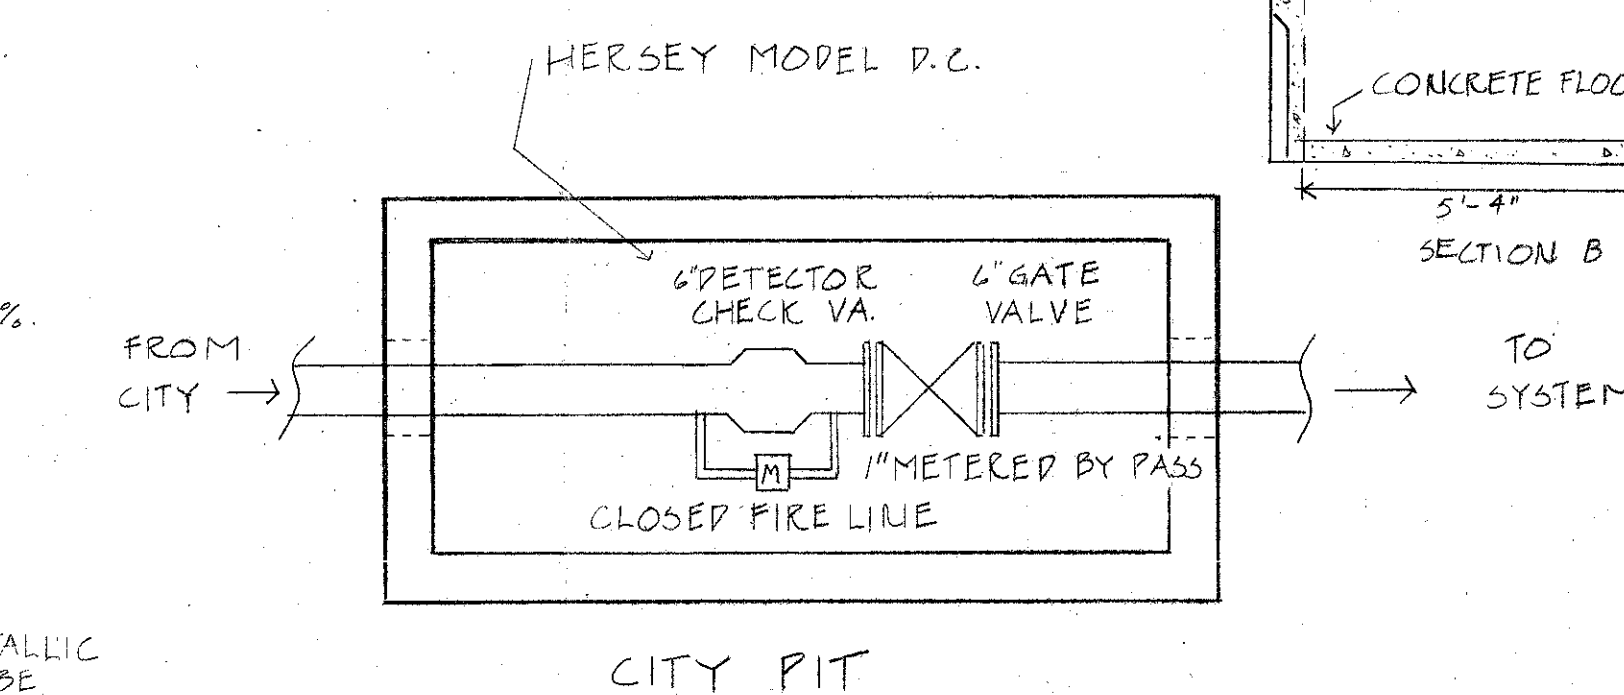

Tomall B. Oka

PLAN VIEW SYMBOLS		BUILDING & SYSTEM LEGEND		125# BLK. C.I. FLANGED FITTINGS		125# BLK. C.I. SCREW FITTINGS		GROOVED FITTINGS		U.L. APPROVED WELDED OUTLETS		SPRINKLER DESCRIPTION		NO. DATE		REVISION DESCRIPTION	
WET MAIN RISER	STD. F.O.C. 2 1/2" x 4"	HYDRAULIC LINE NO.	PIPE BELOW	COMPANION FLANGE	90° ELL	45° ELL	TEE	REDUCER	COUPLING	TAPER REDUCER	750 REDUCER	EL PASO	NO. 1	DATE	REVISION	AUTOMATIC FIRE SPRINKLER SYSTEM FOR	
DRY MAIN RISER	FLUSH F.O.C. 2 1/2" x 4"	HYDRAULIC REF. POINT	PIPE ABOVE FLOOR	FLANGED UNION	90° ELL	45° ELL	TEE	REDUCER	COUPLING	TAPER REDUCER	750 REDUCER	EL PASO	NO. 2	DATE	REVISION	Old Town 7-11 Strip Crt.	
DELUGE RISER	SINGLE F.O.C. 2 1/2" x 3"	FABRICATION LINE NO.	ROOF ELEVATION	FLANGED REDUCER	90° ELL	45° ELL	TEE	REDUCER	COUPLING	TAPER REDUCER	750 REDUCER	EL PASO	NO. 3	DATE	REVISION	4801 ARAPAHO	
WATER MOTOR & GONG		FABRICATION MAIN NO.	CEILING ELEVATION	FLANGED REDUCER	90° ELL	45° ELL	TEE	REDUCER	COUPLING	TAPER REDUCER	750 REDUCER	EL PASO	NO. 4	DATE	REVISION	ADDISON, TEXAS	
ELECTRIC BELL		FABRICATION MAIN NO.	CEILING HIGH WALL	FLANGED REDUCER	90° ELL	45° ELL	TEE	REDUCER	COUPLING	TAPER REDUCER	750 REDUCER	EL PASO	NO. 5	DATE	REVISION	CITY AND TSBI	
		FABRICATION MAIN NO.		FLANGED REDUCER	90° ELL	45° ELL	TEE	REDUCER	COUPLING	TAPER REDUCER	750 REDUCER	EL PASO	NO. 6	DATE	REVISION		
		FABRICATION MAIN NO.		FLANGED REDUCER	90° ELL	45° ELL	TEE	REDUCER	COUPLING	TAPER REDUCER	750 REDUCER	EL PASO	NO. 7	DATE	REVISION		
		FABRICATION MAIN NO.		FLANGED REDUCER	90° ELL	45° ELL	TEE	REDUCER	COUPLING	TAPER REDUCER	750 REDUCER	EL PASO	NO. 8	DATE	REVISION		
		FABRICATION MAIN NO.		FLANGED REDUCER	90° ELL	45° ELL	TEE	REDUCER	COUPLING	TAPER REDUCER	750 REDUCER	EL PASO	NO. 9	DATE	REVISION		
		FABRICATION MAIN NO.		FLANGED REDUCER	90° ELL	45° ELL	TEE	REDUCER	COUPLING	TAPER REDUCER	750 REDUCER	EL PASO	NO. 10	DATE	REVISION		

DESIGNED BY: MDP
 DRAWN BY: JFP
 CHECKED BY: MP
 CONTRACT NO: 01-2607
 DATE: 7-30-85
LaDEW FIRE PROTECTION
 P.O. BOX 270639
 4120 SCOTTSDALE DR.
 DALLAS, TEXAS 75227
 (214) 388-2171
 TEXAS STATE FIRE MARSHAL CERTIFICATE OF REGISTRATION NO. SCR-0008
 AUTHORITY HAVING JURISDICTION: CITY AND TSBI