




2" PVC ONE-WAY ELECTRICAL DUCT-TYPE "A"
NTS

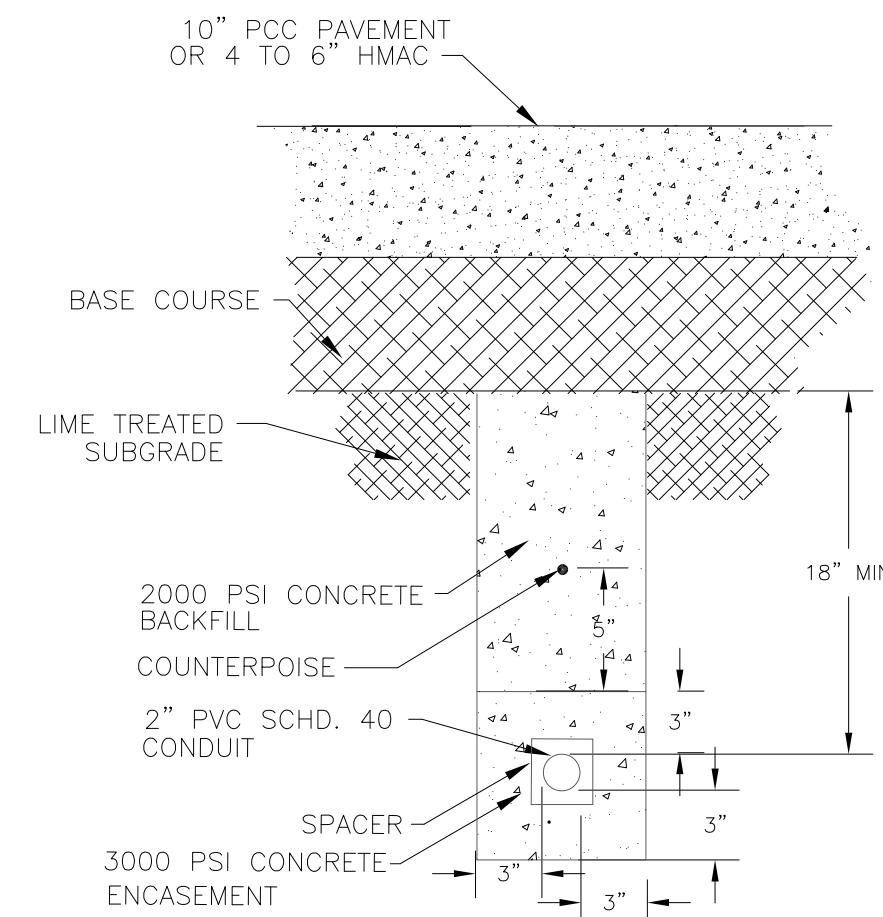

2" PVC ONE-WAY ELECTRICAL DUCT-TYPE "B"
UNDER PAVEMENT
NTS

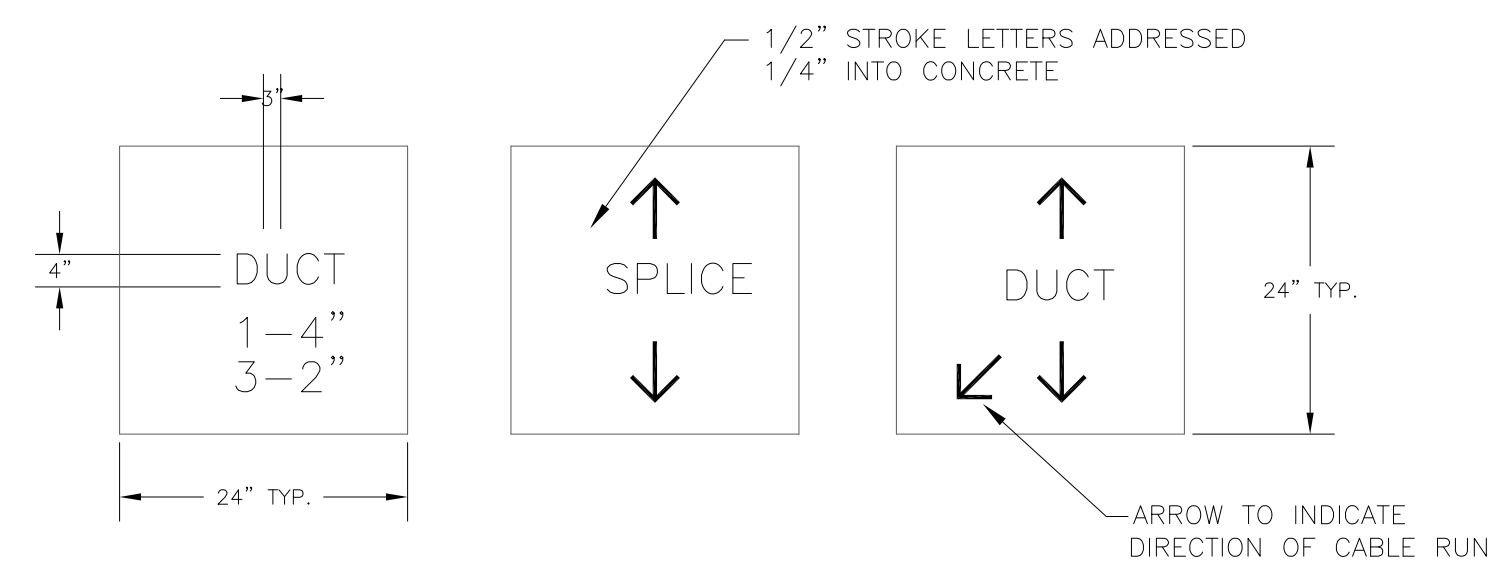

PLAN VIEWS

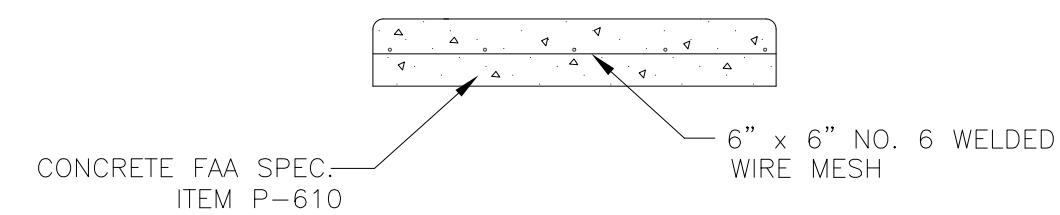

SECTION VIEW
CABLE AND DUCT MARKER
NTS

90% SUBMITTAL

FOR INTERIM REVIEW ONLY

PSA ENGINEERING
PANSAK SRIBHEN
NO. 40320
DATE: 4/26/95

DESIGN: <u>R.W.G.</u>	A.I.P. NO. <u>3-48-0063-07</u>		
DRAWN: <u>W.C.R.</u>	BID NO.: <u>95-18</u>		
CHECKED: <u>P.S.A.</u>	JOB NO.: <u>E708024.70</u>		
SCALE: <u>NO SCALE</u>		Date	Revisions
		By	

Greiner, Inc.
Greiner, Inc.
Fort Worth, Texas

IN ASSOCIATION WITH
ASA
ENGINEERING
DALLAS, TEXAS 75287



ADDISON AIRPORT

TAXIWAY "B" LIGHTING
ELECTRICAL CONDUIT & DUCT DETAIL

SHEET
8
DATE: APR. 1995