


LIGHTING AND RECEPTACLE LEGEND	
SYMBOLS	DESCRIPTION
(A)	FLUORESCENT FIXTURE
⊕	DUPLEX RECEPTACLE SEE E-XX DETAIL XX
§	WALL SWITCH, SPST




**TYPICAL AIRPORT TEE HANGAR-LIGHTING**  
SCALE: 3/16" = 1'-0"

- NOTES:
1. ALL BOTTOM OF RECEPTACLE DISTANCE TO HANGAR FLOOR TO BE MINIMUM 24 INCHES TO BE ABOVE HANGAR ELECTRICAL AREA CLASSIFICATION OF 18 INCHES ABOVE GRADE.
  2. TERMINAL JUNCTION BOX FOR HANGAR WIRING.
  3. SEE SPECIFICATIONS FOR EQUIPMENT WIRING DEVICES.

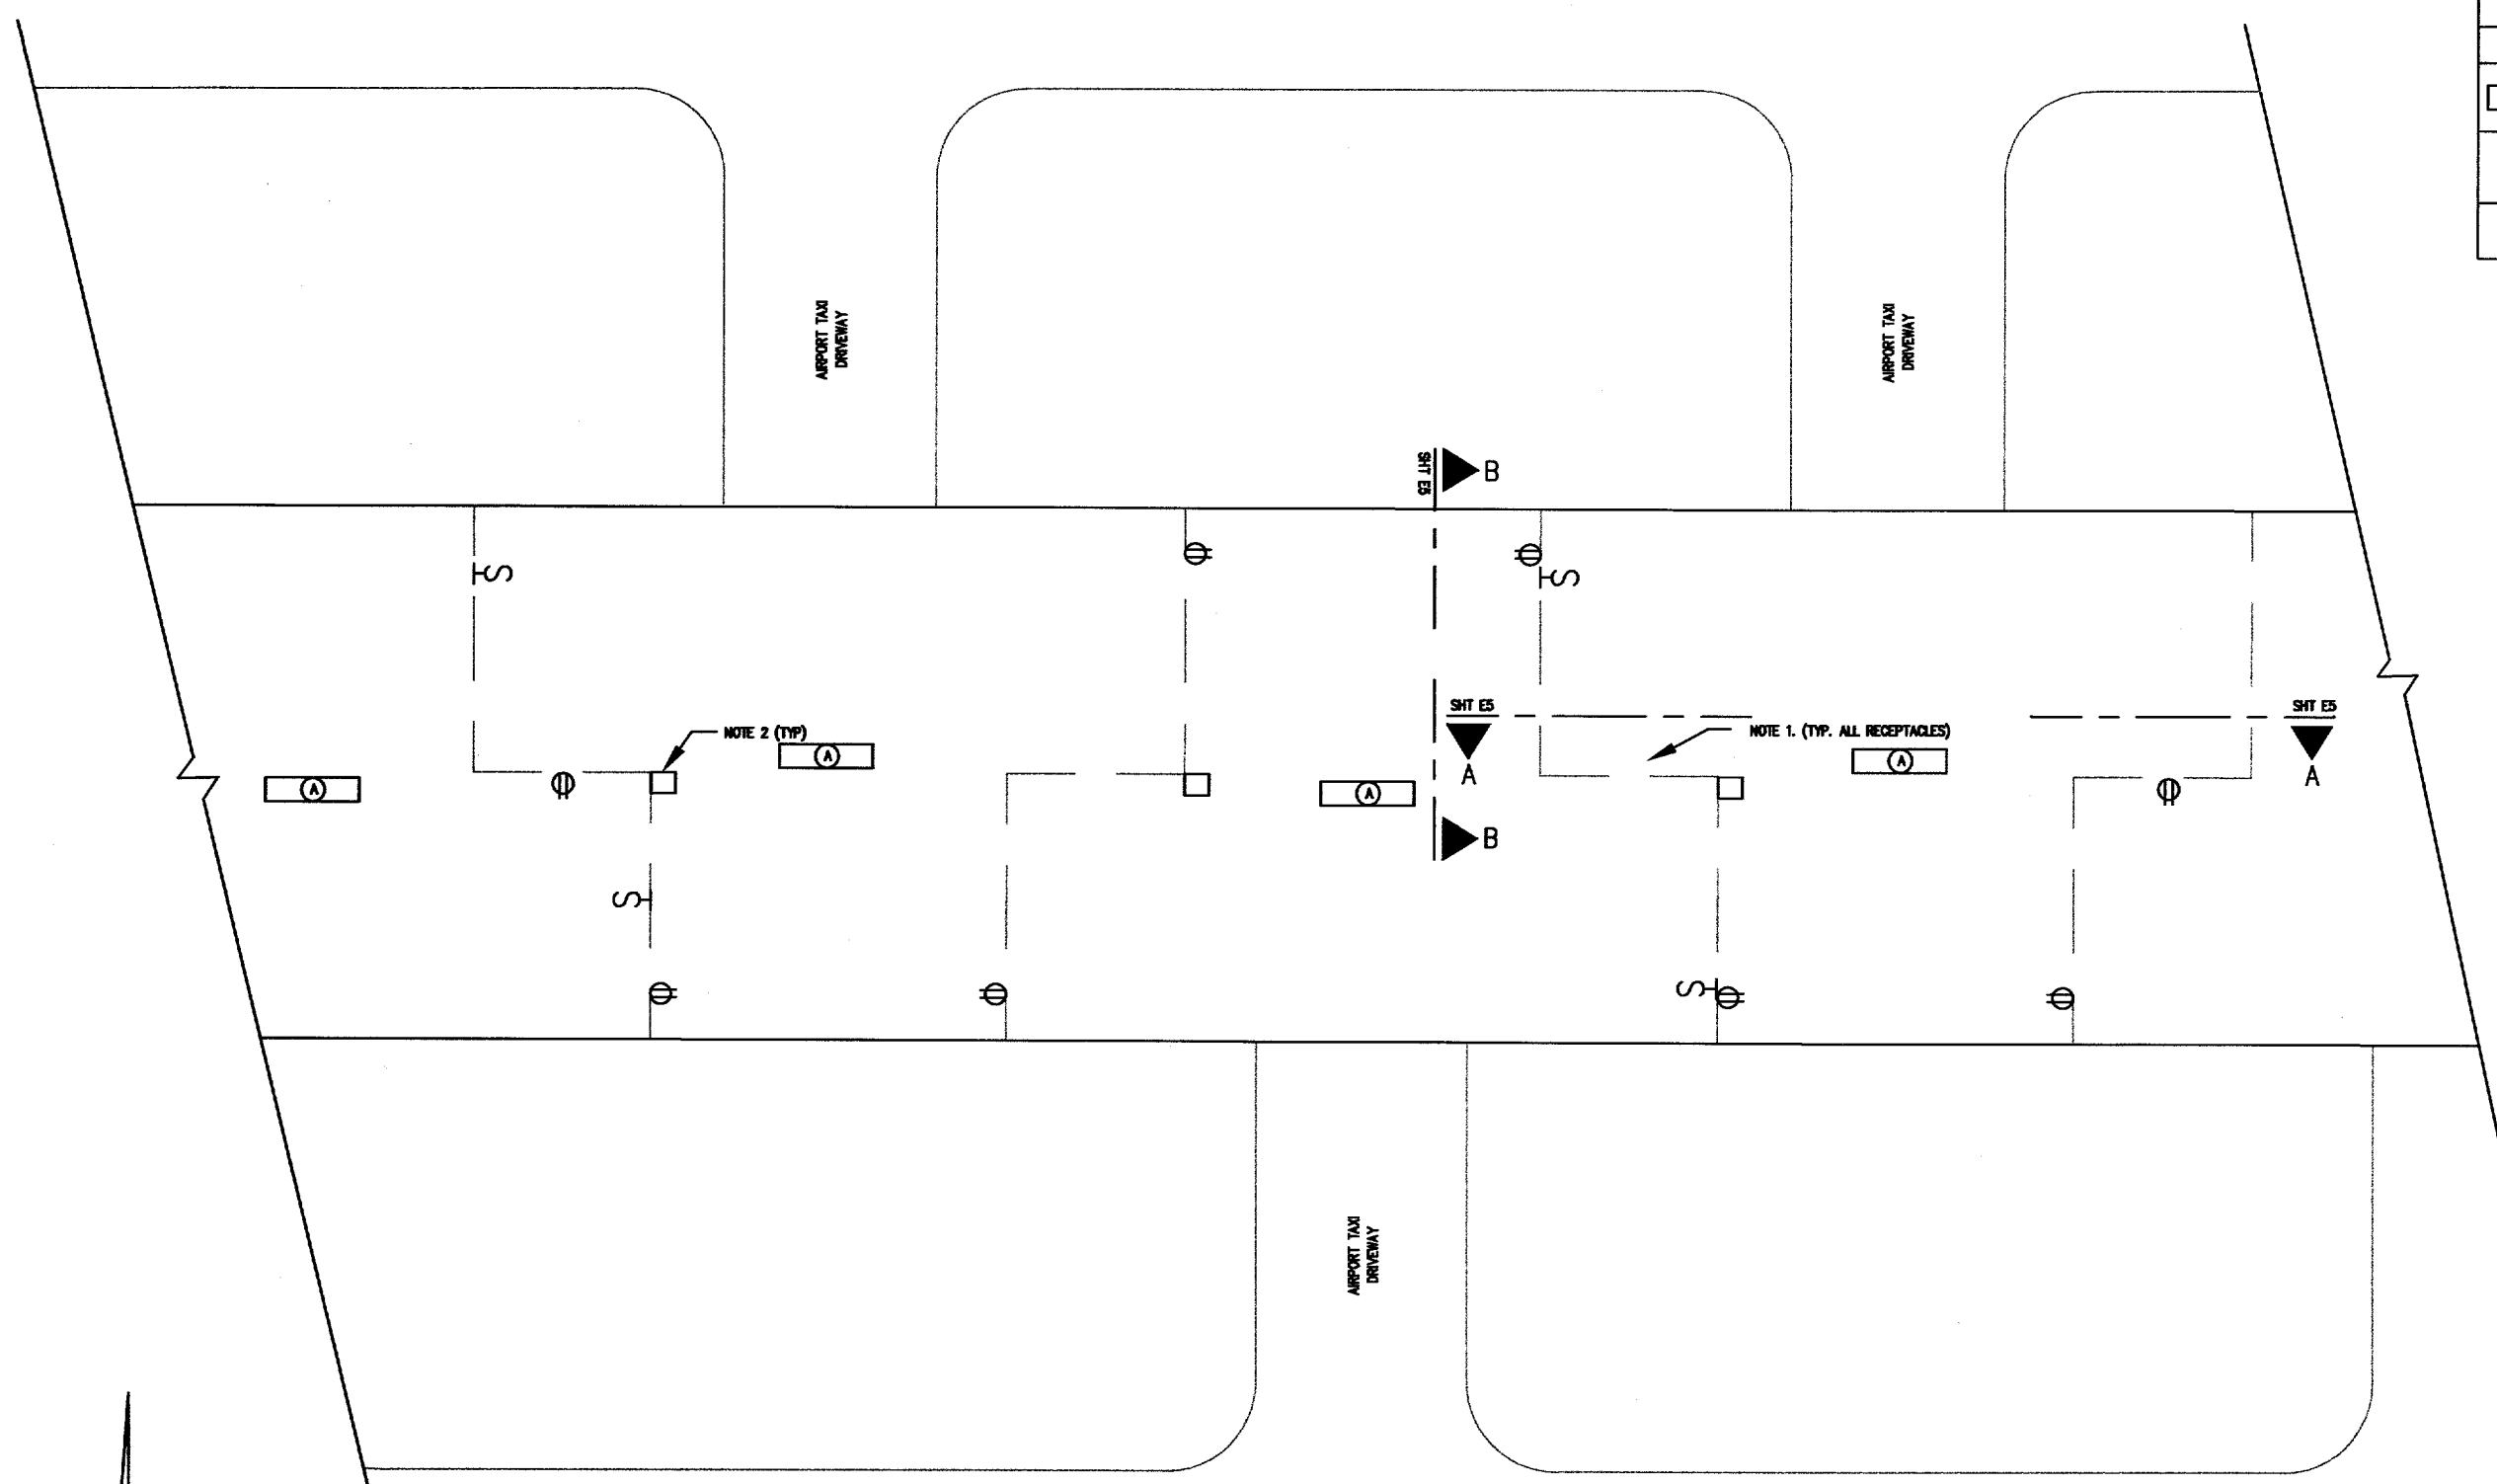

**VERIFY SCALE**  
Bar is one inch on original drawing.  
0 1  
If not one inch on this sheet, adjust scale accordingly.

THESE DOCUMENTS ARE FOR BIDDING, CONSTRUCTION, AND PERMIT PURPOSES.  
DATE: 1-12-05



**TOWN OF ADDISON, TEXAS**

ADDISON AIRPORT TEE HANGAR LIGHTING  
HANGAR ELECTRICAL PLAN

McCREARY & ASSOCIATES, INC.  
CONSULTING ENGINEERS  
4300 LBJ FREIGHT CENTER ST DALLAS, TEXAS 75244

DESIGNED BY: W.H.G.	PROJECT: 97 180	SHEET NO. E4
DRAWN BY: M.E.G.	DATE: JANUARY, 2005	OF 07 SHEETS