



LIGHTING AND RECEPTACLE LEGEND	
SYMBOLS	DESCRIPTION
(A)	FLUORESCENT FIXTURE
⊕	DUPLEX RECEPTACLE SEE E-XX DETAIL XX
S	WALL SWITCH, SPST

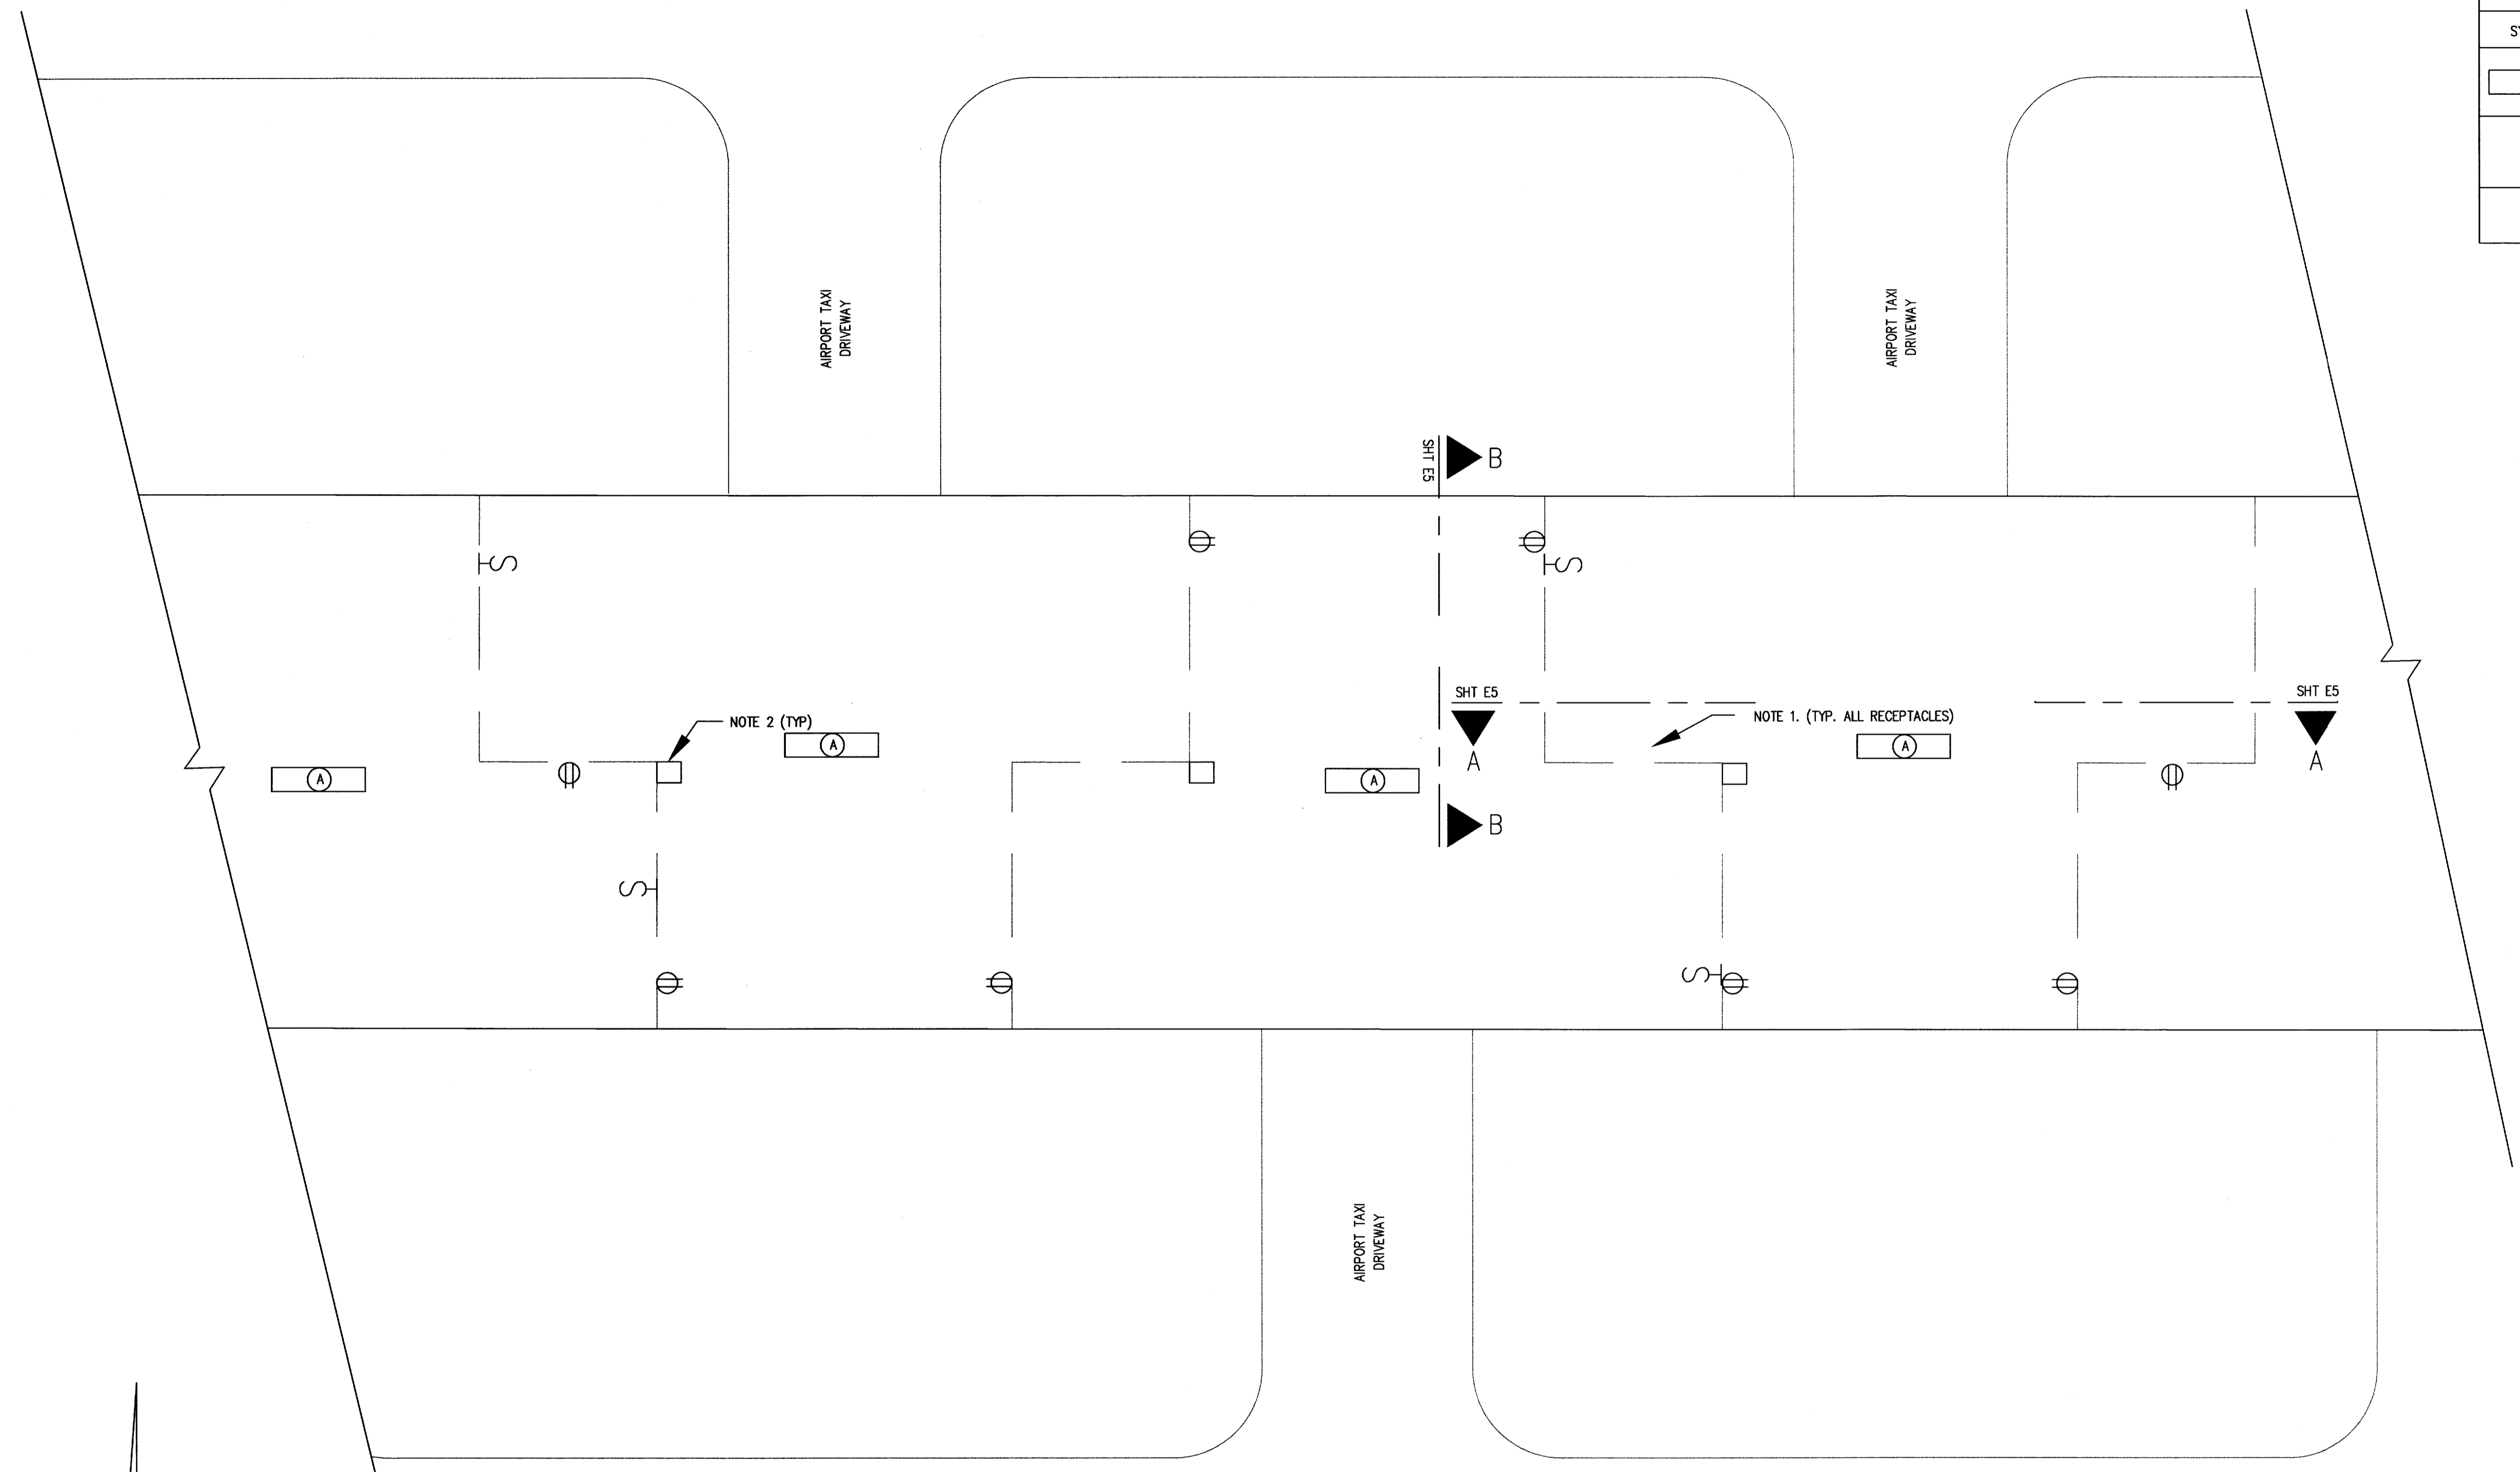


TYPICAL AIRPORT TEE HANGAR—LIGHTING
SCALE: 3/16" = 1'-0"

- NOTES:
1. ALL BOTTOM OF RECEPTACLE DISTANCE TO HANGAR FLOOR TO BE MINIMUM 24 INCHES TO BE ABOVE HANGAR ELECTRICAL AREA CLASSIFICATION OF 18 INCHES ABOVE GRADE.
 2. TERMINAL JUNCTION BOX FOR HANGAR WIRING.
 3. SEE SPECIFICATIONS FOR EQUIPMENT WIRING DEVICES.

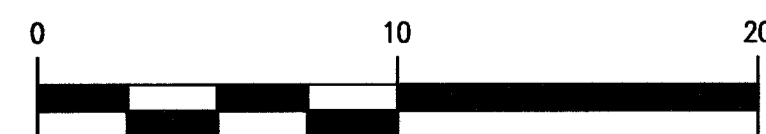

VERIFY SCALE
Bar is one inch on original drawing.
0 1
If not one inch on this sheet, adjust scale accordingly.

THESE DOCUMENTS ARE FOR BIDDING, CONSTRUCTION, AND PERMIT PURPOSES.
DATE: 1-12-05

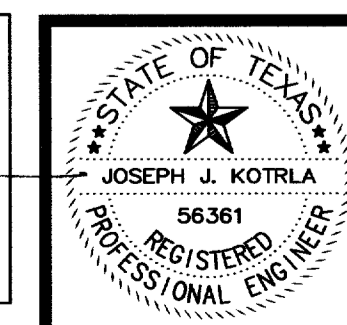

TOWN OF ADDISON, TEXAS		
ADDISON AIRPORT TEE HANGAR LIGHTING HANGAR ELECTRICAL PLAN		
McCREARY & ASSOCIATES, INC. CONSULTING ENGINEERS 972/458-8745 6310 LBJ FREEWAY SUITE 217 DALLAS, TEXAS 75240		
DESIGNED BY: W.H.G.	PROJECT: 97 180	SHEET NO. E4
DRAWN BY: M.E.G.	DATE: JANUARY, 2005	OF E7 SHEETS