


CIRCUITS #5, 6, 7, 8, 9, 10, 11, 12 WIRING DIAGRAM
 TYPICAL FOR EACH OF THE TWO TEE HANGARS
 NOT TO SCALE

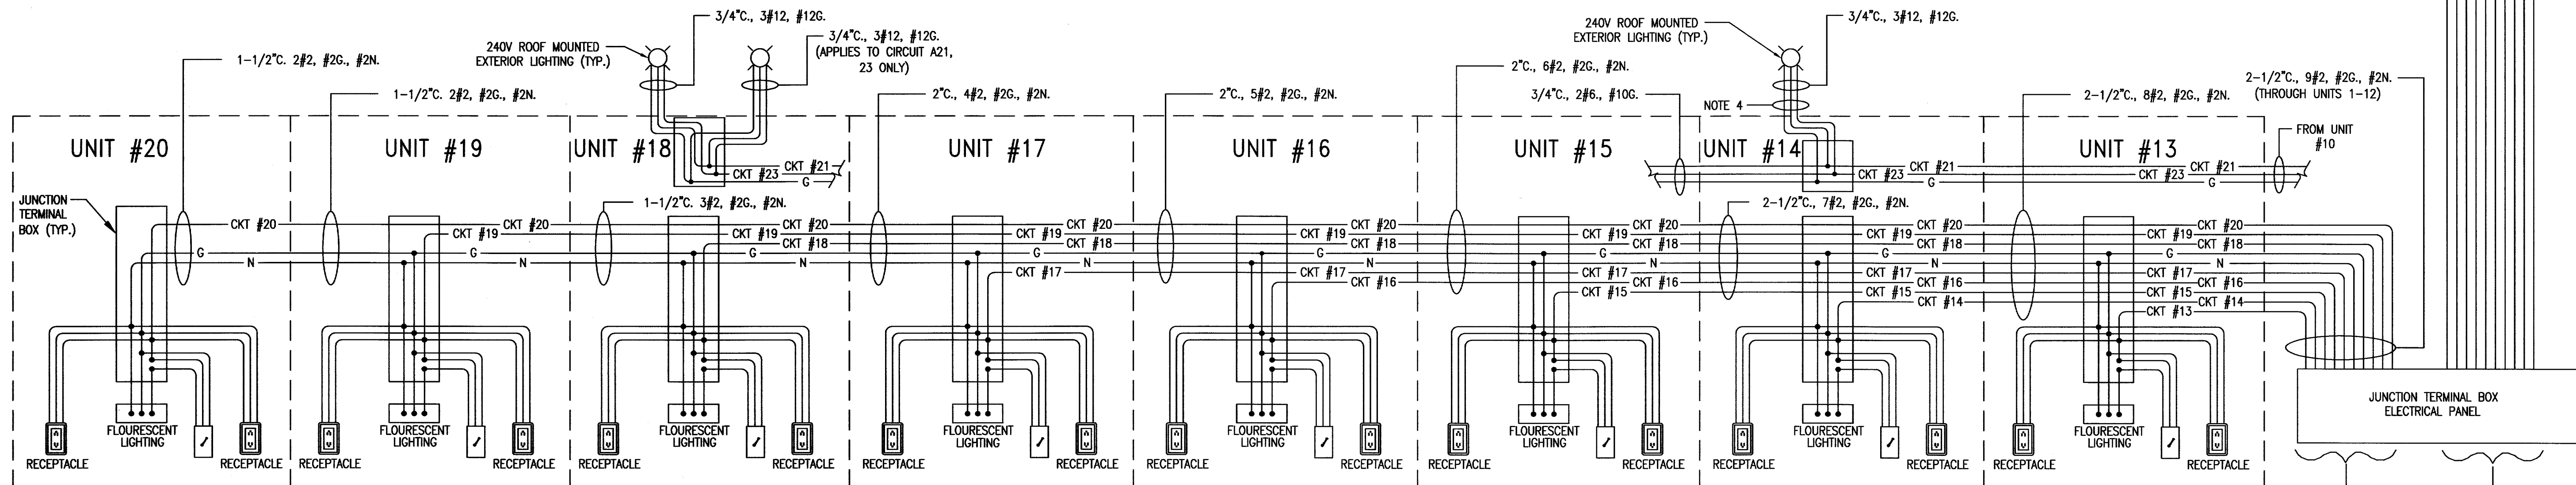


- NOTES:
1. WIRING AND CONDUIT SIZES FOR EXTENSION WIRING FROM JUNCTION BOX TO LIGHTING, SWITCHES AND RECEPTACLES SHALL BE THE SAME AS SHOWN FOR UNIT #1 AS SHOWN ON SHEET E6.
 2. FOR CIRCUITS 1-4 SEE SHEET E6.
 3. NO ROOF MOUNT UNITS IN UNIT #6 FOR CIRCUITS A22, 24.
 4. NO ROOF MOUNT UNITS IN UNIT #14 FOR CIRCUITS A21, 23.

CIRCUITS #13, 14, 15, 16, 17, 18, 19, 20, 21, WIRING DIAGRAM
 TYPICAL FOR EACH OF THE TWO TEE HANGARS
 NOT TO SCALE

VERIFY SCALE
 Bar is one inch on original drawing.
 0 1
 If not one inch on this sheet, adjust scale accordingly.

THESE DOCUMENTS ARE FOR BIDDING, CONSTRUCTION, AND PERMIT PURPOSES.
Joseph J. Kotrla
 DATE: 1-12-05

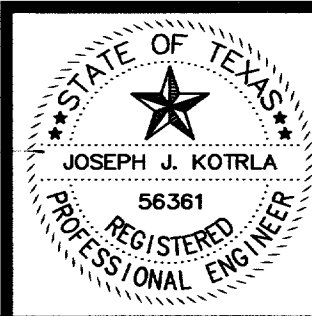

TOWN OF ADDISON, TEXAS
 ADDISON AIRPORT TEE HANGAR LIGHTING
 CIRCUIT DIAGRAM 5 THRU 21

McCREARY & ASSOCIATES, INC.
 CONSULTING ENGINEERS 972/458-8745
 6310 LBJ FREEWAY SUITE 217 DALLAS, TEXAS 75249
 DESIGNED BY: W.H.G. PROJECT: 97 180 SHEET NO. E7
 DRAWN BY: M.E.G. DATE: JANUARY, 2005 OF E7 SHEETS