


File: L:\2011\11081100 - ADS Taxiway Alpha Improvements\Drawings\ADS_SA4B_C405_AR.dwg Plot Date: 2/29/2012 11:10 AM Plotter: garver\jg\plotter.dwg
 Last Saved: 2/17/2012 2:50 PM Last Saved by: Mmmccolly
 Last Plotted: 2/29/2012 11:10 AM Plotted by: jg

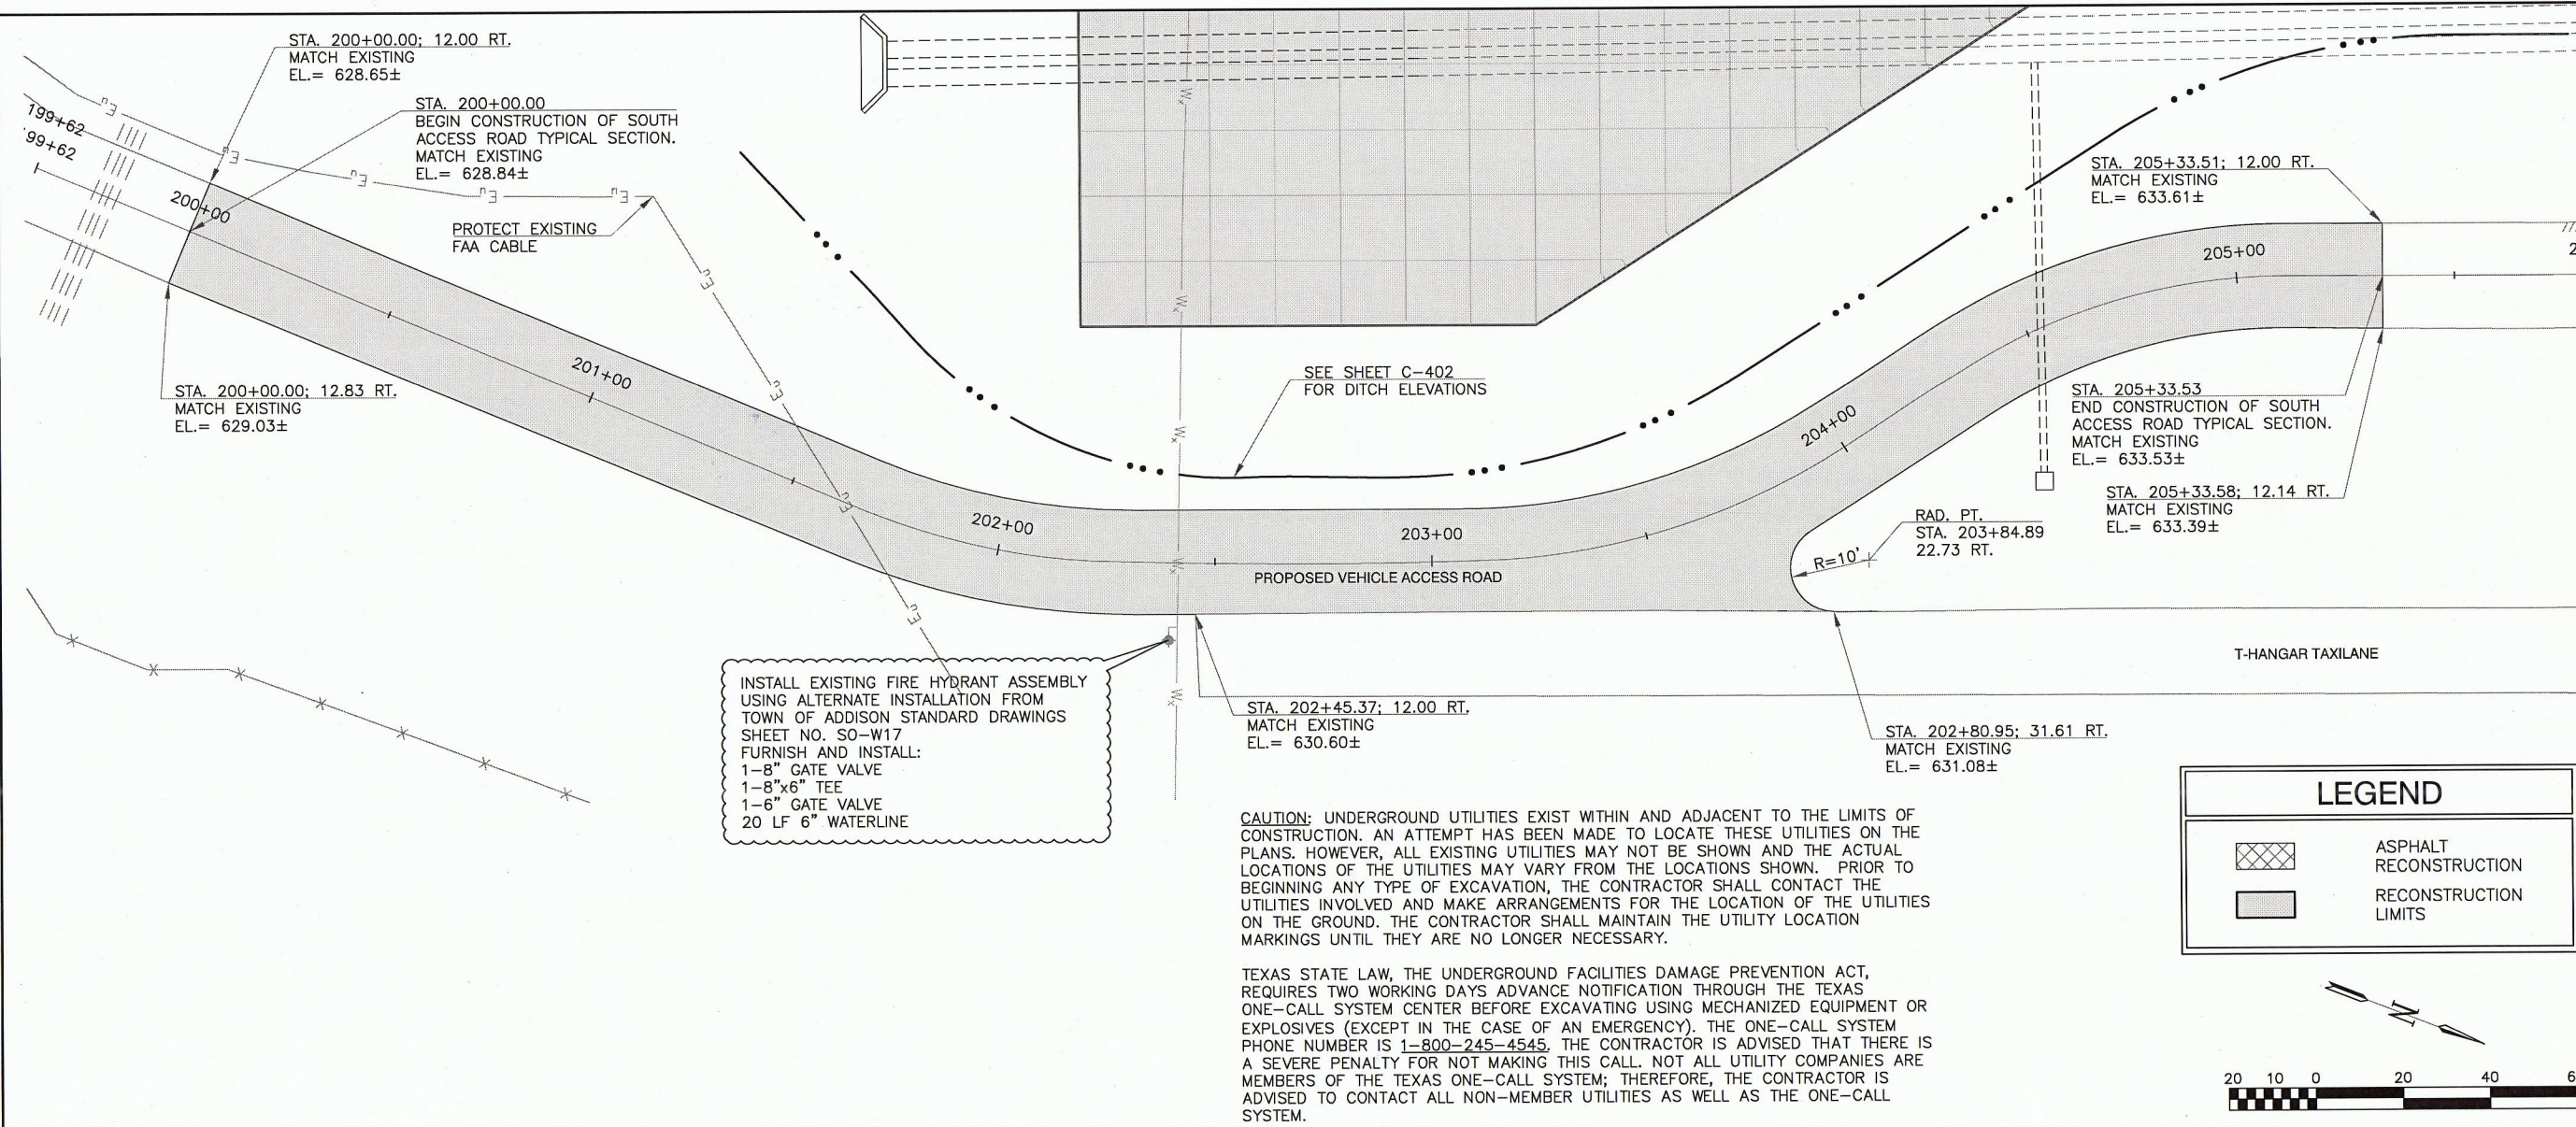



INSTALL EXISTING FIRE HYDRANT ASSEMBLY
 USING ALTERNATE INSTALLATION FROM
 TOWN OF ADDISON STANDARD DRAWINGS
 SHEET NO. SO-W17
 FURNISH AND INSTALL:
 1-8" GATE VALVE
 1-8"x6" TEE
 1-6" GATE VALVE
 20 LF 6" WATERLINE


CAUTION: UNDERGROUND UTILITIES EXIST WITHIN AND ADJACENT TO THE LIMITS OF
 CONSTRUCTION. AN ATTEMPT HAS BEEN MADE TO LOCATE THESE UTILITIES ON THE
 PLANS. HOWEVER, ALL EXISTING UTILITIES MAY NOT BE SHOWN AND THE ACTUAL
 LOCATIONS OF THE UTILITIES MAY VARY FROM THE LOCATIONS SHOWN. PRIOR TO
 BEGINNING ANY TYPE OF EXCAVATION, THE CONTRACTOR SHALL CONTACT THE
 UTILITIES INVOLVED AND MAKE ARRANGEMENTS FOR THE LOCATION OF THE UTILITIES
 ON THE GROUND. THE CONTRACTOR SHALL MAINTAIN THE UTILITY LOCATION
 MARKINGS UNTIL THEY ARE NO LONGER NECESSARY.

TEXAS STATE LAW, THE UNDERGROUND FACILITIES DAMAGE PREVENTION ACT,
 REQUIRES TWO WORKING DAYS ADVANCE NOTIFICATION THROUGH THE TEXAS
 ONE-CALL SYSTEM CENTER BEFORE EXCAVATING USING MECHANIZED EQUIPMENT OR
 EXPLOSIVES (EXCEPT IN THE CASE OF AN EMERGENCY). THE ONE-CALL SYSTEM
 PHONE NUMBER IS 1-800-245-4545. THE CONTRACTOR IS ADVISED THAT THERE IS
 A SEVERE PENALTY FOR NOT MAKING THIS CALL. NOT ALL UTILITY COMPANIES ARE
 MEMBERS OF THE TEXAS ONE-CALL SYSTEM; THEREFORE, THE CONTRACTOR IS
 ADVISED TO CONTACT ALL NON-MEMBER UTILITIES AS WELL AS THE ONE-CALL
 SYSTEM.

LEGEND	
	ASPHALT RECONSTRUCTION
	RECONSTRUCTION LIMITS

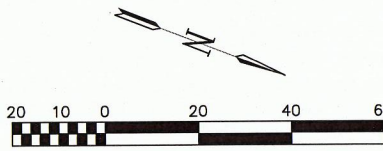



REGISTRATION NO.
 F-5713


REV.	DATE	DESCRIPTION	BY

ADDISON AIRPORT
ADDISON, TX

TAXIWAY ALPHA IMPROVEMENTS

SOUTH AIRCRAFT
 HOLDING BAY -
 SOUTH ACCESS
 ROAD
 PLAN & PROFILE
 (ALTERNATE D)

JOB NO.: 11081100
 DATE: FEB., 2012
 DESIGNED BY: MRM
 DRAWN BY: BMN

BAR IS ONE INCH ON
 ORIGINAL DRAWING
 IF NOT ONE INCH ON
 THIS SHEET, ADJUST
 SCALES ACCORDINGLY.

SHEET NUMBER

C-405