


CONTRACTOR SHALL VERIFY NOZZLE SIZES IN FIELD FOR MFR AND HEAD TO HEAD COVERAGE OVERSPRAY ONTO PAVEMENT SHALL BE ACCEPTED. CONTRACTOR TO MINIMIZE OVERSPRAY. NO

- RAINBIRD 1804-PRS-SAM SERIES 4" POP-UP SPRAY - MPR NOZZLES
- RAINBIRD 1806-PRS-SAM SERIES 6" POP-UP SPRAY - MPR NOZZLES
- RAINBIRD 1812-PRS-SAM SERIES 12" POP-UP SPRAY - MPR NOZZLES
- TORO FB-PC-50 SERIES 12" POP-UP BUBBLERS - TURF AREAS
- TORO FB-100 ON SCH 80 RISER W/SHRUB ADAPTOR - TREE WELLS
- HUNTER 120-ADV SERIES - 8.0 NOZZLE
- HUNTER 120-ADV SERIES - 4.0 NOZZLE
- HUNTER 120-6P-ADV SERIES - 8.0 NOZZLE
- HUNTER 120-6P-ADV SERIES - 4.0 NOZZLE
- HUNTER 120-HP-ADV SERIES - 8.0 NOZZLE
- HUNTER 120-HP-ADV SERIES - 4.0 NOZZLE
- △ HUNTER 120-HP-ADV SERIES - 4.0 NOZZLE
- ▽ WEATHERMATIC 1100CR SERIES REMOTE CONTROL VALVE
- ⊕ MAINFOLDED VALVES SHALL BE SPACED 4'-0" APART
- ⊕ BUCKNER GB38BL07 SINGLE LUG 3/4" QUICK COUPLING VALVE
- ⊕ SPEARS PLASTIC BALL VALVE - Same size as mainline

- ⊕ WATTS 007M SERIES INLINE DCA - 2"
- ⊕ HERSEY MWR WATER METER - 2"
- ⊕ RAINMASTER EVOLUTION DX-2 CONTROLLER-ELECT
- ⊕ DISTRIBUTION AND PHONE SERVICE LINES TO THE IR
- ⊕ CONTRACTORS SHALL BE THE RESPONSIBILITY OF THE
- ⊕ CONTRACTOR, THE ELECTRICAL AND PHONE LINES
- ⊕ RELATED WORK SHALL BE INSTALLED PER ALL LOC
- ⊕ AND NATIONAL CODES
- ⊕ FLOW METER - SAME SIZE AS MAINLINE
- ⊕ FS-200 DATA INDUSTRIAL FLOW METER
- ⊕ SCHEDULE 40 PVC MAINLINE - REF PLAN
- ⊕ Class 315 IPS or Class 200 IPS Lateral Line
- ⊕ SCH 40 PVC SLEEVE - PERMANENTLY MARK CURBS
- ⊕ WITH LOCATIONS OF SLEEVES PER CITY STANDARDS
- ⊕ ZONE
- ⊕ CONTROLLER - STATION NUMBER
- ⊕ VALVE SIZE
- ⊕ GPM PER VALVE

IRRIGATION LEGEND:

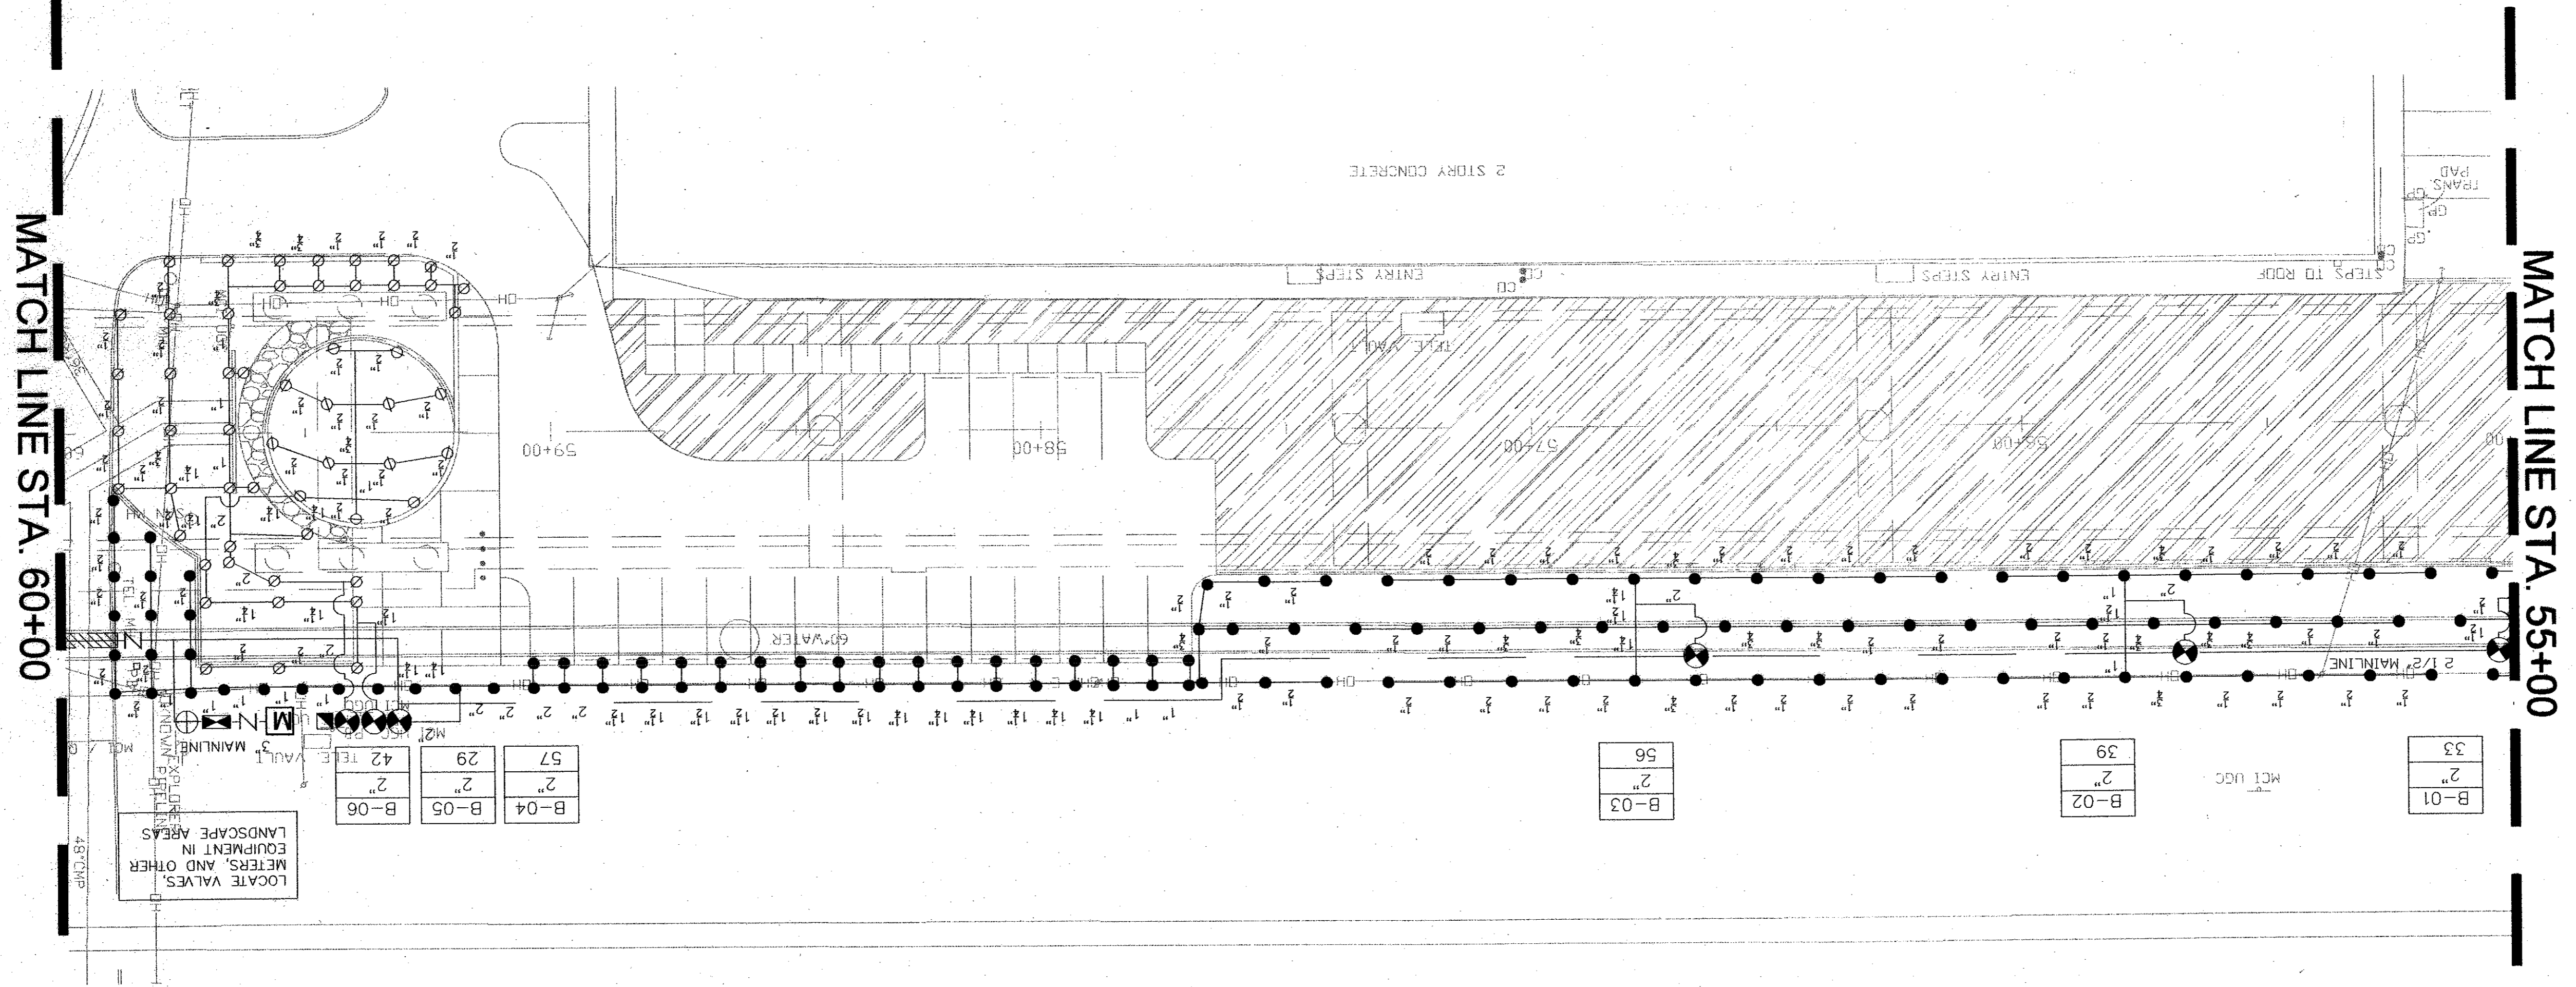

MATCH LINE STA. 60+00

MATCH LINE STA. 55+00

VOTED

